



| DATE | BY | REVISION | DESCRIPTION |
|------|----|----------|-------------|
| | | 1 | REVISED |
| | | 2 | REVISED |
| | | 3 | REVISED |
| | | 4 | REVISED |
| | | 5 | REVISED |
| | | 6 | REVISED |
| | | 7 | REVISED |
| | | 8 | REVISED |
| | | 9 | REVISED |
| | | 10 | REVISED |
| | | 11 | REVISED |
| | | 12 | REVISED |
| | | 13 | REVISED |
| | | 14 | REVISED |
| | | 15 | REVISED |
| | | 16 | REVISED |
| | | 17 | REVISED |
| | | 18 | REVISED |
| | | 19 | REVISED |
| | | 20 | REVISED |
| | | 21 | REVISED |
| | | 22 | REVISED |
| | | 23 | REVISED |
| | | 24 | REVISED |
| | | 25 | REVISED |
| | | 26 | REVISED |
| | | 27 | REVISED |
| | | 28 | REVISED |
| | | 29 | REVISED |
| | | 30 | REVISED |
| | | 31 | REVISED |
| | | 32 | REVISED |
| | | 33 | REVISED |
| | | 34 | REVISED |
| | | 35 | REVISED |
| | | 36 | REVISED |
| | | 37 | REVISED |
| | | 38 | REVISED |
| | | 39 | REVISED |
| | | 40 | REVISED |
| | | 41 | REVISED |
| | | 42 | REVISED |
| | | 43 | REVISED |
| | | 44 | REVISED |
| | | 45 | REVISED |
| | | 46 | REVISED |
| | | 47 | REVISED |
| | | 48 | REVISED |
| | | 49 | REVISED |
| | | 50 | REVISED |
| | | 51 | REVISED |
| | | 52 | REVISED |
| | | 53 | REVISED |
| | | 54 | REVISED |
| | | 55 | REVISED |
| | | 56 | REVISED |
| | | 57 | REVISED |
| | | 58 | REVISED |
| | | 59 | REVISED |
| | | 60 | REVISED |
| | | 61 | REVISED |
| | | 62 | REVISED |
| | | 63 | REVISED |
| | | 64 | REVISED |
| | | 65 | REVISED |
| | | 66 | REVISED |
| | | 67 | REVISED |
| | | 68 | REVISED |
| | | 69 | REVISED |
| | | 70 | REVISED |
| | | 71 | REVISED |
| | | 72 | REVISED |
| | | 73 | REVISED |
| | | 74 | REVISED |
| | | 75 | REVISED |
| | | 76 | REVISED |
| | | 77 | REVISED |
| | | 78 | REVISED |
| | | 79 | REVISED |
| | | 80 | REVISED |
| | | 81 | REVISED |
| | | 82 | REVISED |
| | | 83 | REVISED |
| | | 84 | REVISED |
| | | 85 | REVISED |
| | | 86 | REVISED |
| | | 87 | REVISED |
| | | 88 | REVISED |
| | | 89 | REVISED |
| | | 90 | REVISED |
| | | 91 | REVISED |
| | | 92 | REVISED |
| | | 93 | REVISED |
| | | 94 | REVISED |
| | | 95 | REVISED |
| | | 96 | REVISED |
| | | 97 | REVISED |
| | | 98 | REVISED |
| | | 99 | REVISED |
| | | 100 | REVISED |

| DATE | BY | REVISION | DESCRIPTION |
|------|----|----------|-------------|
| | | 1 | REVISED |
| | | 2 | REVISED |
| | | 3 | REVISED |
| | | 4 | REVISED |
| | | 5 | REVISED |
| | | 6 | REVISED |
| | | 7 | REVISED |
| | | 8 | REVISED |
| | | 9 | REVISED |
| | | 10 | REVISED |
| | | 11 | REVISED |
| | | 12 | REVISED |
| | | 13 | REVISED |
| | | 14 | REVISED |
| | | 15 | REVISED |
| | | 16 | REVISED |
| | | 17 | REVISED |
| | | 18 | REVISED |
| | | 19 | REVISED |
| | | 20 | REVISED |
| | | 21 | REVISED |
| | | 22 | REVISED |
| | | 23 | REVISED |
| | | 24 | REVISED |
| | | 25 | REVISED |
| | | 26 | REVISED |
| | | 27 | REVISED |
| | | 28 | REVISED |
| | | 29 | REVISED |
| | | 30 | REVISED |
| | | 31 | REVISED |
| | | 32 | REVISED |
| | | 33 | REVISED |
| | | 34 | REVISED |
| | | 35 | REVISED |
| | | 36 | REVISED |
| | | 37 | REVISED |
| | | 38 | REVISED |
| | | 39 | REVISED |
| | | 40 | REVISED |
| | | 41 | REVISED |
| | | 42 | REVISED |
| | | 43 | REVISED |
| | | 44 | REVISED |
| | | 45 | REVISED |
| | | 46 | REVISED |
| | | 47 | REVISED |
| | | 48 | REVISED |
| | | 49 | REVISED |
| | | 50 | REVISED |
| | | 51 | REVISED |
| | | 52 | REVISED |
| | | 53 | REVISED |
| | | 54 | REVISED |
| | | 55 | REVISED |
| | | 56 | REVISED |
| | | 57 | REVISED |
| | | 58 | REVISED |
| | | 59 | REVISED |
| | | 60 | REVISED |
| | | 61 | REVISED |
| | | 62 | REVISED |
| | | 63 | REVISED |
| | | 64 | REVISED |
| | | 65 | REVISED |
| | | 66 | REVISED |
| | | 67 | REVISED |
| | | 68 | REVISED |
| | | 69 | REVISED |
| | | 70 | REVISED |
| | | 71 | REVISED |
| | | 72 | REVISED |
| | | 73 | REVISED |
| | | 74 | REVISED |
| | | 75 | REVISED |
| | | 76 | REVISED |
| | | 77 | REVISED |
| | | 78 | REVISED |
| | | 79 | REVISED |
| | | 80 | REVISED |
| | | 81 | REVISED |
| | | 82 | REVISED |
| | | 83 | REVISED |
| | | 84 | REVISED |
| | | 85 | REVISED |
| | | 86 | REVISED |
| | | 87 | REVISED |
| | | 88 | REVISED |
| | | 89 | REVISED |
| | | 90 | REVISED |
| | | 91 | REVISED |
| | | 92 | REVISED |
| | | 93 | REVISED |
| | | 94 | REVISED |
| | | 95 | REVISED |
| | | 96 | REVISED |
| | | 97 | REVISED |
| | | 98 | REVISED |
| | | 99 | REVISED |
| | | 100 | REVISED |


PLOT DATE = 2/15/2006
 PLOT SCALE = 1/8" = 1'-0"
 USER NAME = enginemat

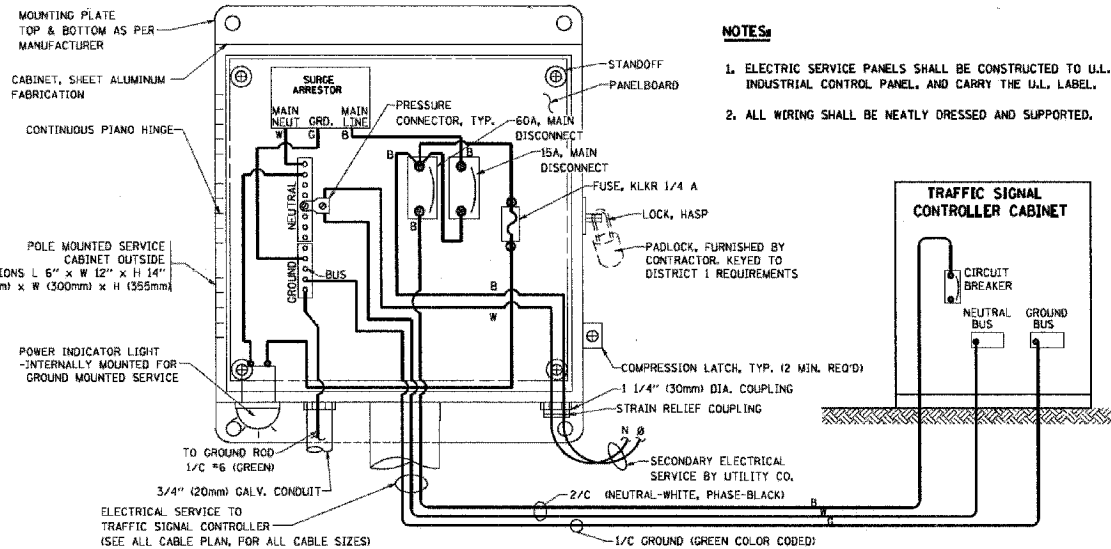


ELECTRICAL SERVICE - PANEL DIAGRAM (TYPICAL FOR POLE AND GROUND MOUNTED SERVICE)
SERVICE INSTALLATION POLE MOUNT (SHOWN)
 (NOT TO SCALE)

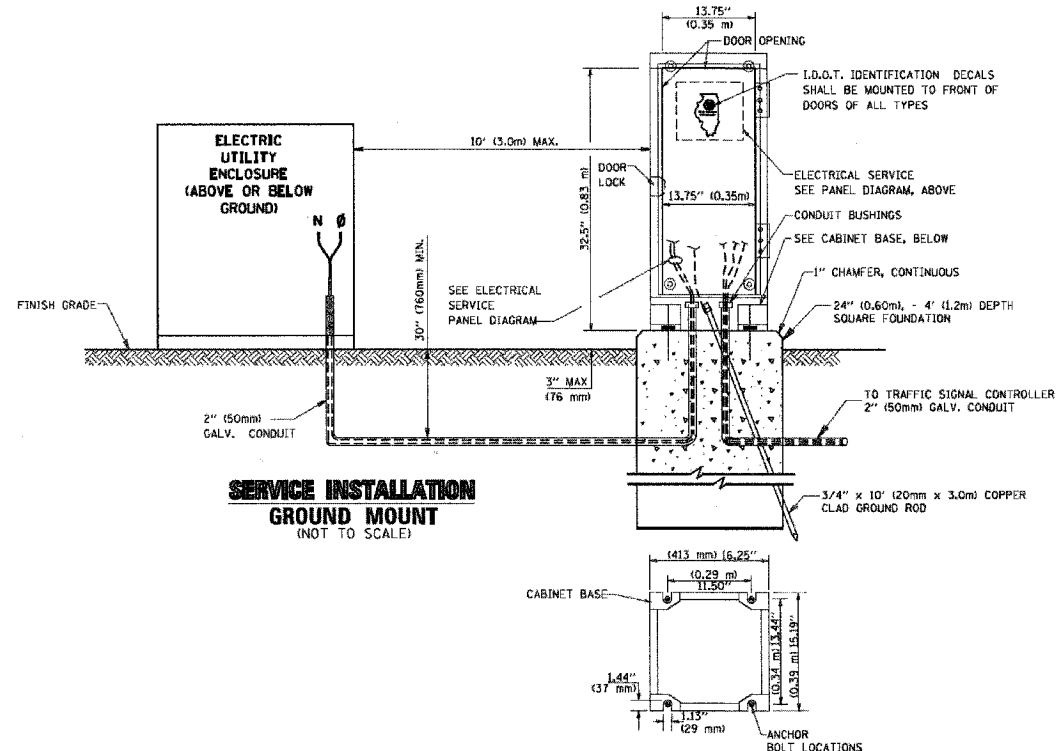


CABINET - BASE BOLT PATTERN
 (NOT TO SCALE)

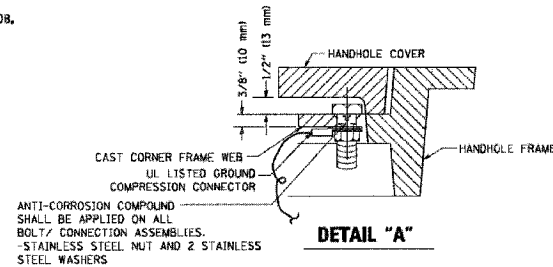

DETAIL "A"

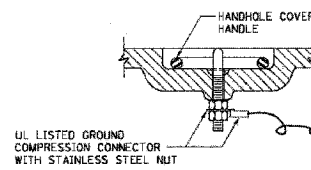


DETAIL "B"

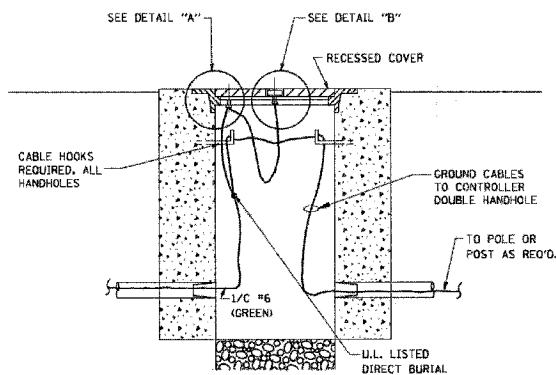

HANDHOLE COVER & FRAME - GROUNDING DETAIL

(2) 1/2" x 1 1/4" STAINLESS STEEL BOLT WITH SPLIT LOCK WASHER AND NYLON INSERT LOCKOUT WELDED TO FRAME AND TO COVER. (TYPICAL)

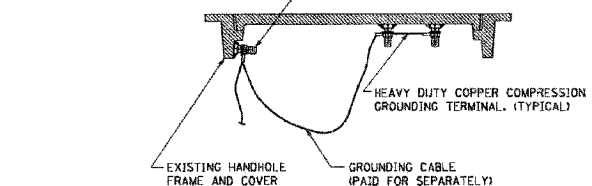


EXISTING HANDHOLE COVER & FRAME - GROUNDING DETAIL


NOTES:

GROUNDING SYSTEM

1. THE GROUNDING SYSTEM SHALL CONSIST OF AN INSULATED CONDUCTOR TYPE XLP, NO. 6 A.W.G., STRANDED COPPER TO BE INSTALLED IN RACEWAYS. THE GROUNDING CABLE SHALL BE INSTALLED IN A CONTINUOUS MANNER AS SHOWN ON THE CABLE PLAN PROVIDED. ALL GROUNDING CONDUCTORS SHALL BE BONDED TO METAL ENCLOSURE (HANDHOLE, POST, MAST ARM, CONTROLLER, ETC.). GROUND ROD SHALL BE 3/4" DIA. x 10'-0" (20mm x 3.0m) LONG, COPPER CLAD. ONE GROUND ROD SHALL BE INSTALLED AT ALL POST FOUNDATIONS, POLE FOUNDATIONS, CONTROLLER CABINET FOUNDATION AND ELECTRICAL SERVICE INSTALLATION AS INDICATED ON THE CABLE PLAN. IF THERE ARE ANY SPECIAL CONDITIONS SUCH AS SUB-SURFACE CONDITIONS OR INSTALLATION PROBLEMS, THE RESIDENT ENGINEER SHALL BE NOTIFIED OR CONTACT THE BUREAU OF TRAFFIC, ILLINOIS DEPARTMENT OF TRANSPORTATION DISTRICT ONE AT (847) 705-4139.
2. THE NEUTRAL CONDUCTOR AND THE GROUND CONDUCTOR SHALL BE CONNECTED IN THE SERVICE INSTALLATION. AT NO OTHER POINT IN THE TRAFFIC SIGNAL SYSTEM SHALL THE NEUTRAL AND GROUND CONDUCTORS BE CONNECTED.
3. ALL EQUIPMENT GROUNDING CONDUCTORS SHALL TERMINATE AT THE GROUND BUS IN THE CONTROLLER CABINET.
4. THE CONTRACTOR SHALL PROVIDE A GROUND CABLE WITH CONNECTORS BETWEEN THE HANDHOLE COVER AND HANDHOLE FRAME.




HEAVY-DUTY COMPRESSION TERMINAL (BUNRDY TYPE YCHA OR APPROVED EQUAL)



3/4" (20mm) HEAVY-DUTY GROUND ROD CLAMP (BUNRDY TYPE GRC OR APPROVED EQUAL)

NOTES:

- ALL CLAMPS SHALL BE BRONZE OR COPPER, UL APPROVED.
- GROUND CABLE SHALL BE LOOPEO OVER HOOKS IN THE HANDHOLES 6.5' (2.0m) SLACK SHALL BE PROVIDED IN SINGLE HANDHOLES 13' (4.0m) OF SLACK SHALL BE PROVIDED IN DOUBLE HANDHOLES. 5' (1.4m) OF SLACK SHALL BE PROVIDED BETWEEN FRAME AND COVER.

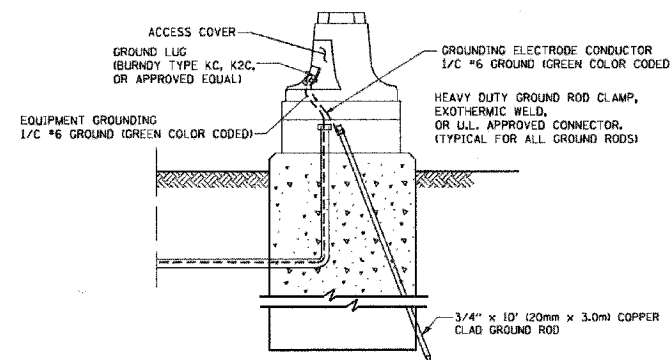

MAST ARM POLE / POST-GROUNDING DETAIL

| REVISIONS | NAME | DATE |
|-----------|-------------------|---------|
| 1 | CAD | 5/30/00 |
| 2 | CAD | 3/15/01 |
| 3 | BUREAU OF TRAFFIC | 1/01/02 |

ILLINOIS DEPARTMENT OF TRANSPORTATION

DISTRICT ONE
STANDARD TRAFFIC SIGNAL
DESIGN DETAILS

SCALE: NONE
 DATE: 2/15/2006

DRAWN BY: RWP
 DESIGNED BY: DAZ
 CHECKED BY: DAZ
 SHEET 3 OF 4
 TS05
 REVISION DATE: 8/04/02

ILLINOIS DEPARTMENT OF TRANSPORTATION
 ILLINOIS ROUTE 56 AT KIRK / FARNSWORTH

STANDARD TRAFFIC SIGNAL
DESIGN DETAILS

SCALE: VERT.
 HORIZ.
 DATE: APR 06 2007

DRAWN BY: BAH
 CHECKED BY: APS