


3 INTERMEDIATE FLOOR (-2) POWER PLAN - EL:684.00
SCALE: 1/4" = 1'-0"

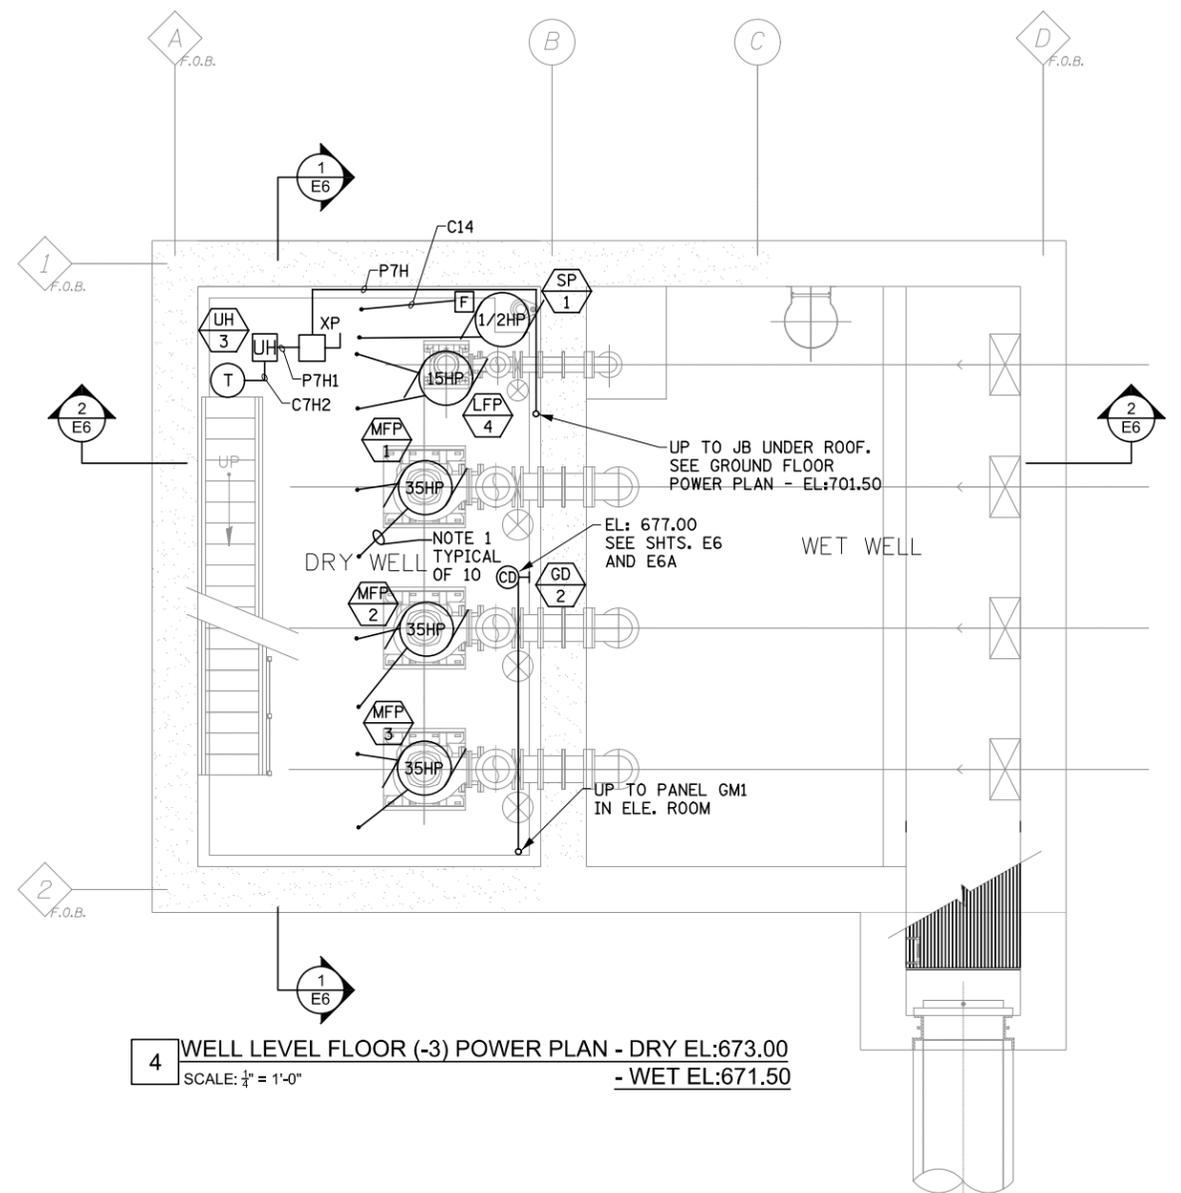

4 WELL LEVEL FLOOR (-3) POWER PLAN - DRY EL:673.00
- WET EL:671.50
SCALE: 1/4" = 1'-0"

NOTES:

1. CABLES BY PUMP MANUFACTURER UP TO DISCONNECTS AT INTERMEDIATE FLOOR (-1) - EL:692.75
2. FOR DETAILS OF CONDUIT AND CABLE RUNS FROM MCC TO MFP-1, MFP-2, MFP-3, LFP-4, AND SP-1 SEE SHEET E6.
3. ELECTRICAL INSTALLATION AND EQUIPMENT WITHIN ENTIRE WET AND DRY WELL AREA SHALL BE PER N.E.C. CLASS I DIV. 2.



E5B