


THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123. CONTACT AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING AIRPORT CABLES.

QUANTITIES - REMOVAL				
ITEM No.	DESCRIPTION	UNIT	QUANTITY	AS BUILT QUANTITY
AR110906	REMOVE ELECTRICAL HANDHOLE	EACH	1	
AR125901	REMOVE STAKE MOUNTED LIGHT	EACH	36	
AR125902	REMOVE BASE MOUNTED LIGHT	EACH	4	
AR125904	REMOVE TAXI GUIDANCE SIGN	EACH	3	
AR125961	RELOCATE STAKE MOUNTED LIGHT	EACH	4	
AR125962	RELOCATE BASE MOUNTED LIGHT	EACH	2	
AR125964	RELOCATE TAXI GUIDANCE SIGN	EACH	1	

LEGEND

- PROPOSED CONCRETE PAVEMENT
- EXISTING PAVEMENT
- EXISTING ELECTRICAL CABLE
- EXISTING ELECTRICAL CABLE TO BE ABANDONED/CURRENTLY ABANDONED
- EXISTING BASE MOUNT RUNWAY LIGHT
- EXISTING BASE MOUNT TAXIWAY LIGHT
- EXISTING STAKE MOUNT TAXIWAY LIGHT
- EXISTING TAXIWAY GUIDANCE SIGN
- EXISTING ELECTRICAL HANDHOLE
- EXISTING ELECTRICAL DUCT
- EXISTING STAKE MOUNT TAXIWAY/RUNWAY LIGHT TO BE REMOVED
- EXISTING BASE MOUNT TAXIWAY/RUNWAY LIGHT TO BE REMOVED
- EXISTING TAXIWAY GUIDANCE SIGN TO BE REMOVED
- EXISTING BASE MOUNT TAXIWAY/RUNWAY LIGHT TO BE RELOCATED

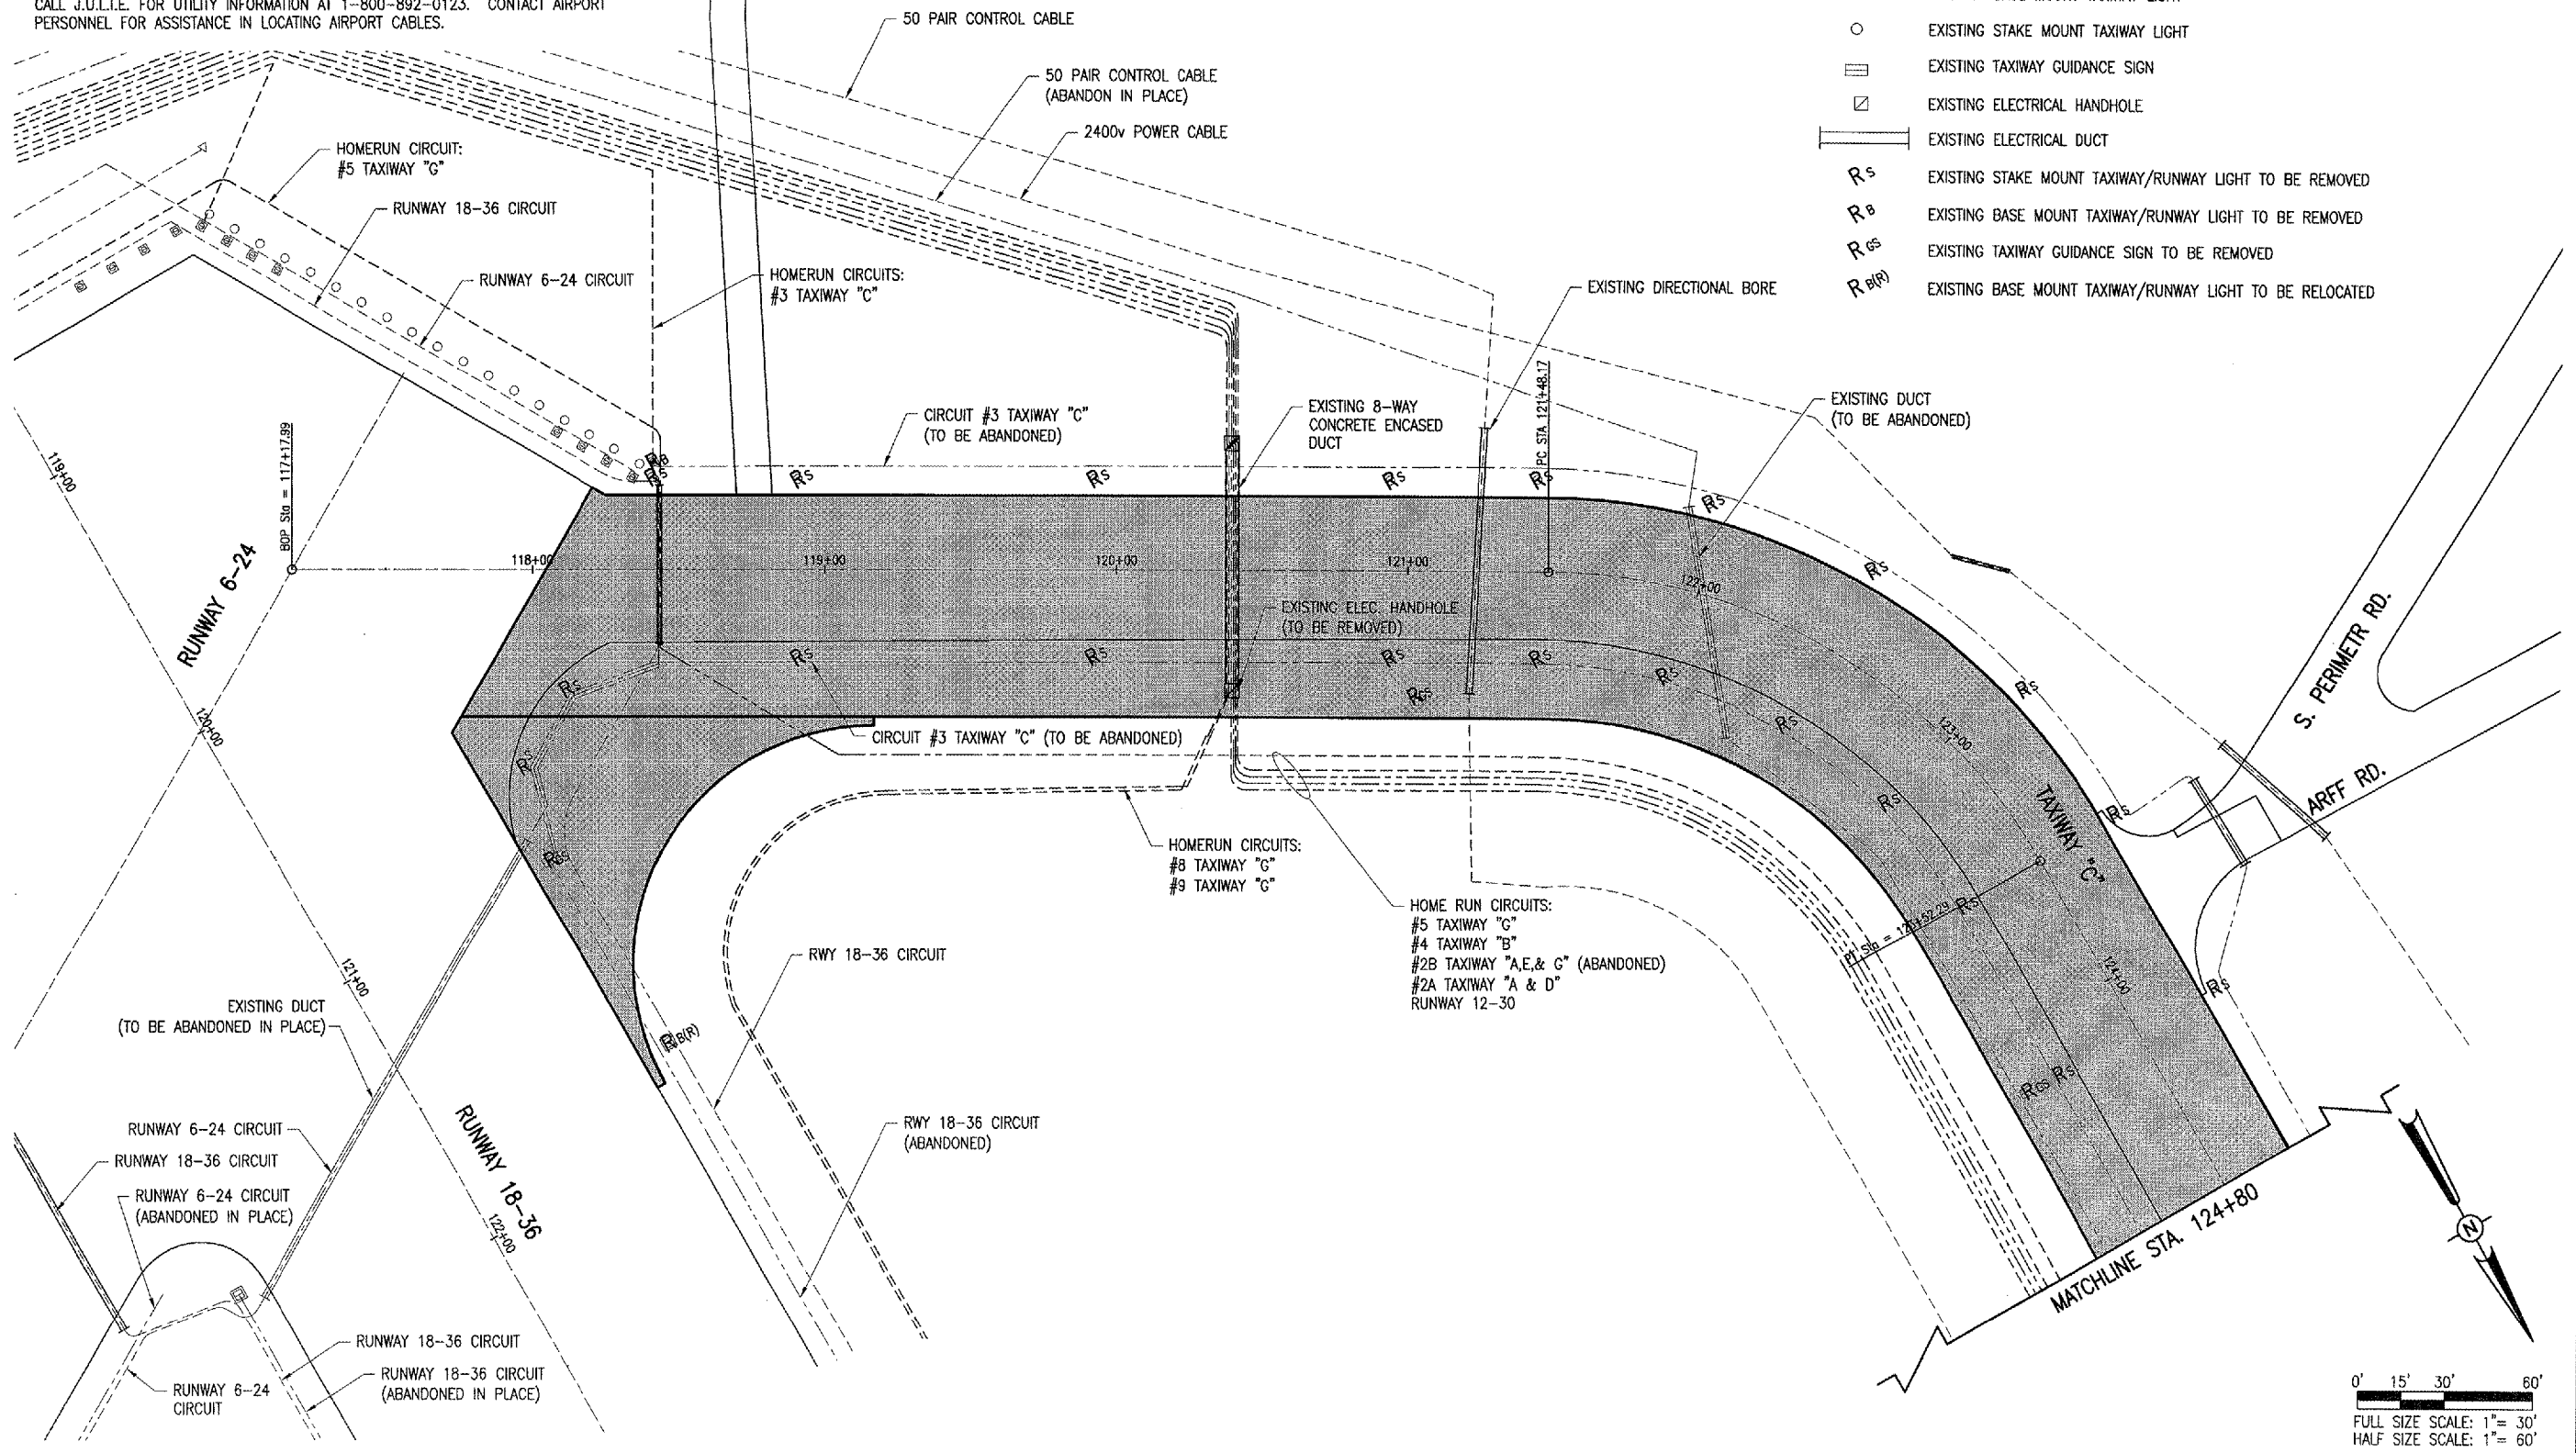

REVISION DATE		BY DATE		PROJECT: DEC-3588 A.I.P. PROJ.: 3-17-00
HANSON Hanson Professional Services Inc. 1525 South Sixth Street Springfield, Illinois 62703-2886 Offices Nationwide				
TAXIWAY "C" RECONSTRUCTION EXISTING ELECTRICAL PLAN STA. 117+99 TO STA. 124+80				
16 16 of 58 sheets				

APR 27, 2005 11:05 PM RAW
 I:\AIRPORTS\DECATUR\802-06TXX\AIRPORT\SHEETS\141ELE.DWG - Sta. 117+99 to Sta. 124+80

