




* Grind anchor rod to bright finish at ground clamp location before installing clamp.

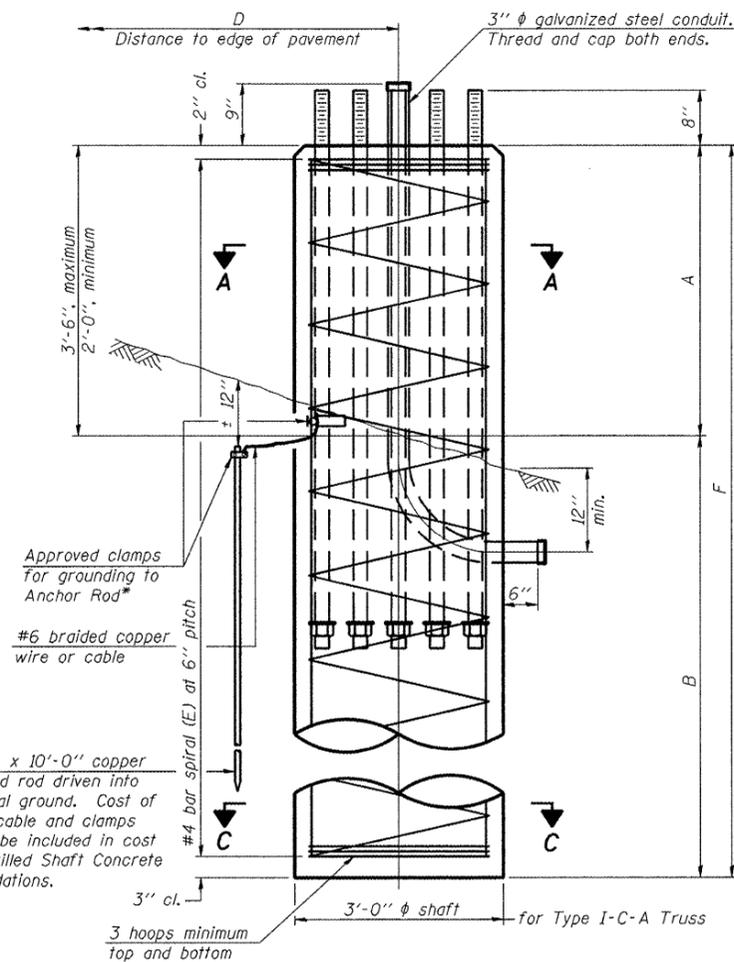

ELEVATION

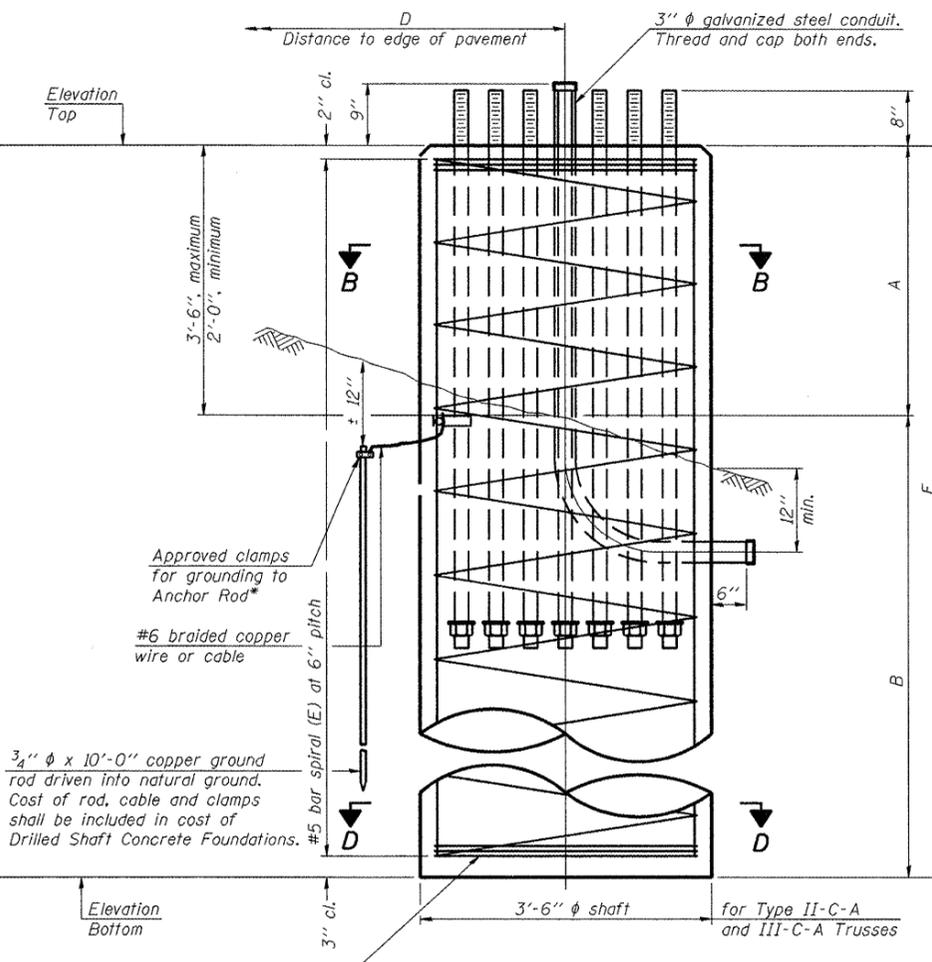


ELEVATION

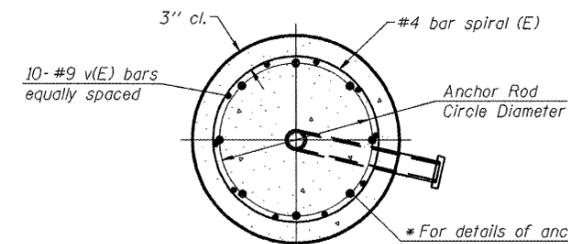


SECTION A-A

3'-0" ϕ shaft

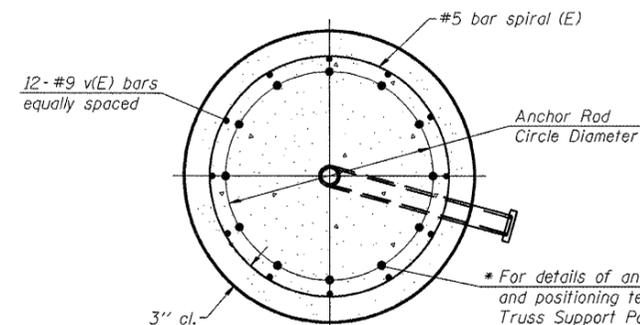


SECTION B-B

3'-6" ϕ shaft

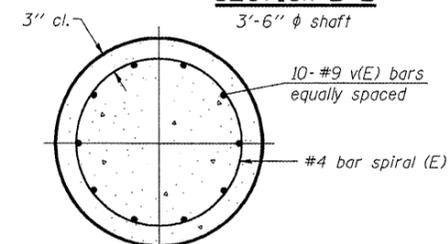

SECTION C-C

3'-0" ϕ shaft

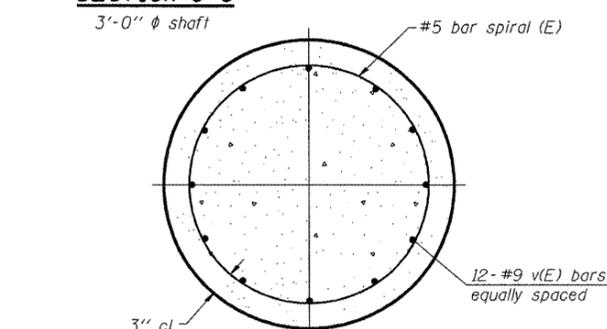

SECTION D-D

3'-6" ϕ shaft

NOTES:

The foundation dimensions shown in the Foundation Design Table are based on the presence of mostly cohesive soils with an average Unconfined Compressive Strength (Qu) of at least 1.25 tsf, which must be determined by previous soil investigations at the jobsite. When other conditions are indicated, the boring data will be included in the plans and the foundation dimensions shown in the Foundation Data Table will be the result of site specific designs.

If the conditions encountered are different than those indicated, the Contractor shall notify the Engineer to determine if the foundation dimensions need to be modified. If dimensions "B" or "F" are revised by more than 12" by the Contractor, "as-built" plans shall be prepared and submitted to the District Bureau of Operations for future reference.

No sonotubes or decomposable forms shall be used below the lower conduit entrance. Permanent metal forms or other shielding may not be left in place below that elevation without the Engineer's written permission.

Concrete shall be placed monolithically, without construction joints.

Backfill shall be placed per Article 502 of Standard Specification and prior to erection of support column.

A normal surface finish followed by a Bridge Seat Sealer application will be required on concrete surfaces above the lowest elevation 6" below finished ground line. Cost included in "Drilled Shaft Concrete Foundation".

FOUNDATION DESIGN TABLE

Truss Type	Post Base Sheet	Maximum Cantilever Length (ft)	Maximum Total Sign Area (sq ft)	Shaft Diameter (in)	"B" Depth (ft)	Anchor Rods		Anchor Rod Circle Diameter (in)
						No.	Diameter (in)	
I-C-A	OSC-A-4	25	170	3.0	16.0	8	2	22
II-C-A	OSC-A-5	30	170	3.5	17.0	12	2	30
II-C-A	OSC-A-5	30	340	3.5	21.5	12	2	30
III-C-A	OSC-A-5	35	170	3.5	19.0	12	2	30
III-C-A	OSC-A-5	35	250	3.5	22.5	12	2	30
III-C-A	OSC-A-5	35	400	3.5	26.5	12	2	30
III-C-A	OSC-A-5	40	400	3.5	32.0	12	2	30

FOUNDATION DATA TABLE

Structure Number	Station	Truss Type	Shaft Diameter	Elevation Top	Elevation Bottom	Qu	A	B	F	Class DS Concrete Cubic Yards
3C0061080R050.9	839+25 EB	II-C-A	3'-6"	101.34	82.34	3.5 tsf	2'-0"	17'-0"	19'-0"	6.1
3C0061080L051.7	886+45 WB	II-C-A	3'-6"	101.23	82.23	2.0 tsf	2'-0"	17'-0"	19'-0"	6.1

OSC-A-9

7-1-10

FILE NAME =	USER NAME = potelyj	DESIGNED - YOGESH PATEL	REVISED -
77-Sign Truss-shft-details.DGN		DRAWN - YOGESH PATEL	REVISED -
PLOT SCALE = 1/8" = 1'-0"		CHECKED -	REVISED -
PLOT DATE = Mar 14, 2011 - 02:00:06 PM		DATE -	REVISED -

**STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION**

**CANTILEVER SIGN STRUCTURES - DRILLED SHAFT
ALUMINUM TRUSS & STEEL POST**

F.A.I. RTE. I-80	SECTION D-3 OVD SIGN STR REPL 12-04	COUNTY BUREAU	TOTAL SHEETS 17	SHEET NO. 15
SCALE: _____		SHEET NO. 1 OF 1 SHEETS		STA. _____ TO STA. _____
ILLINOIS CONTRACT NO. 46177				