




EXISTING POLE WIRING DETAIL FOR 240/480V LIGHTING SYSTEMS (A-1)
N.T.S.

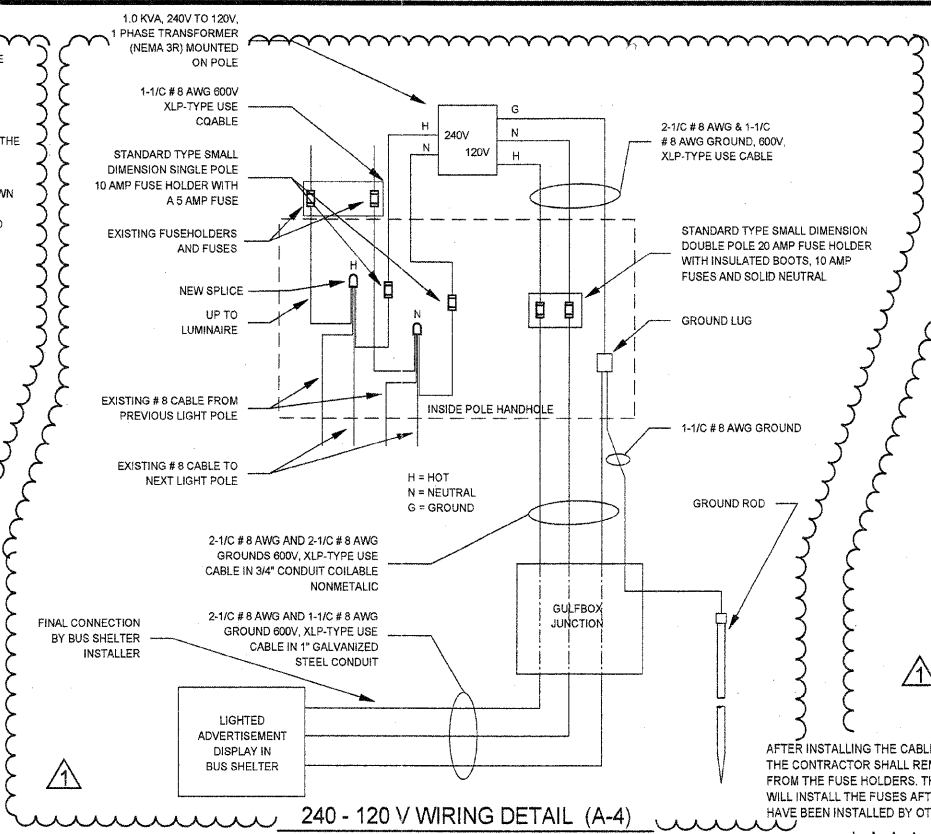

240 - 120 V WIRING DETAIL (A-4)
N.T.S.

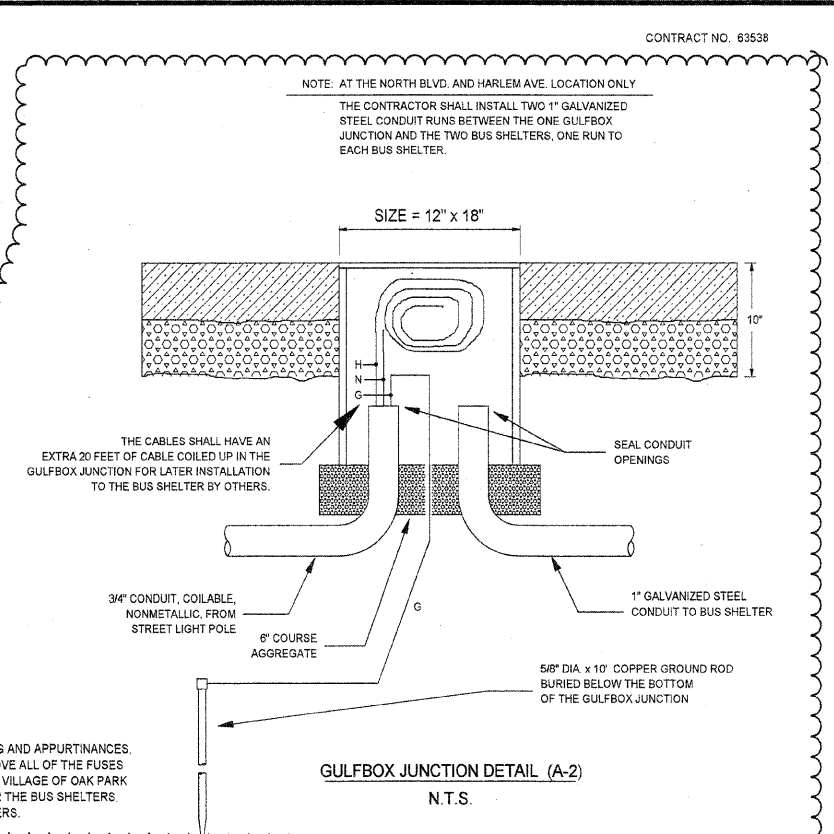

GULFBOX JUNCTION DETAIL (A-2)
N.T.S.

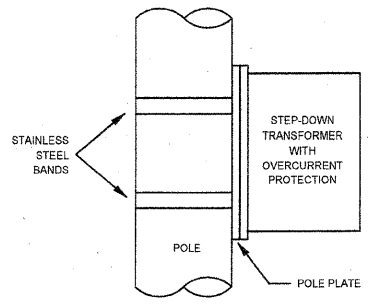


STEP-DOWN TRANSFORMER MOUNTING DETAIL

AFTER INSTALLING THE CABLING AND APPURTINANCES, THE CONTRACTOR SHALL REMOVE ALL OF THE FUSES FROM THE FUSE HOLDERS. THE VILLAGE OF OAK PARK WILL INSTALL THE FUSES AFTER THE BUS SHELTERS HAVE BEEN INSTALLED BY OTHERS.

THE CONTRACTOR SHALL FURNISH AND INSTALL OVERCURRENT PROTECTION, INCLUDING FUSEHOLDERS AND FUSES, AS SHOWN ON THE PLAN DETAILS. THE MATERIALS AND INSTALLATION SHALL CONFORM TO SECTION 1065.01 OF THE STANDARD SPECIFICATIONS. OVERCURRENT PROTECTION, INCLUDING FUSEHOLDERS AND FUSES, SHALL BE CONSIDERED AS INCLUDED IN THE COST OF THE ELECTRIC CABLE PAY ITEM.

DETAILS REARRANGED ON SHEETS 10, 11, AND 12. SOME DETAILS REVISED ON SHEETS 11 AND 12.

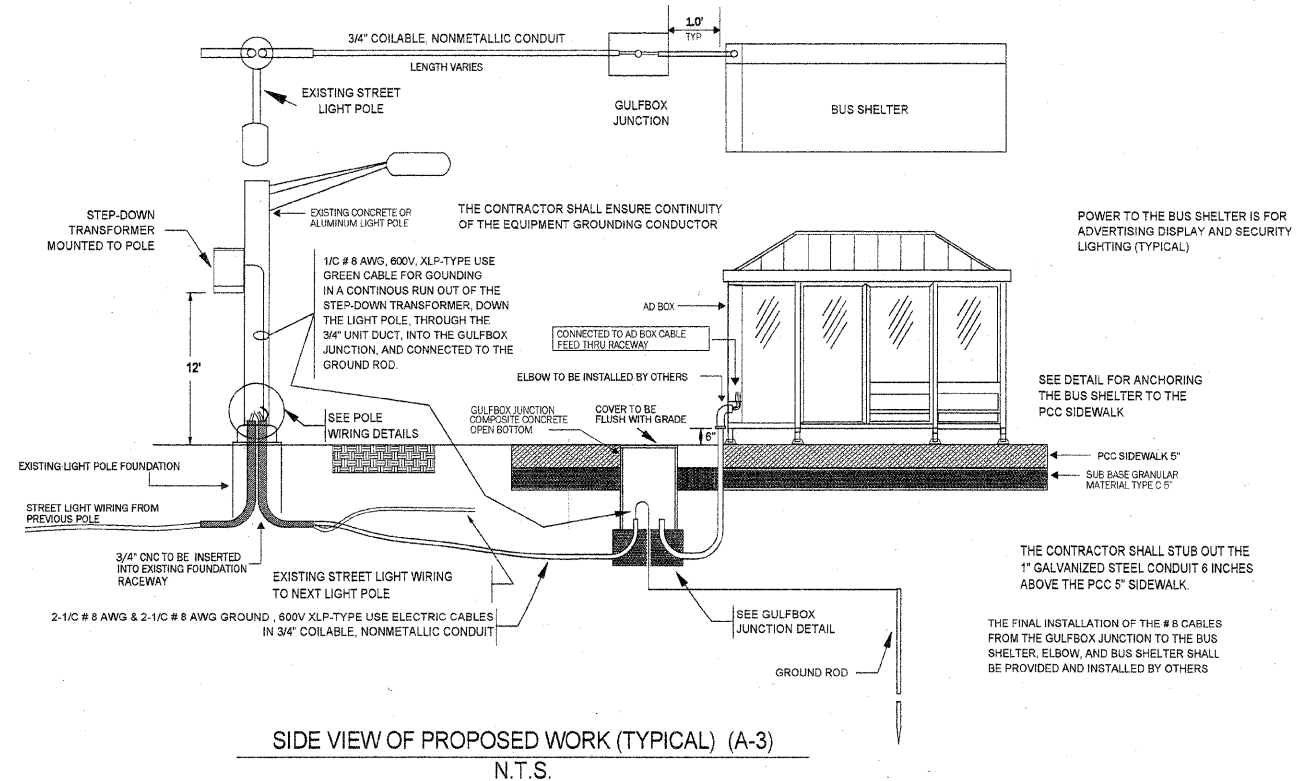

SIDE VIEW OF PROPOSED WORK (TYPICAL) (A-3)
N.T.S.

FILENAME = plan_details_sheef 3E.dwg

USER NAME = KOPERNIAK
PLOT SCALE = N.T.S.
PLOT DATE = MAR 2, 2011

DESIGNED BY: KOPERNIAK
DRAWN BY: KOPERNIAK
CHECKED BY: BUDRICK
DATE: MAR 2, 2011

REVISED: 03/31/2011
REVISED: 05/20/2011
REVISED:



VILLAGE OF OAK PARK

CONSTRUCTION DETAILS

SCALE: SHEET NO. OF SHEETS STA TO STA

DATE	SECTION	COUNTY	DATE	SHEET NO.
3/8	10-00251-00-MS	COOK	10	12

CONTRACT NO. 63538
ILLINOIS FED. AID PROJECT