




EXISTING POLE WIRING DETAIL FOR 240/480V LIGHTING SYSTEMS (A-1)
N.T.S.

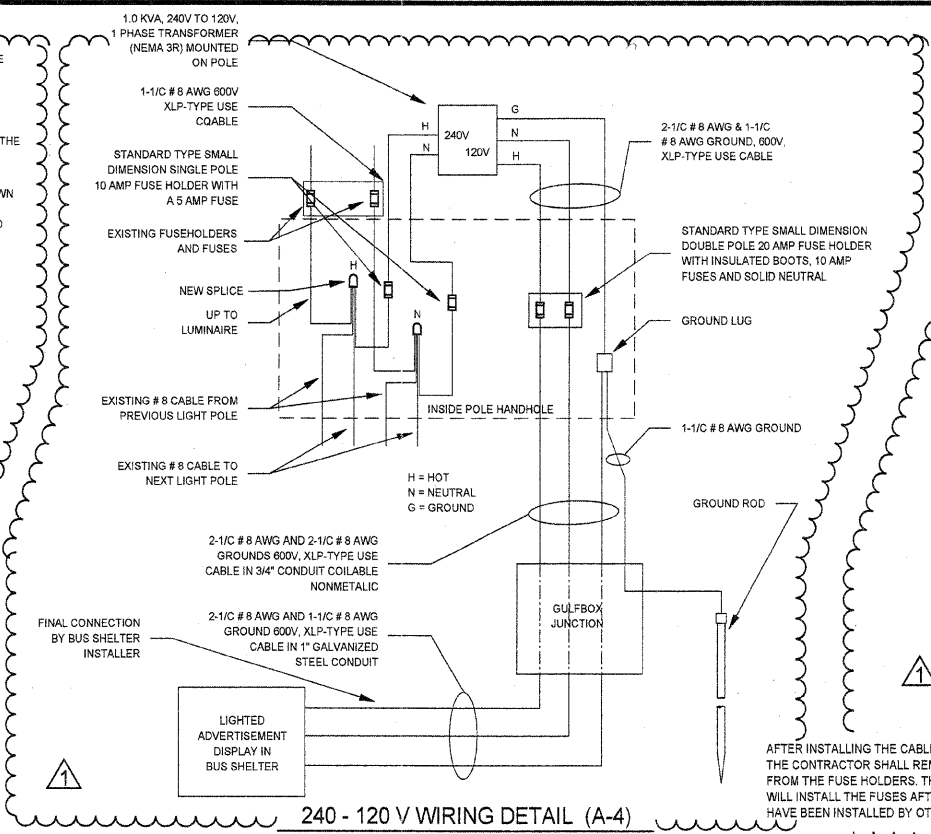

240 - 120 V WIRING DETAIL (A-4)
N.T.S.

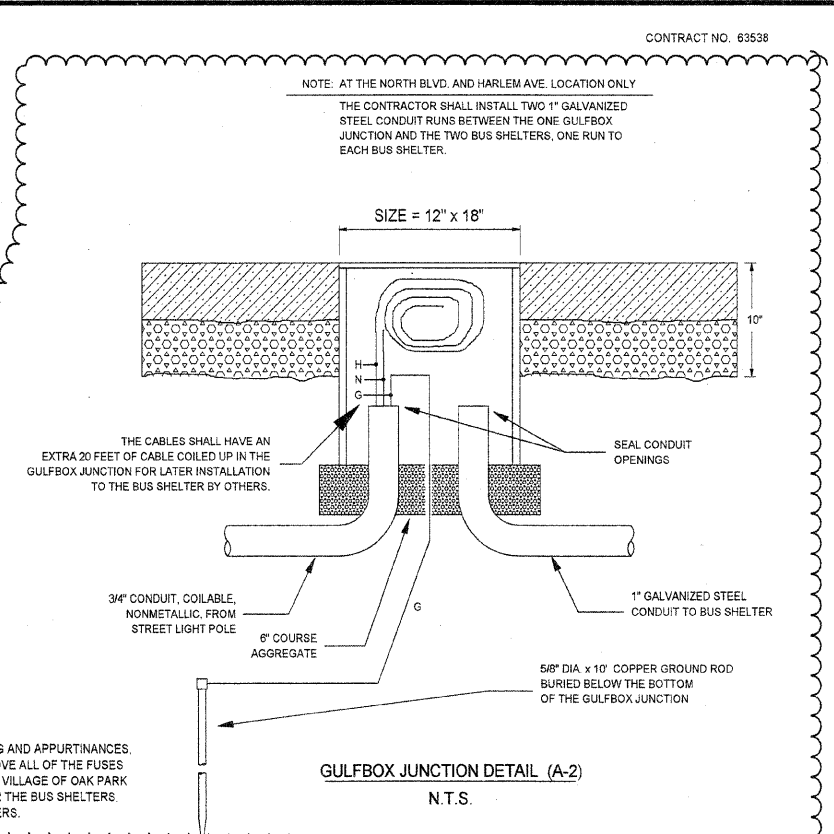

GULFBOX JUNCTION DETAIL (A-2)
N.T.S.

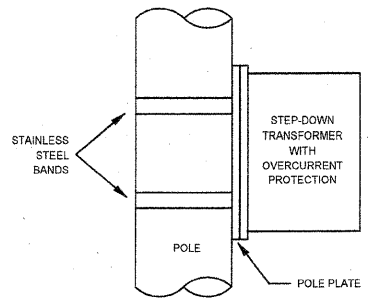


STEP-DOWN TRANSFORMER MOUNTING DETAIL

AFTER INSTALLING THE CABLING AND APPURTINANCES, THE CONTRACTOR SHALL REMOVE ALL OF THE FUSES FROM THE FUSE HOLDERS. THE VILLAGE OF OAK PARK WILL INSTALL THE FUSES AFTER THE BUS SHELTERS HAVE BEEN INSTALLED BY OTHERS.

THE CONTRACTOR SHALL FURNISH AND INSTALL OVERCURRENT PROTECTION, INCLUDING FUSEHOLDERS AND FUSES, AS SHOWN ON THE PLAN DETAILS. THE MATERIALS AND INSTALLATION SHALL CONFORM TO SECTION 1065.01 OF THE STANDARD SPECIFICATIONS. OVERCURRENT PROTECTION, INCLUDING FUSEHOLDERS AND FUSES, SHALL BE CONSIDERED AS INCLUDED IN THE COST OF THE ELECTRIC CABLE PAY ITEM.

DETAILS REARRANGED ON SHEETS 10, 11, AND 12. SOME DETAILS REVISED ON SHEETS 11 AND 12.

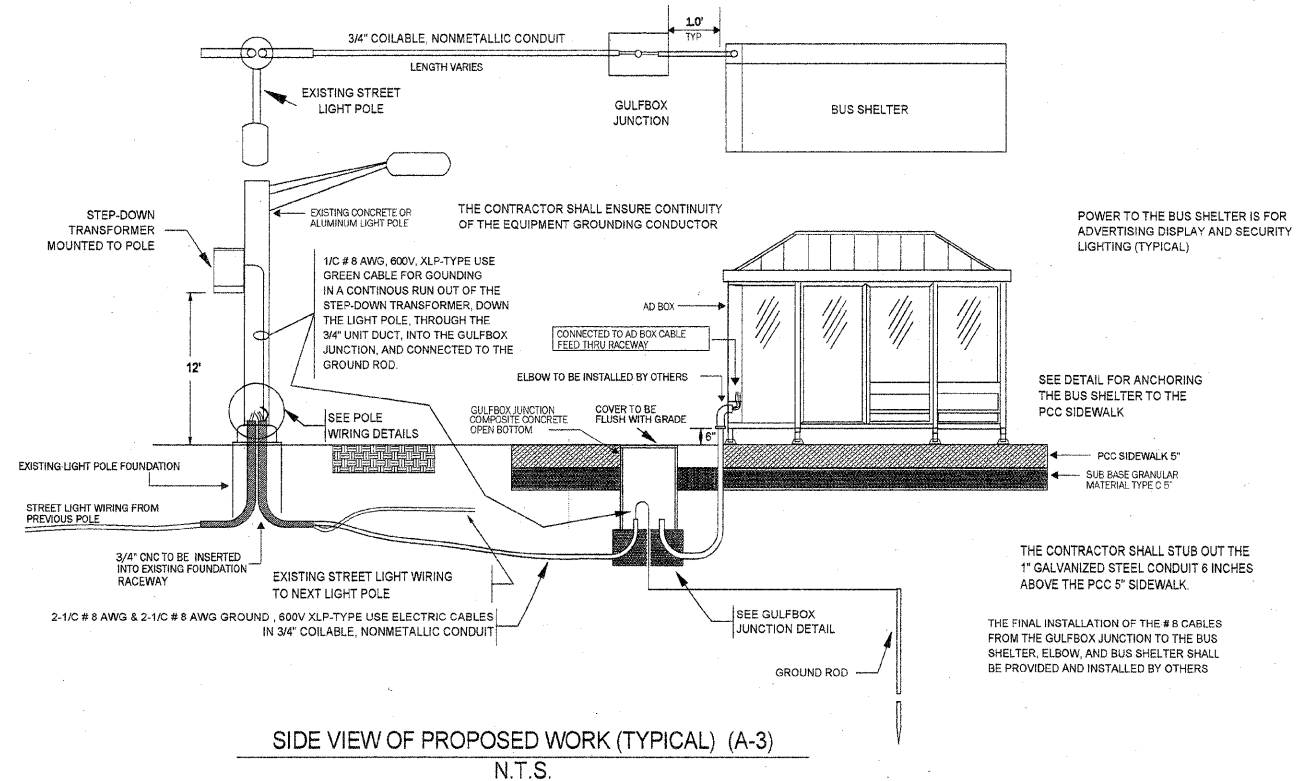

SIDE VIEW OF PROPOSED WORK (TYPICAL) (A-3)
N.T.S.

FILENAME = plan_details_sheet 3E.dwg	USER NAME = KOPERNIAK	DESIGNED BY: KOPERNIAK	REVISED: 03/31/2011		VILLAGE OF OAK PARK CONSTRUCTION DETAILS	DATE	SECTION	COUNTY	NO. OF SHEETS	SHEET NO.
		DRAWN BY: KOPERNIAK	REVISED: 05/20/2011			348	10-00251-00-MS	COOK	16	12
		CHECKED BY: BUDRICK	REVISED:							CONTRACT NO. 63538
		DATE: MAR 2, 2011	REVISED:							ILLINOIS FED. AID PROJECT