

Stainless steel standard grade wire cloth,
6x6 (1/4") mesh or less with #16 gauge
(0.062") diameter or heavier wire.


Attach with 1/2" stainless steel banding
or tie back onitself with stainless steel wire ties.
Finished installation must prevent rodent entry.

Cable splices according
to Art 1066.06 with
compression connectors
appropriately taped.

Surge protectors
(metal oxide-
varistor type)

2-1/c #10 XLP-USE
cable to each
luminaire

For each luminaire
use 2 pole fused
quick disconnect.
For receptacle
circuit (not shown)
use 2 pole
fuseholder with
solid neutral.

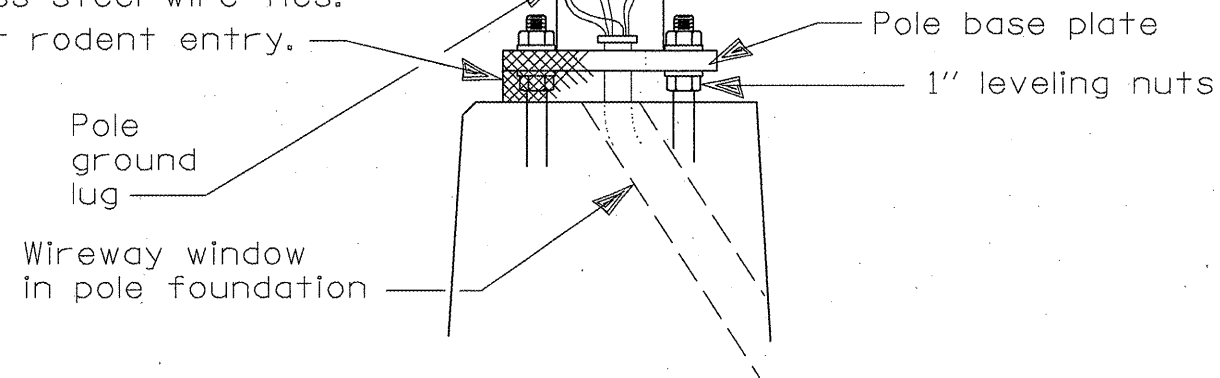

WIRING DETAIL

NO SCALE

GENERAL NOTES

All taped splices shall use 2 layers of electrical tape
over 3 layers of rubber tape as required by the
Standard Specifications. Coat the finished taped
splice with bonding compound.

All cable splices shall be taped unless another method
has been specifically approved by the Engineer.

For example purposes the pole is shown on an anchor base.
If the pole is required to be set on a breakaway base,
consult the Standard Specifications.

All dimensions are in millimeters (inches)
unless otherwise shown.

7/31/08 Updated

DRAFT COPY
not for distribution

FILE NAME =	USER NAME = baij	DESIGNED -	REVISED -	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	POLE HANDHOLE WIRING DRAFT			F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
cr:\pwr\work\pwr\dots\baij\dms20086\d653982	sh-t-3110-1g1000A.dgn	DRAWN -	REVISED -		310	69-3(3HB)	MORGAN	310	3110			
	PLOT SCALE = 8:26.000 mm / in.	CHECKED -	REVISED -		CONTRACT NO. 72667							
	PLOT DATE = May-19-2011 09:22:16AM	DATE -	REVISED -		SCALE:	SHEET NO.	OF SHEETS	STA.	TO STA.	ILLINOIS FED. AID PROJECT		