
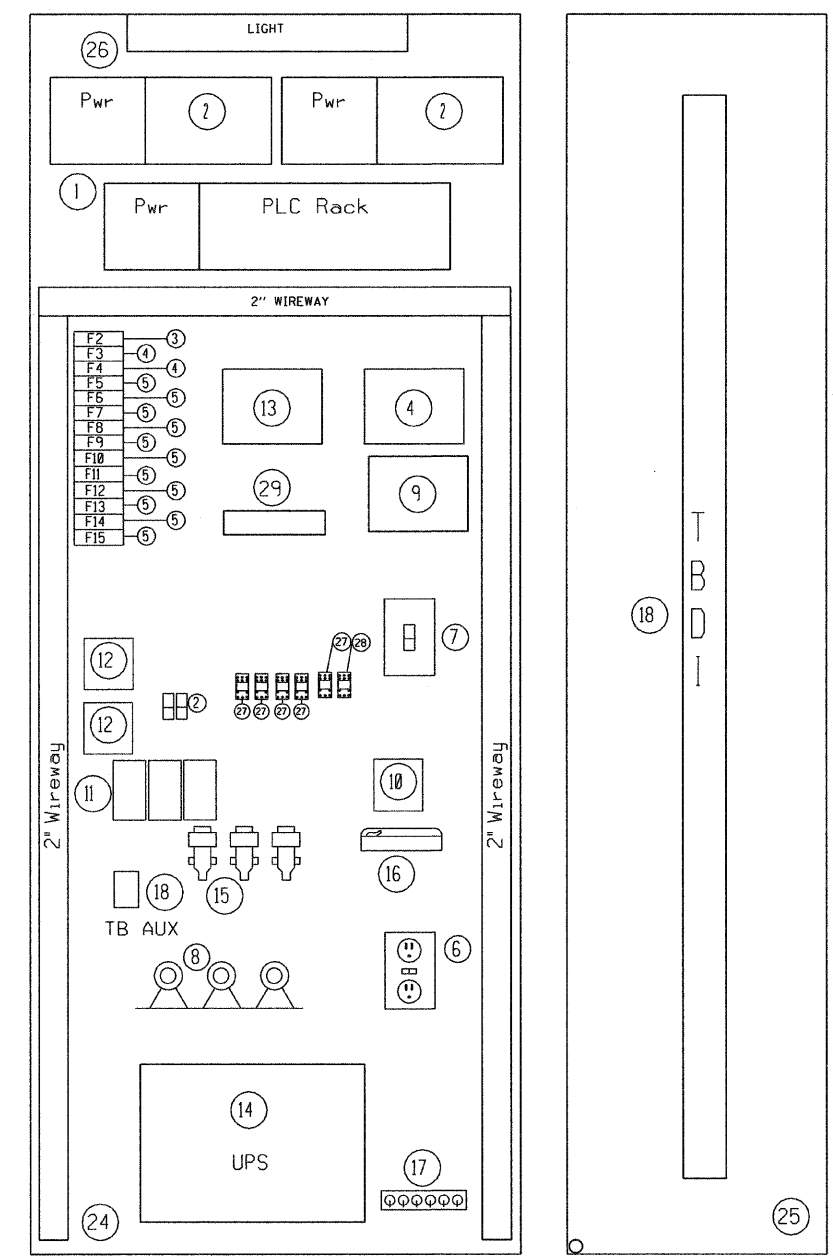
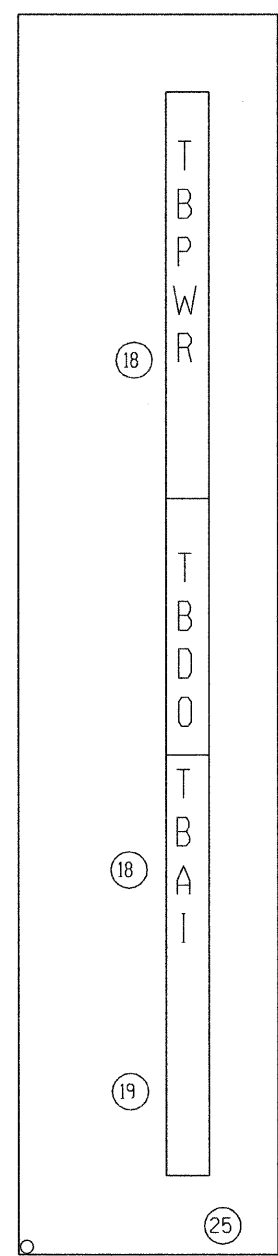


F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
365	59(SA, SB&SF)	DUPAGE	39	36
FED. ROAD DIST. NO.		ILLINOIS	FED. AID PROJECT	

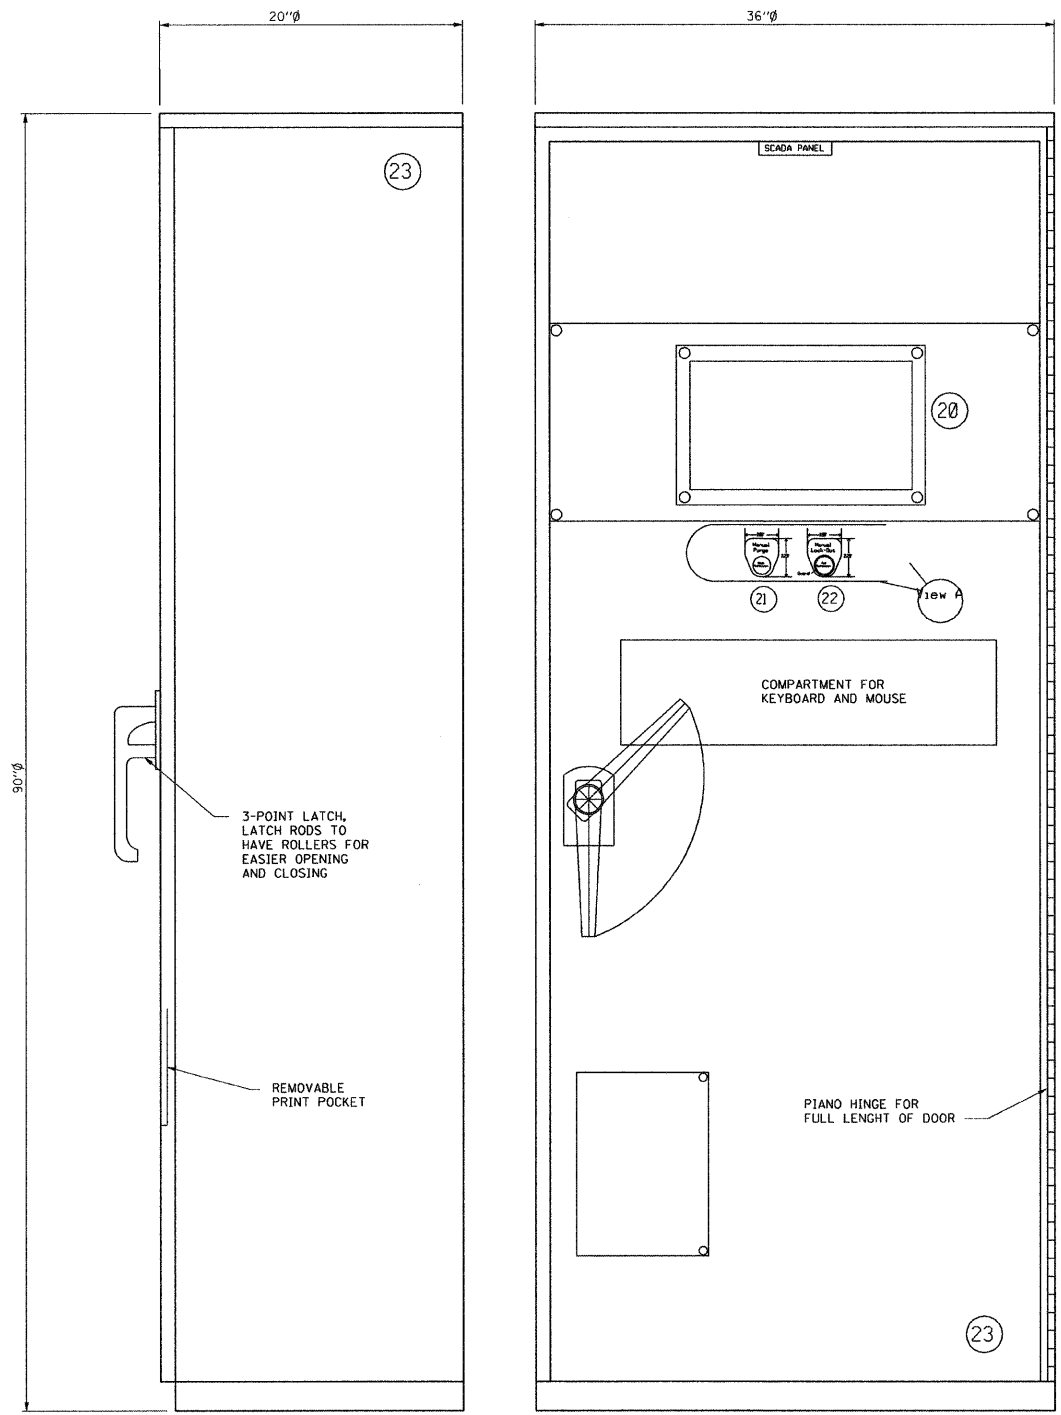

- BILL OF MATERIALS**
- \* DESCRIPTION
- 1756-A17 17-SLOT PLC RACK
  - REDUNDANT 1756-A7 7-SLOT RACK
  - BREAKER
  - NETWARE ETHERNET SWITCH
  - FUSE
  - GFCI OUTLET, 125V, 20A, IN HANDY BOX
  - LIGHT SWITCH, 125V, 20A, IN HANDY BOX
  - GAST COMPRESSOR, MOA-P101-CA
  - CROMPTON CURRENT TRANSDUCER, 256-TALU-LSHG0-C6-BC
  - DITEK MR111SCP-RUV PHONE LINE SUPPRESSOR
  - MOORE INDUSTRIES PRESSURE TRANSDUCER PIT 3-27PSIG 4-20MA 12-28VDC 15B-DIN
  - POWER INTEGRITY SURGE SUPPRESSOR, ZTAS-03-15-0
  - SOLA 12 VOLT DC POWER SUPPLY, SFL6-12-100
  - UPS, 120 VAC, DOUBLE CONVERSION TYPE
  - ASCO SOLENOID VALVE, 8360G77
  - US ROBOTICS 56K MODEM, 5686
  - GROUND BUS
  - TERMINAL BLOCKS, 300 V, SCREW TYPE
  - TERMINAL BLOCKS, 300 V, FUSE HOLDER, SCREW TYPE
  - PLC DISPLAY, AB PANELVIEW PLUS 1250
  - OILTIGHT PUSH BUTTON WITH NAMEPLATE, AB 800T-A2A
  - OILTIGHT LOCKING PUSH BUTTON WITH SHROUD & NAMEPLATE AB 800T-FX6AL
  - ENCLOSURE, NEMA 12, FREE STANDING WITH HINGED DOOR AND THREE-POINT LATCH
  - BACK PANEL
  - SIDE PANEL
  - FLOURESCENT LIGHT 120 V, 20 W
  - AUXILIARY RELAY, DPDT, 120 V AC COIL
  - AUXILIARY RELAY, DPTP, 12 VDC COIL

E18

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION

PUMP STATION NO. 48  
REHABILITATION

SCADA PANEL  
LAYOUT AND DETAILS

SCALE: N/A  
DATE: 03-10-11

DRAWN BY: DAK/HFF  
CHECKED BY: KCC/MS

