



**FABRIC BEARING PAD**  
(Interior)

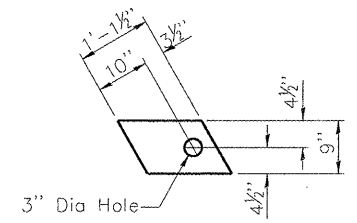


**FABRIC BEARING PAD**  
(Exterior)

**FIXED**


Note: Omit holes when using expansion bearings.

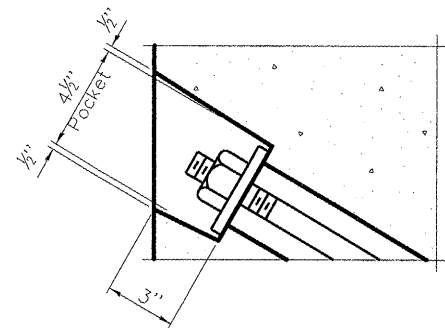


**SECTION A-A**

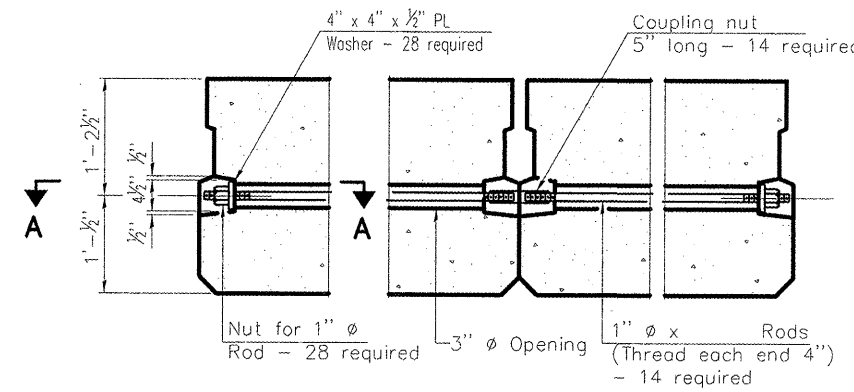


**TYPICAL TRANSVERSE TIE ASSEMBLY**




**BAR S(E)**




**BAR S1(E)**

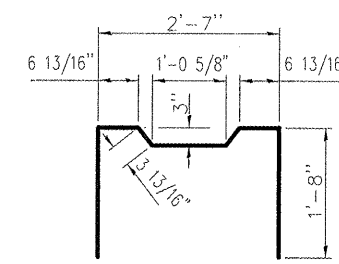


**BAR S2(E)**




**BAR S3(E)**




**BAR S4(E)**



**BAR U(E)**

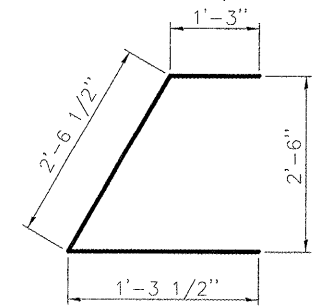

**BAR U1(E)**

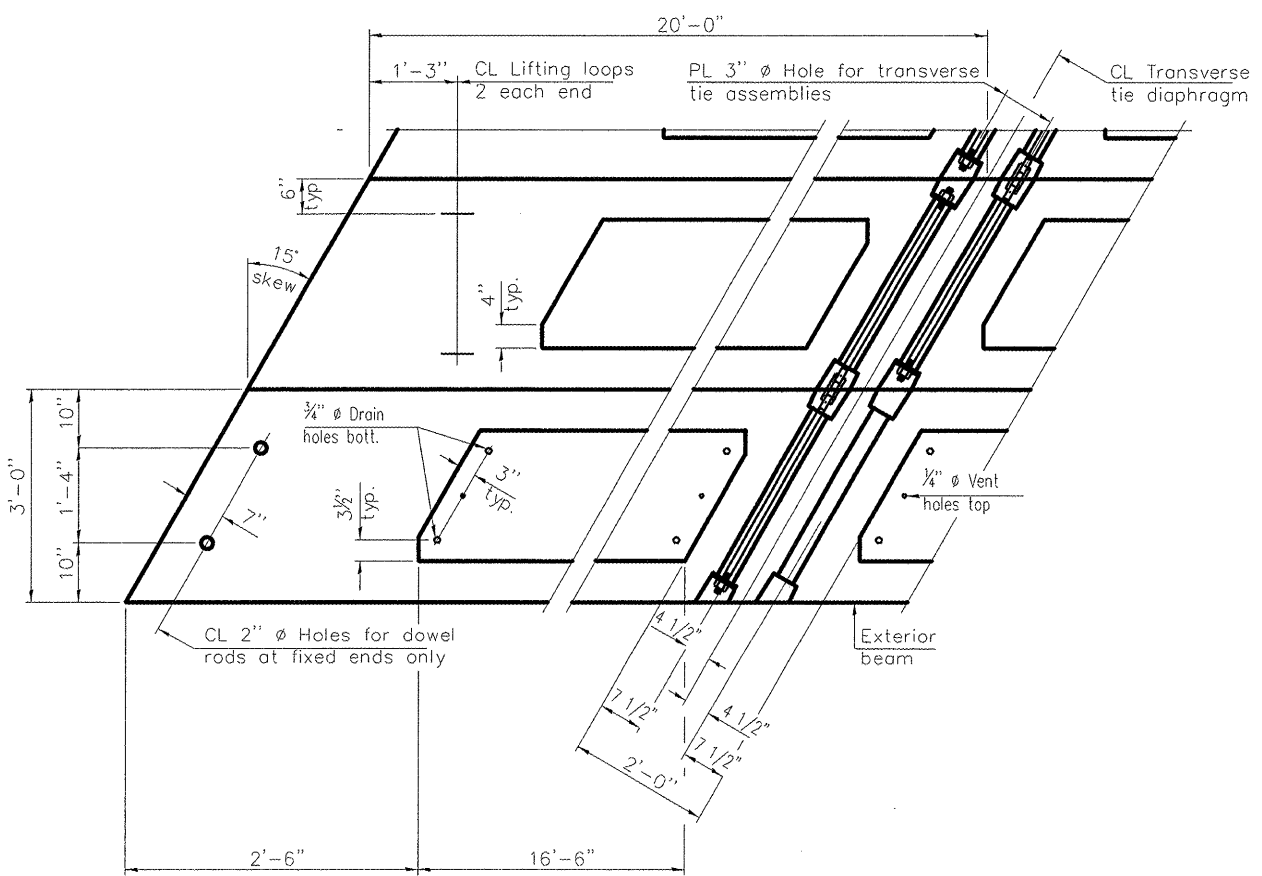


**PLAN VIEW**

Note: Connect beams in pairs with the transverse tie configuration shown.

**NOTES**

- Prestressing steel shall be uncoated high strength, low relaxation 7-wire strand, Grade 270. The nominal diameter shall be 7/8" and the nominal cross-sectional area shall be 0.153 sq. in. The 1" dia. rods in the transverse tie assembly shall be tightened to a snug fit and the threads set. Pockets on exterior faces of bridge shall be filled with grout after transverse tie assembly is in place.
- Reinforcement bars shall conform to ASTM A 706, Grade 60. (See Special Provisions).
- Two 1/8" fabric adjusting shims of the dimensions of the exterior bearing pad shall be provided for each bearing pad location.
- A minimum 2 1/2" dia. lifting pin shall be used to engage the lifting loops during handling.
- Corrosion Inhibitor, per Article 1020.05(b)(12) and 1021.06 of the Standard Specifications, shall be used in the concrete for precast prestressed concrete deck beams.
- Compressive strength of prestressed concrete, f<sub>c</sub>, shall be 6000 psi.
- Compressive strength of prestressed concrete at release, f<sub>ci</sub>, shall be 5000 psi.
- See Sheet 6 of 18 for railing inserts.

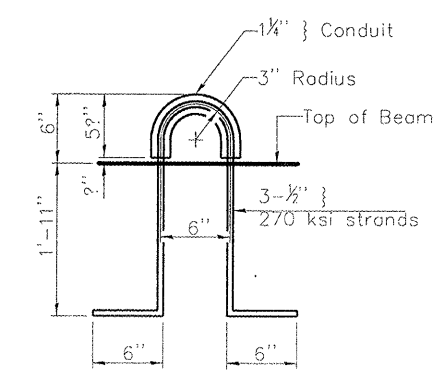

**LIFTING LOOP DETAIL**

**BILL OF MATERIAL**

Precast Prestressed Conc. Deck Bms. (27" depth)	Sq. Ft.	1440
-------------------------------------------------	---------	------