

098-0065

ROUTE NO.	SEC.	COUNTY	SHEET NO.	SHEET TOTAL
FA 403	243	WHITESIDE	400	90
FED. ROAD DIST. NO. 7 ILLINOIS I.A. PROJ.				


**GENERAL NOTES**

All reinforcement bars shall be lapped 24 diameters unless otherwise shown.  
 Fasteners shall be high strength bolts, Bolt 1/2" dia. open holes 3/4" dia. unless otherwise noted.  
 Calculated weight of Structural Steel = 542,308 lbs.  
 The basic lead silico-chromate paint system shall be used for shop and field painting of Structural Steel.  
 Field welding of construction accessories will not be permitted to bottom of flange of girders nor to the top flange for a distance equal to one-fourth the span length each way from the pier support. Field welding in other areas will be permitted only when approved by the Engineer.  
 Anchor bolts shall be set before bolting diaphragms over supports. Slope wall shall be reinforced with welded wire fabric 6"x6" mesh, weighing 58# per 100 sq. ft.  
 The contractor shall drive one concrete test pile at each abutment in a permanent location as directed by the Engineer before entering the remainder of piles.  
 Concrete piles of abutments shall be driven in holes prepared through the embankment in accordance with Article 613.09(c) of the Standard Specifications.  
 The concrete rail section above the mandatory construction joint at the top of the slab shall be constructed of Class X Concrete, except the aggregates shall conform to the requirements of Standard Concrete.  
 Protective Coat shall not be applied to the surfaces to which Coal Tar Interlayer, Protective Coat.  
 The embankment configuration shown shall be the minimum embankment that must be constructed prior to construction of the abutments.  
 Bearing seat surfaces shall be constructed or adjusted to the designated elevations within a tolerance of 1/8 inch. Adjustment shall be made either by grinding the surface or by shimming the bearing. Two 1/2" adjusting shims, of the dimensions of the bottom bearing plate, shall be provided for each bearing in addition to all other plates or shims.

**TOTAL BILL OF MATERIAL**

Item	Unit	Super	Sub	Total
Structural Excavation	Cu. Yds.	409	409	818
Class X Concrete	Cu. Yds.	222.0	357.7	579.7
Structural Steel	Long Tons	1	1	2
Reinforcement Bars	Lbs.	149,360	4,181.0	153,541
Concrete Piles	Lin. Ft.	1	1	2
Test Piles Concrete	Lin. Ft.	1	1	2
Slope Wall	Sq. Yds.	17.0	17.0	34.0
Bit. Surf. Class 1	Sq. Yds.	144.4	144.4	288.8
Coal Tar Inter. Prot. Coat	Lin. Ft.	501	501	1,002
Minimum Applying	Sq. Ft.	139	139	278
Preformed Joint Spacer	Lbs.	840.2	840.2	1,680.4
Steel Sheet Piling	Lbs.	1	1	2
Welding	Sq. Yds.	12.8	12.8	25.6
Protective Coat	Sq. Yds.	34.4	34.4	68.8
Gravel	Cu. Yds.	530	530	1,060
Crushed Stone	Cu. Yds.	119	119	238
Gravel Embankment	Cu. Yds.	419.8	419.8	839.6

\* See Special Provisions

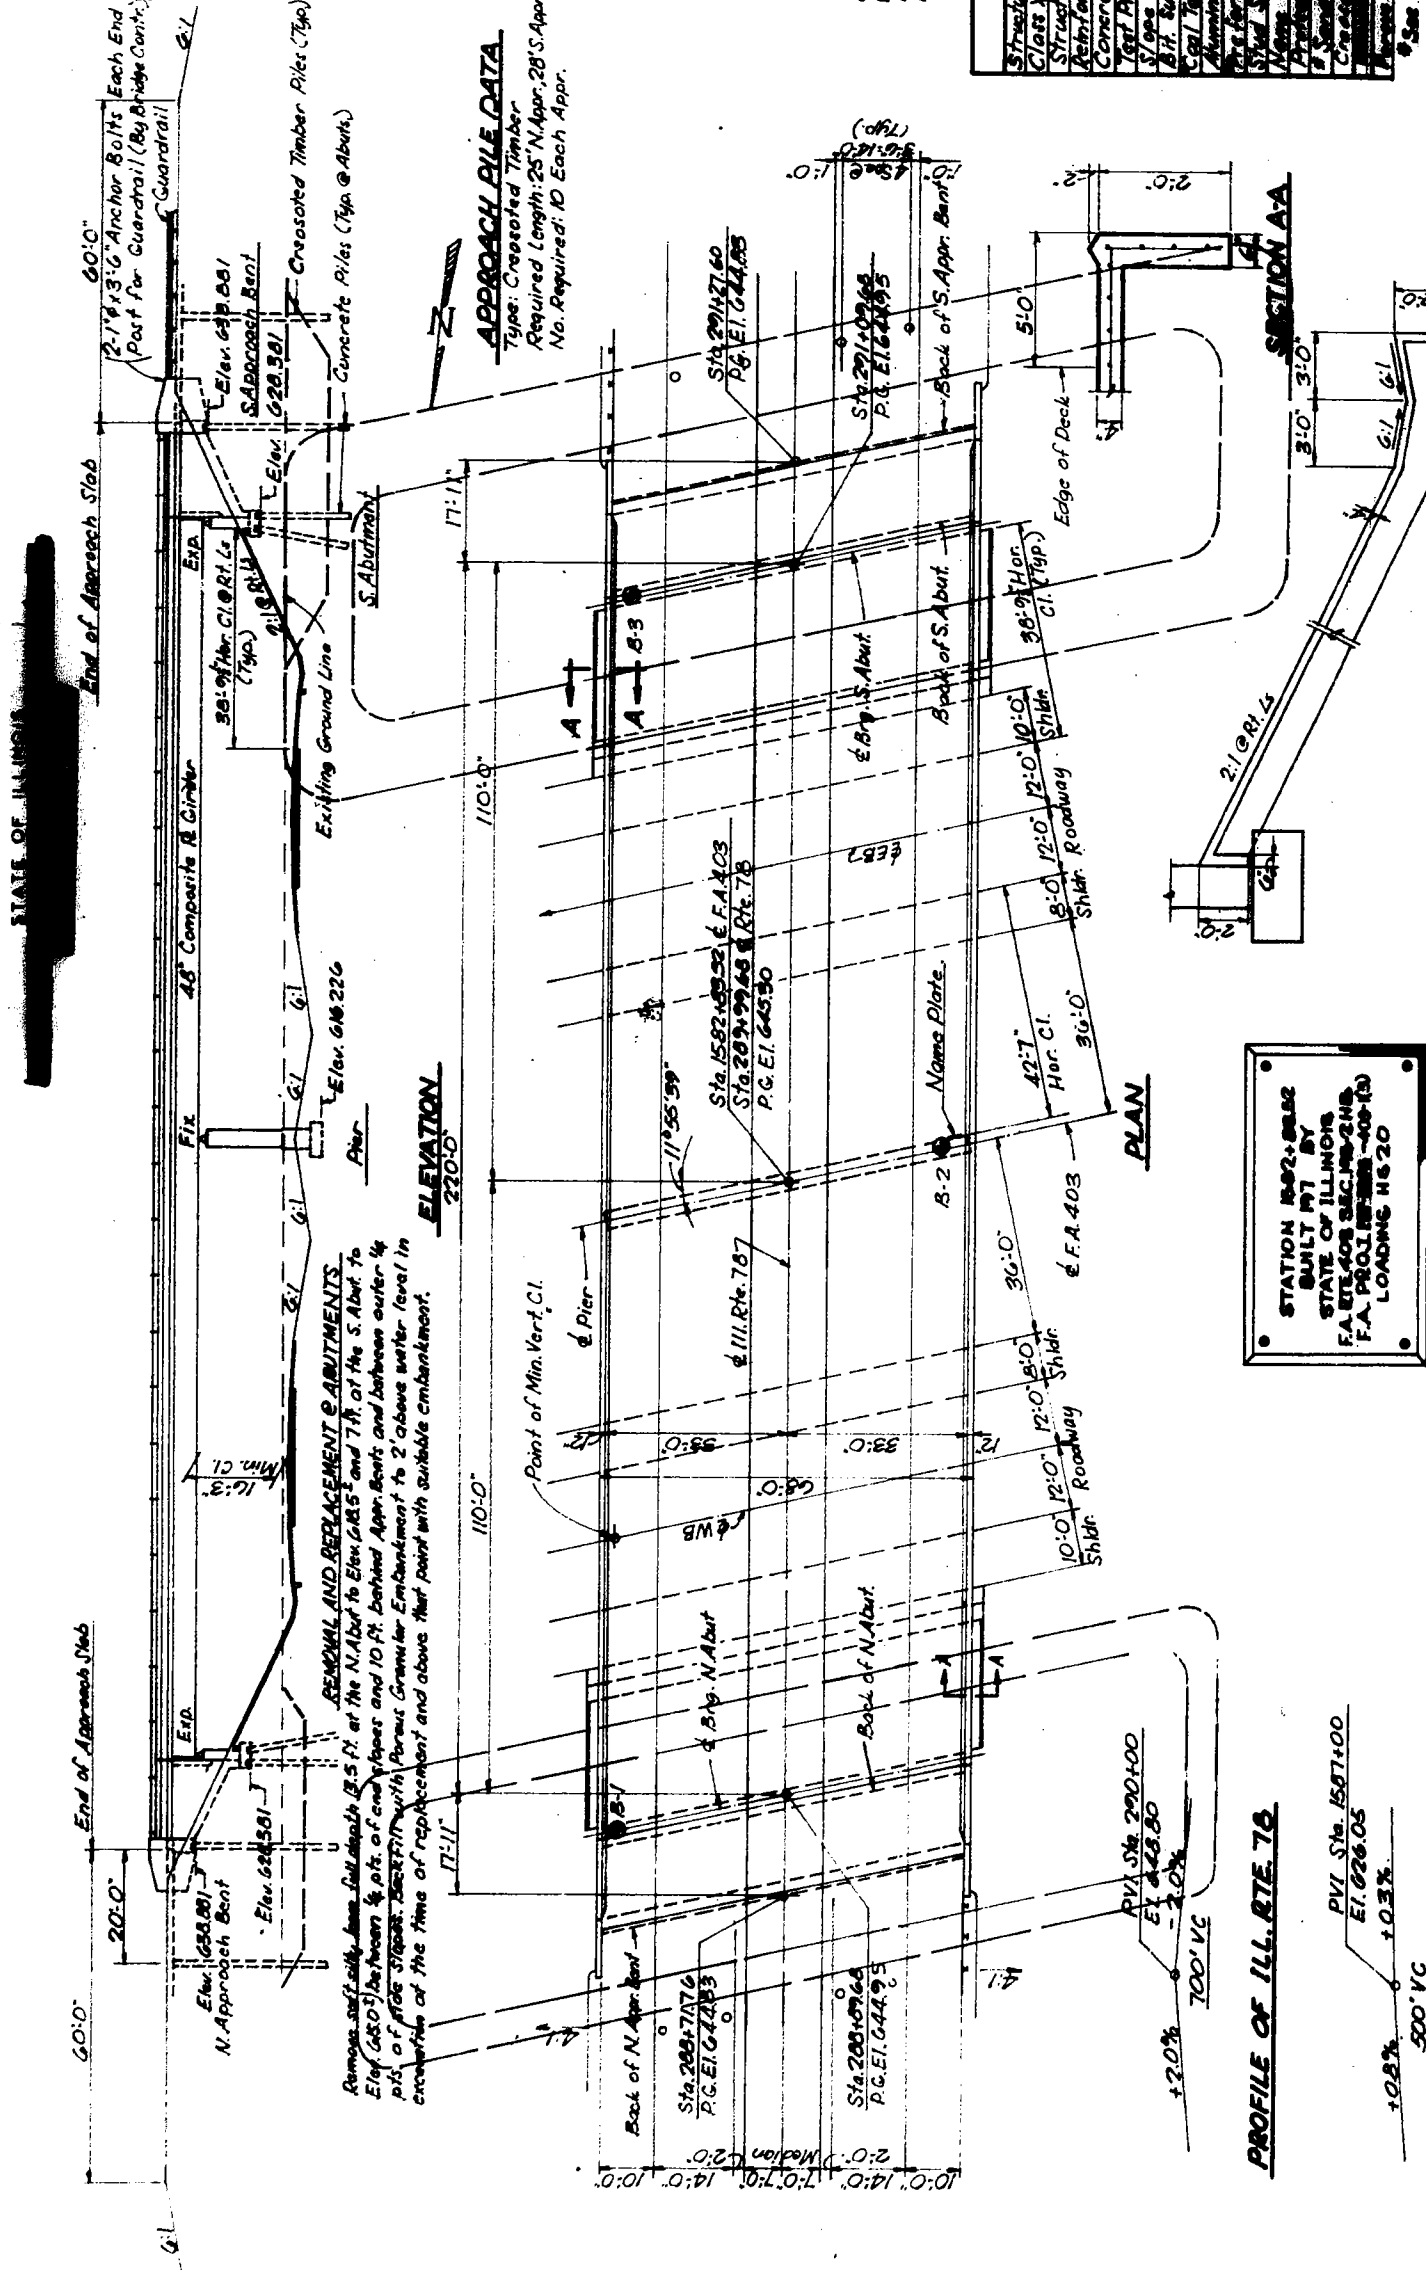

**NAME PLATE**  
(See Std 219)


STATION 1582+00  
 BUILT BY  
 STATE OF ILLINOIS  
 F.A. PROJECT NO. 403-10  
 LOADING HS 20

**LOADING HS 20-44**

**DESIGN STRESS**  
 $f_c = 1200$  psi Deck Slab  
 $f_c = 1400$  psi Curbs, Parapets, & Substructure  
 $f_t = 75$  psi (Fibs)  
 $n = 10$   
 $f_s = 20,000$  psi Reinf.  
 $f_s = 20,000$  psi Struct.  
 Allowable & Deflection = 1/800  
 Design Specifications 1969 AASHTO (or applicable)  
 Allow 25% per Sq. Ft. for future wearing surface

DESIGNED	G.D.C.
CHECKED	H.M.M.
DRAWN	C.D.C.
CHECKED	S.M.K.


EXAMINED  
 PASSED  
 APPROVED



**LOADING STRESS**

**GENERAL PLAN & ELEVATION**  
**PROJECT FA 403**  
**ILL. RTE. 70 OVER FA 403**  
**FA. PROJ. NO. 403-10**  
**LOADING HS 20-44**  
**STATION 1582+00**

DATE	195	2 HB	WHITESIDE 406	99
NO.	403			

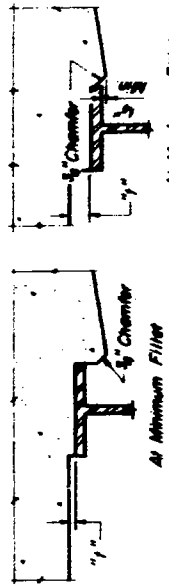

To determine "f", after all structural steel has been erected, elevations of the top flanges of the beams shall be taken at intervals shown below. These elevations subtracted from the "Theoretical Grade Elevations Adjusted for Dead Load Deflection" shown below, minus slab thickness, equals the fillet height "f", above top flange of beams.

**FILLET HEIGHTS**

**STATE OF ILLINOIS**

DESIGNED G.D.C.  
CHECKED S.M.C.  
DRAWN P.E. BARNETT & L.R.  
CHECKED S.M.C.



**DEAD LOAD DEFLECTION DIAGRAM**

(Includes weight of concrete only)  
Note: The above deflections are not to be used in the field if the engineer is working from the grade elevations adjusted for dead load deflections as shown below.


NOTE: Elevations are to top of concrete slab.

Location	Beam	Station	Offset	Theoretical Grade Elevations	Theoretical Grade Elevations Adjusted For Dead Load Deflection
Bk. of N. Appr. Slab	1	500+82.20	0	644.019	644.019
	2				
	3				
	4				
A	1	500+82.20	0	644.920	644.920
	2				
	3				
	4				
	5				
	6				
	7				
	8				
	9				
Front of N. Appr. Slab	1	500+82.20	0	644.922	644.922
	2				
	3				
	4				
	5				
	6				
	7				
	8				
	9				

Location	Beam	Station	Offset	Theoretical Grade Elevations	Theoretical Grade Elevations Adjusted For Dead Load Deflection
Brg. N. Abut.	1	500+82.20	31.000	644.879	644.879
	2	500+82.20	25.250	644.877	644.877
	3	500+82.20	23.250	644.872	644.872
	4	500+82.20	18.500	644.768	644.768
	5	500+82.20	7.750	644.636	644.636
	6	500+82.20	0	644.543	644.543
	7	500+82.20	7.750	644.637	644.637
	8	500+82.20	18.500	644.768	644.768
	9	500+82.20	23.250	644.872	644.872
B	1	500+82.20	31.000	644.877	644.877
	2	500+82.20	25.250	644.875	644.875
	3	500+82.20	23.250	644.870	644.870
	4	500+82.20	18.500	644.766	644.766
	5	500+82.20	7.750	644.634	644.634
	6	500+82.20	0	644.541	644.541
	7	500+82.20	7.750	644.635	644.635
	8	500+82.20	18.500	644.766	644.766
	9	500+82.20	23.250	644.870	644.870
C	1	500+82.20	31.000	644.879	644.879
	2	500+82.20	25.250	644.877	644.877
	3	500+82.20	23.250	644.872	644.872
	4	500+82.20	18.500	644.768	644.768
	5	500+82.20	7.750	644.636	644.636
	6	500+82.20	0	644.543	644.543
	7	500+82.20	7.750	644.637	644.637
	8	500+82.20	18.500	644.768	644.768
	9	500+82.20	23.250	644.872	644.872

Location	Beam	Station	Offset	Theoretical Grade Elevations	Theoretical Grade Elevations Adjusted For Dead Load Deflection
D	1	500+82.20	31.000	644.874	644.874
	2	500+82.20	25.250	644.872	644.872
	3	500+82.20	23.250	644.867	644.867
	4	500+82.20	18.500	644.763	644.763
	5	500+82.20	7.750	644.631	644.631
	6	500+82.20	0	644.538	644.538
	7	500+82.20	7.750	644.632	644.632
	8	500+82.20	18.500	644.763	644.763
	9	500+82.20	23.250	644.867	644.867
E	1	500+82.20	31.000	644.879	644.879
	2	500+82.20	25.250	644.877	644.877
	3	500+82.20	23.250	644.872	644.872
	4	500+82.20	18.500	644.768	644.768
	5	500+82.20	7.750	644.636	644.636
	6	500+82.20	0	644.543	644.543
	7	500+82.20	7.750	644.637	644.637
	8	500+82.20	18.500	644.768	644.768
	9	500+82.20	23.250	644.872	644.872
F	1	500+82.20	31.000	644.879	644.879
	2	500+82.20	25.250	644.877	644.877
	3	500+82.20	23.250	644.872	644.872
	4	500+82.20	18.500	644.768	644.768
	5	500+82.20	7.750	644.636	644.636
	6	500+82.20	0	644.543	644.543
	7	500+82.20	7.750	644.637	644.637
	8	500+82.20	18.500	644.768	644.768
	9	500+82.20	23.250	644.872	644.872

Location	Beam	Station	Offset	Theoretical Grade Elevations	Theoretical Grade Elevations Adjusted For Dead Load Deflection
G	1	500+82.20	31.000	644.877	644.877
	2	500+82.20	25.250	644.875	644.875
	3	500+82.20	23.250	644.870	644.870
	4	500+82.20	18.500	644.766	644.766
	5	500+82.20	7.750	644.634	644.634
	6	500+82.20	0	644.541	644.541
	7	500+82.20	7.750	644.635	644.635
	8	500+82.20	18.500	644.766	644.766
	9	500+82.20	23.250	644.870	644.870
H	1	500+82.20	31.000	644.879	644.879
	2	500+82.20	25.250	644.877	644.877
	3	500+82.20	23.250	644.872	644.872
	4	500+82.20	18.500	644.768	644.768
	5	500+82.20	7.750	644.636	644.636
	6	500+82.20	0	644.543	644.543
	7	500+82.20	7.750	644.637	644.637
	8	500+82.20	18.500	644.768	644.768
	9	500+82.20	23.250	644.872	644.872
I	1	500+82.20	31.000	644.879	644.879
	2	500+82.20	25.250	644.877	644.877
	3	500+82.20	23.250	644.872	644.872
	4	500+82.20	18.500	644.768	644.768
	5	500+82.20	7.750	644.636	644.636
	6	500+82.20	0	644.543	644.543
	7	500+82.20	7.750	644.637	644.637
	8	500+82.20	18.500	644.768	644.768
	9	500+82.20	23.250	644.872	644.872
J	1	500+82.20	31.000	644.879	644.879
	2	500+82.20	25.250	644.877	644.877
	3	500+82.20	23.250	644.872	644.872
	4	500+82.20	18.500	644.768	644.768
	5	500+82.20	7.750	644.636	644.636
	6	500+82.20	0	644.543	644.543
	7	500+82.20	7.750	644.637	644.637
	8	500+82.20	18.500	644.768	644.768
	9	500+82.20	23.250	644.872	644.872

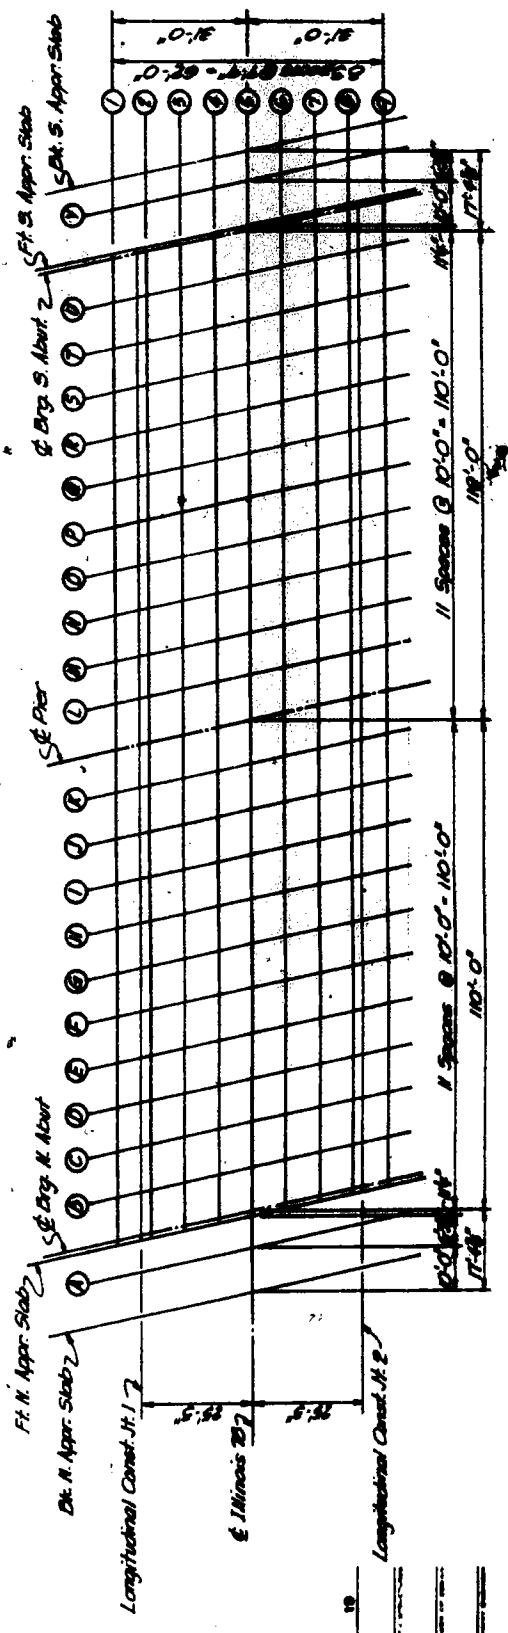


DESIGNED G.D.C.	10
CHECKED S.M.C.	
DRAWN P.E. BARNETT & L.R.	
CHECKED S.M.C.	
E-S	8-1-65

**ELEVATIONS**  
FACTORY SEC. 195-210  
WHITESIDE COUNTY  
STATION 1002+05.62


NO.	REV.	DATE	BY	CHKD.
1				
2				

NO.	REV.	DATE	BY	CHKD.
1				
2				

NOTE: Bars indicated thus 20'-3'-0" etc. indicates 20 lines of bars with 3 lengths per line. Min bar laps: 24" dia.

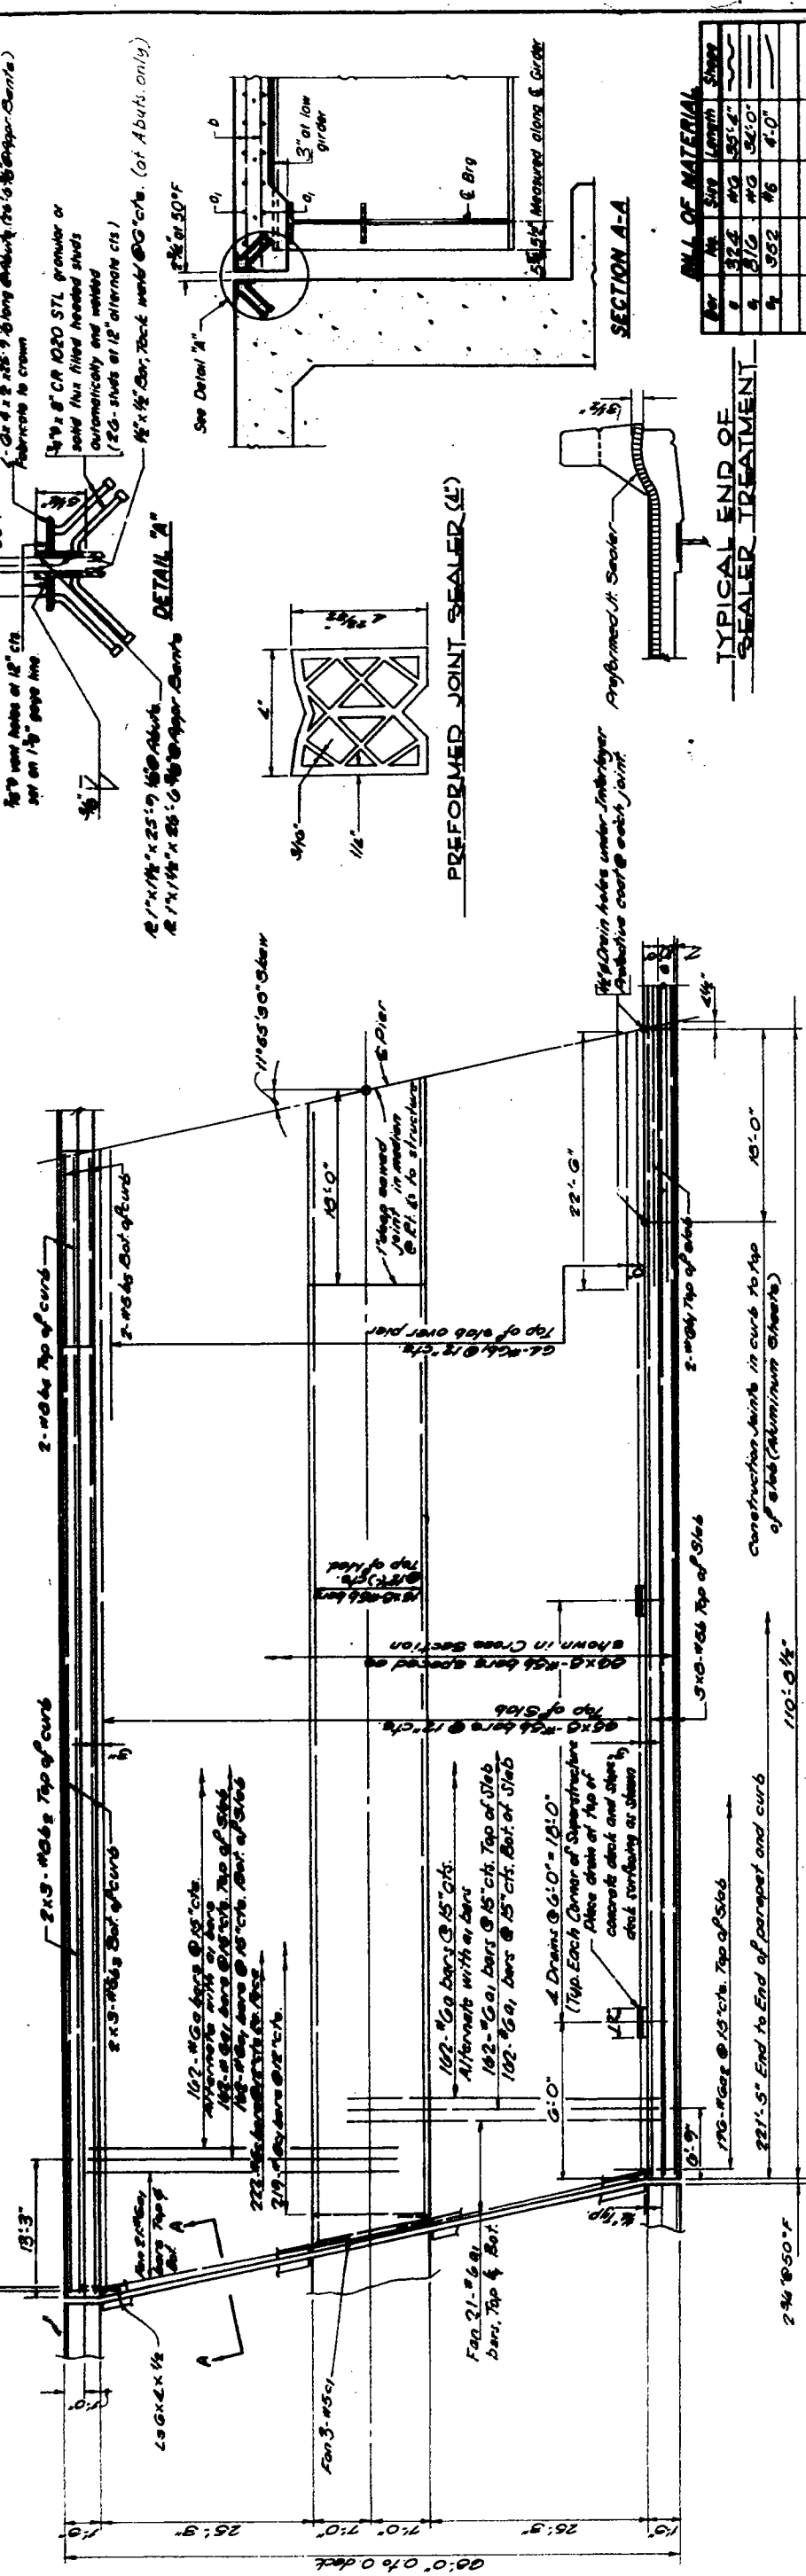

NOTE: For placement of bars \$d\_1\$ and \$d\_2\$ thru \$e\_2\$ see sheet #2

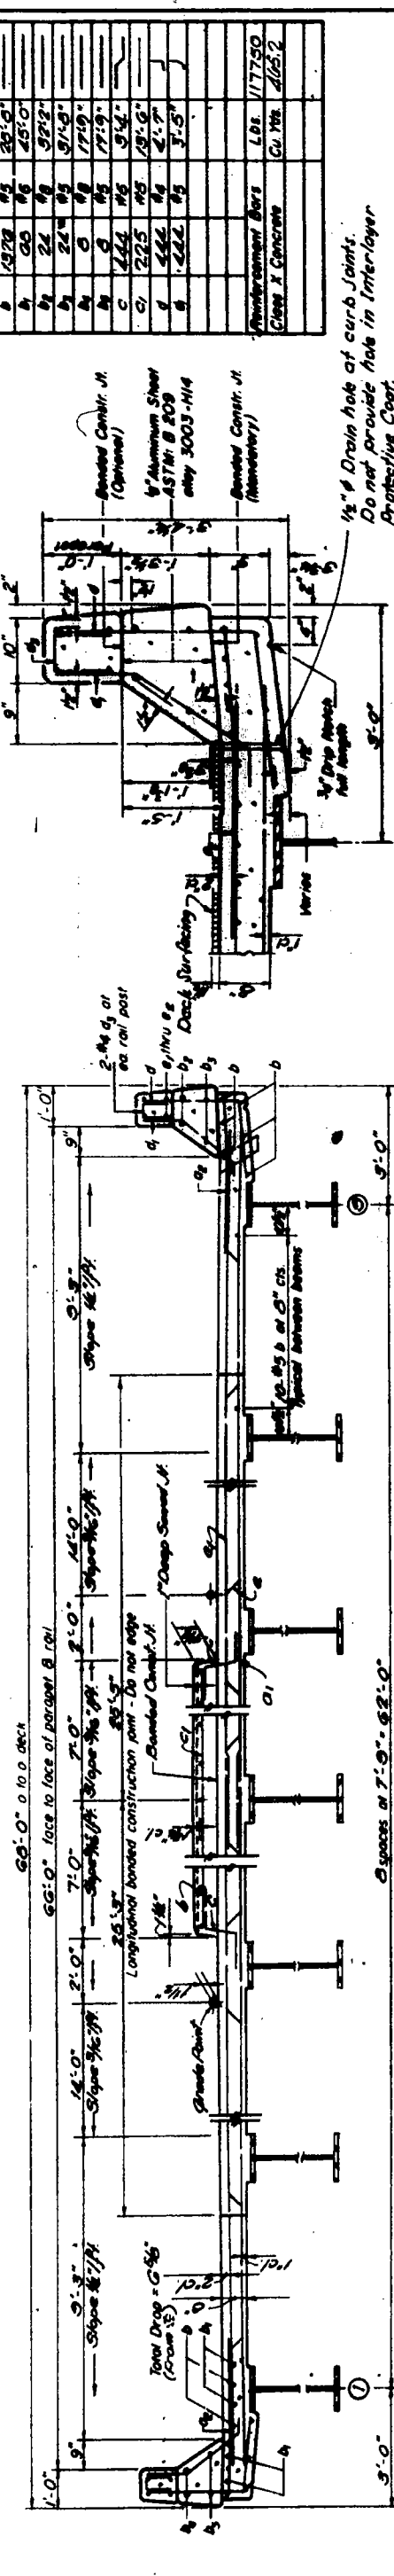

Bar	No.	Size	Length	Shape
1	374	#4	55'-4"	
2	310	#4	54'-0"	
3	352	#6	4'-0"	
4	1378	#5	20'-0"	
5	69	#5	45'-0"	
6	24	#8	37'-8"	
7	24	#5	37'-8"	
8	0	#8	17'-0"	
9	0	#8	17'-0"	
10	224	#6	9'-4"	
11	225	#5	18'-6"	
12	444	#4	4'-7"	
13	444	#5	3'-5"	

**CROSS SECTION**  
 1/2" Aluminum Sheet milled A.S.T.M. B209 alloy 6061-T6 or Aluminum Extrusion A.S.T.M. B221 alloy 6061-T6

**NEAR MIDSPAN**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**NEAR PER**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**END VIEW**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**DRAIN DETAIL**  
 Place this end toward & R-1/2

**BAR 1**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 2**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 3**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 4**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 5**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 6**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 7**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 8**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 9**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 10**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 11**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 12**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 13**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 14**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 15**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 16**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 17**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 18**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 19**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6

**BAR 20**  
 1/2" x 1/2" Aluminum Bar A.S.T.M. B211 alloy 6061-T6


**SUPERSTRUCTURE**  
 F.A.D.T.E. 403 SEC. 195-2 H.S.  
 WHITEHIDE COUNTY  
 STATION 1692+98.52

DESIGNED	C.D.C.
CHECKED	S.M.F.K.
DRAWN	C.D.C.
CHECKED	S.M.F.K.


S-586-R(107) 4-22-68, 2-3-69




PROJECT NO.	145	DATE	11/11/68
DRAWN BY	403 ZHB	CHECKED BY	102 JWB
SHEET NO. 6		OF 12 SHEETS	
PROJECT NAME		WHITE/SID 406 105	

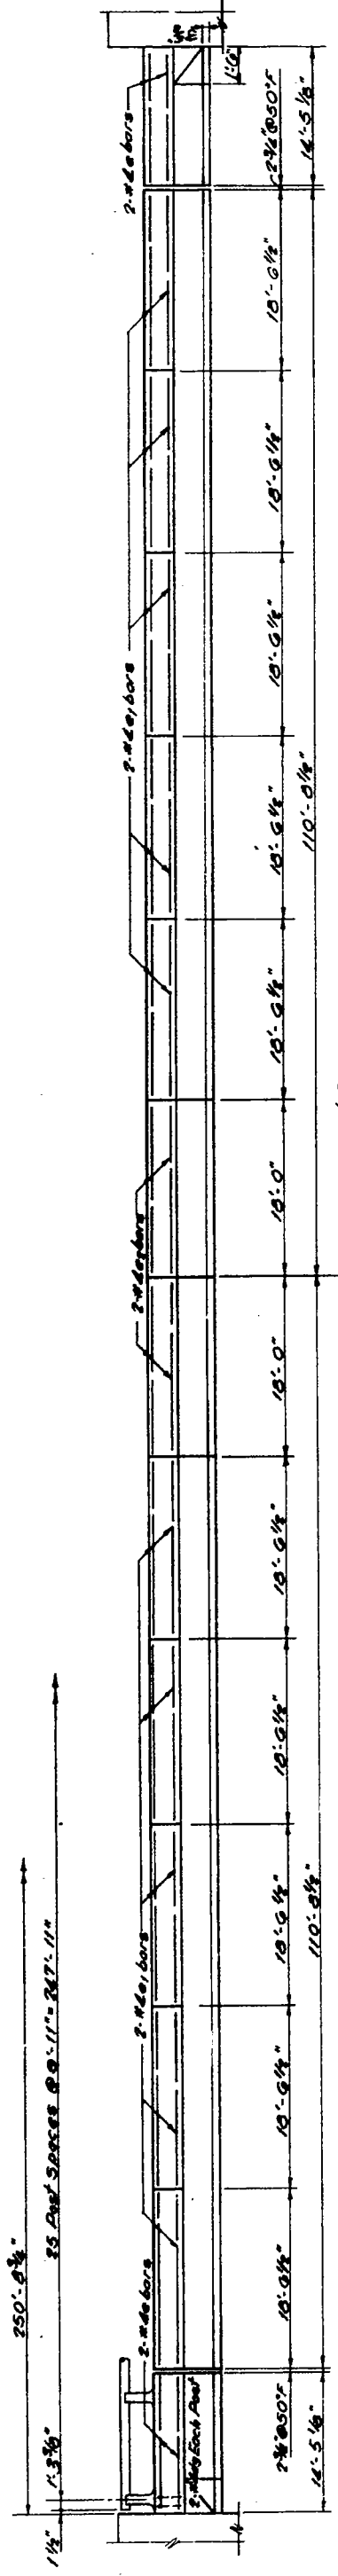


**ELEVATION**

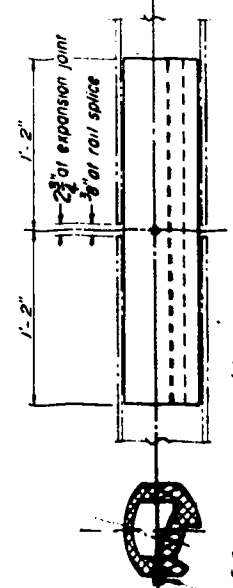


**RAIL SPLICE**

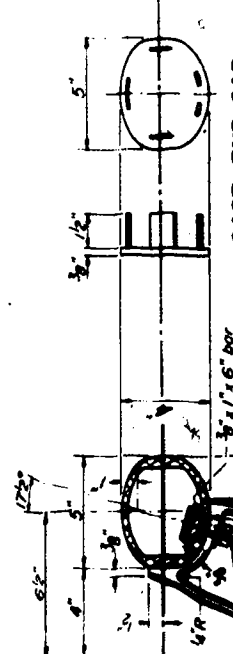


**CAST END CAP DRIVE FIT TYPE**

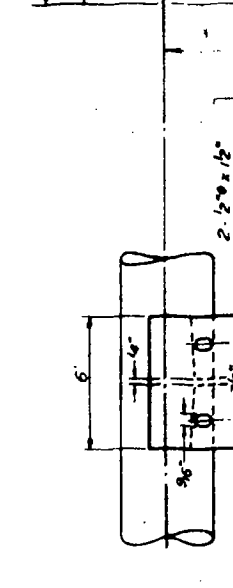


**RAIL POST DETAILS**

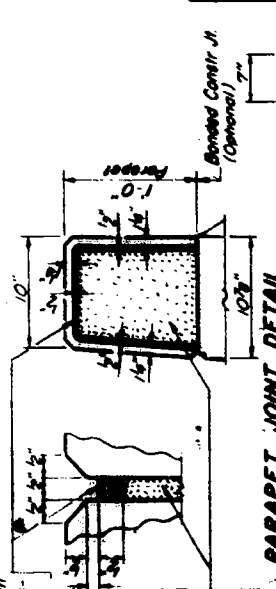

**PARAPET JOINT DETAIL**

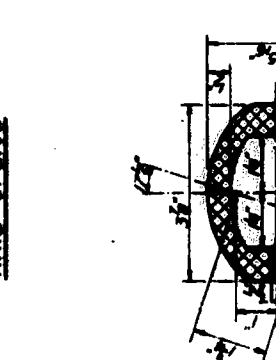

**SEC. THRU ELLIPTICAL RAIL SECTION**



**SEC. THRU RAIL SECTION**

**PARAPETS & RAILS**

Bar	No.	Size	Length	Shape
1	10	#4	44'-5"	
2	10	#4	16'-5"	
3	10	#4	17'-5"	
4	104	#4	2'-1"	U

Reinforcement Area	Lbs.	1460
Class I Quantity	20,105	51/2
Aluminum Alloy	Lbs. Ft.	501

**NOTES:**

All Aluminum Alloy Extruded Rail shall be supplied in modular lengths of 30 feet, except at the end of bridge or over span joints in bridge deck where the rail shall be fabricated in a minimum of 2 peaks. If the rail is of a non-staining gray with polysulfide liquid polymers, the modular lengths may be reduced but shall be attached to a maximum of 2 posts.

All joints in rail shall be gasketed per detail.

Posts 1-1/2" and 2-1/2" Aluminum Steels for 25% of the Posts Rail section shall be parallel to Grade - high spots shall be ground and the ends chamfered.

Steel parameter of base of post to prevent with two component non-staining gray sealing compound with polysulfide liquid polymers, per detail with primer. Fabric Reinforcing Post shall have same dimensions as base of post.

Aluminum alloy rail shall conform to ASTM B221 alloy 6061-T6 or 6061-T5 with min yield 35 ksi, min tensile 58 ksi, and elongation of 10% in 2 inches.





**ALUMINUM RAILING**  
 F.A. RTE-406 SEC. 105-241/5  
 WHITE/SIDE COUNTY  
 STATION 1602+08.52

DESIGNED	G.D.C.
CHECKED	S.M.K.
DRAWN	G.D.C.
CHECKED	S.M.K.

ROUTE NO. 195  
 S.A. 4032 NB  
 FEDERAL DIST. NO. 1111000 P.A. PROJ.

STATE OF ILLINOIS  
 COUNTY  
 WHITEHSE 406  
 104

SHEET NO. 7  
 12 SHEETS

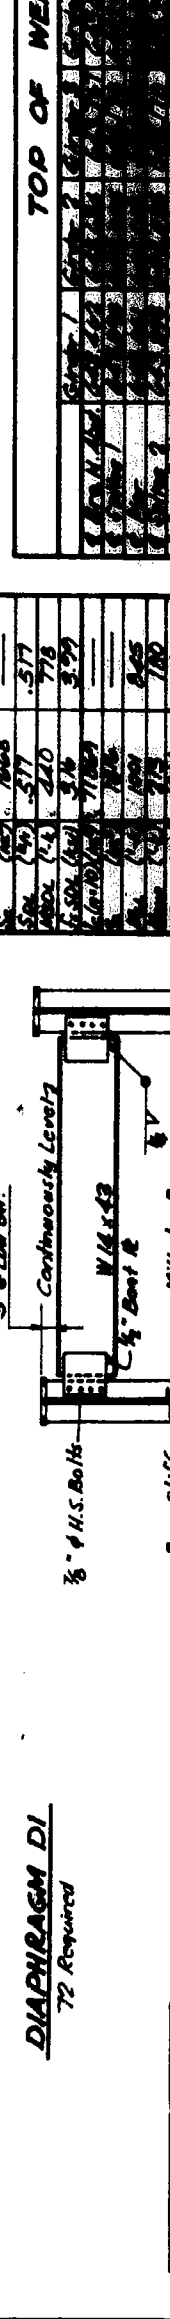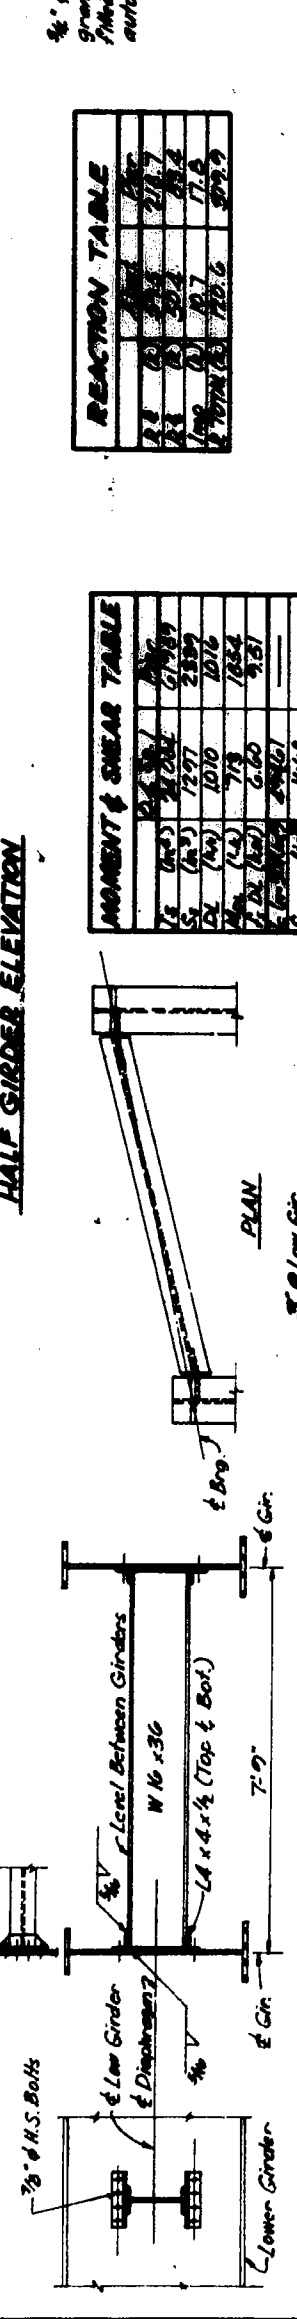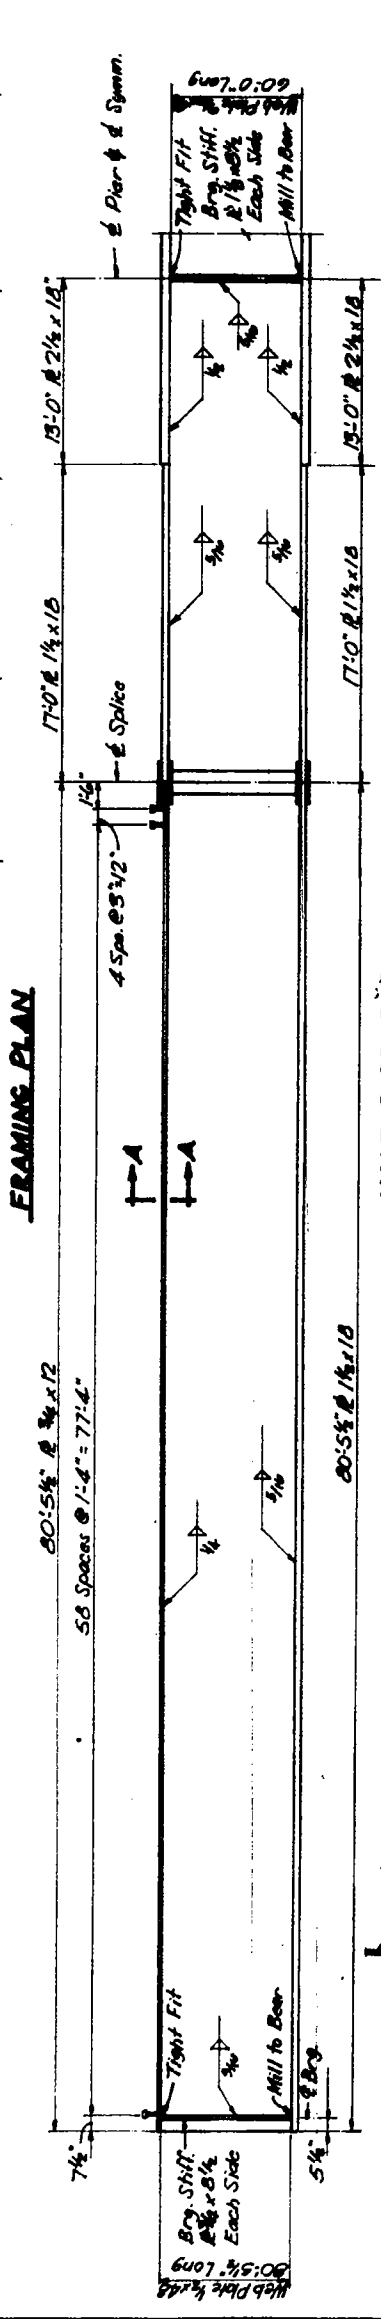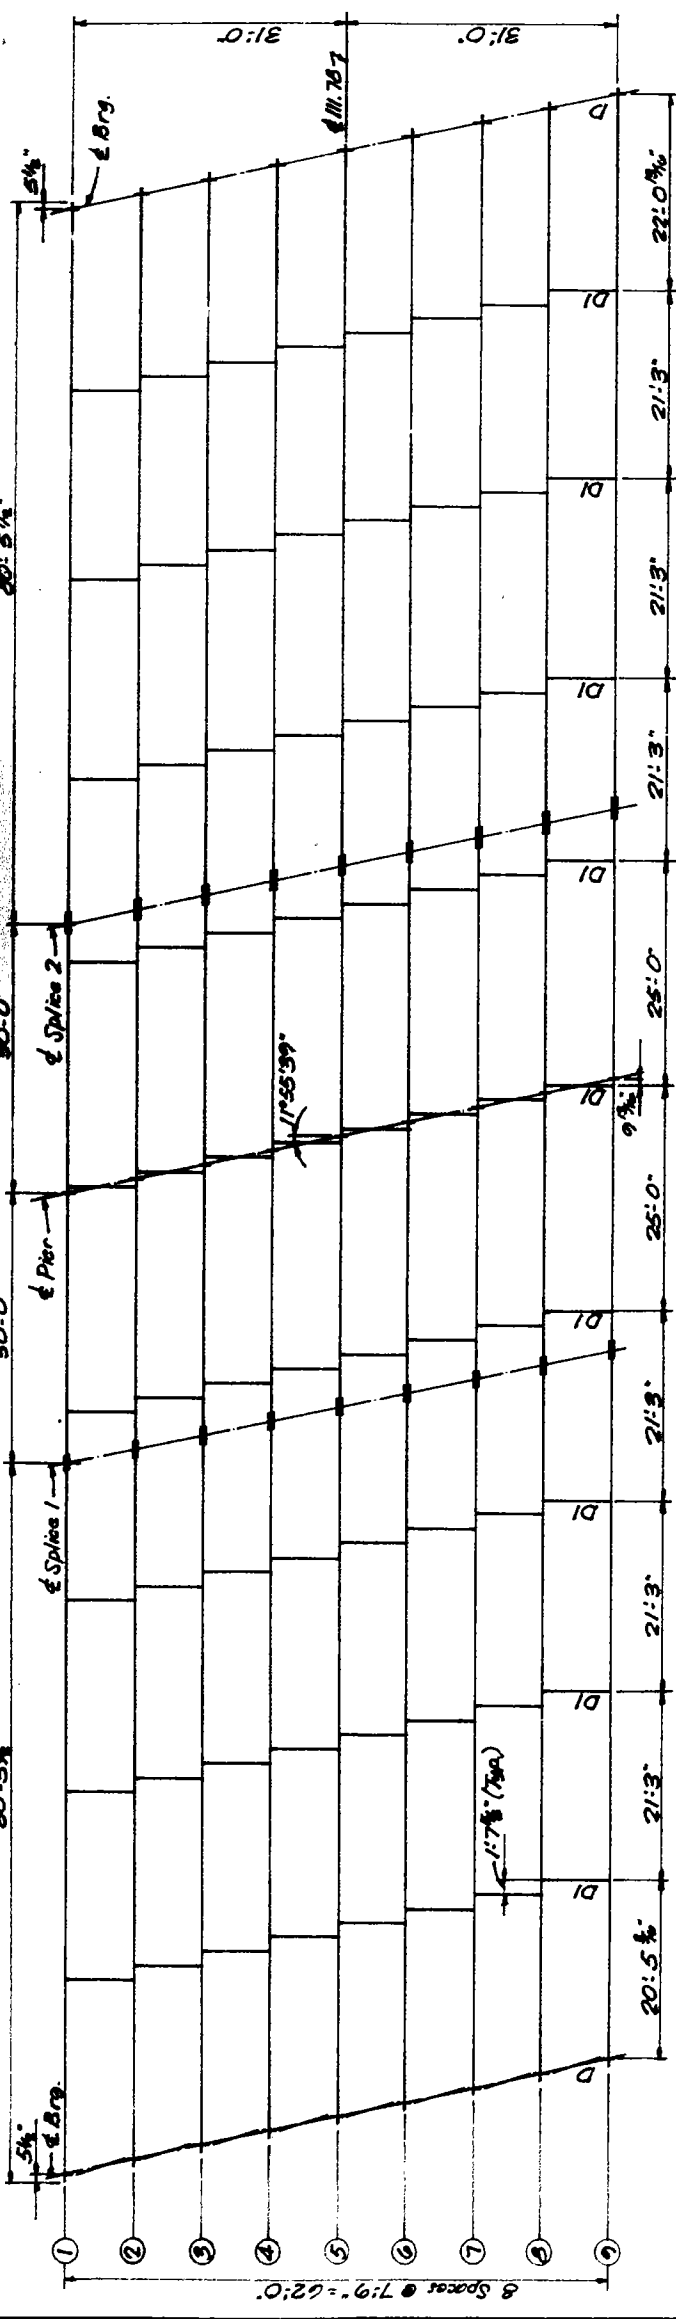

REACTION TABLE

1	2	3	4	5	6	7	8	9
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4

MOMENT & SHEAR TABLE

1	2	3	4	5	6	7	8	9
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4

TOP OF WEB ELEVATIONS \*


1	2	3	4	5	6	7	8	9
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4
12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4	12.4

DESIGNED A.L.C.  
 CHECKED S.M.K.  
 DRAW C.D.C.  
 CHECKED S.M.F.L.

EXAMINED 13  
 PASSED  
 APPROVED

72 Required

SPALICE DETAILS  
 (All Bolts 3/8" H.S.)

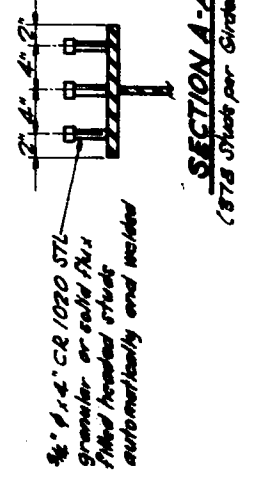

\* For fabrication only.

E and S are the moment of inertia and section modulus of the steel section.  
 E and S are the moment of inertia and section modulus of the composite section used in computing I<sub>c</sub>.  
 I<sub>c</sub> is the maximum I<sub>c</sub> + I<sub>p</sub> + I<sub>ps</sub> in span.


DIAPHRAGM D  
 1/2 Required

DESIGNED A.L.C.  
 CHECKED S.M.K.  
 DRAW C.D.C.  
 CHECKED S.M.F.L.


EXAMINED 13  
 PASSED  
 APPROVED

F.A. RTE. 408-SEC. 198-2 NB  
 WHITEHSE COUNTY  
 STATION 1509+00.02


PROJECT NO.	195	CONTRACT	WHITESIDE	406	105
DATE	4-13-24	BY			

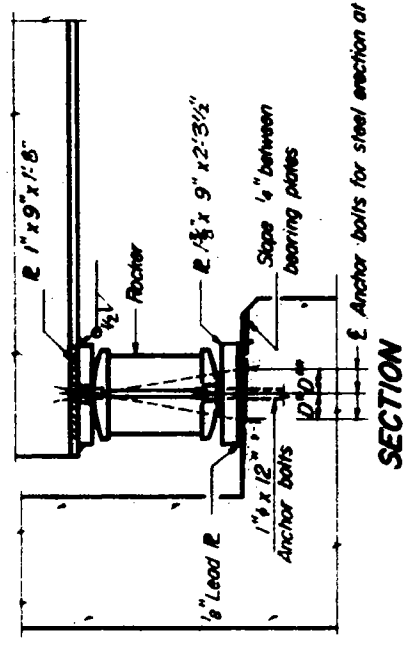


**SECTION**

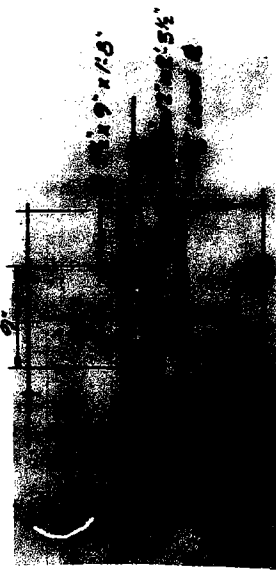


**ELEVATION**

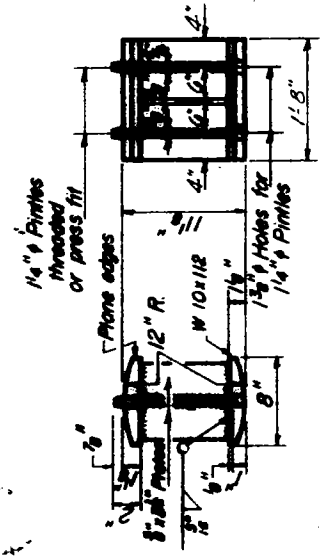

**ROCKER**



**PINTLE**

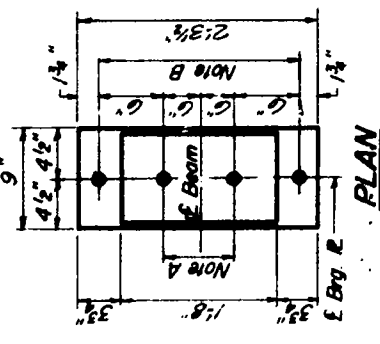

**AT ABUTMENT**

**NOTE A**


1 3/8" Holes - 1" deep in top R. for pintles Thread or press fit pintles into bottom R.

**NOTE B**

1 1/2" Holes for 1" anchor bolts. 2 x 2 1/2 x 2 1/2 R. Washers under nut.

**NOTE C**

1 3/8" Holes 1" deep in top R. only for 1/4" pinholes.

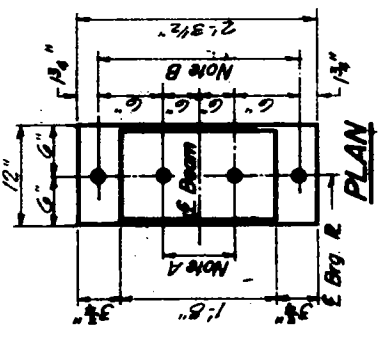


**AT PIER**

**BEARING ASSEMBLY DETAILS**

**NOTES ON SETTING OF ANCHOR BOLTS AT EXP. BRGS.**

- a) D\* (Side of brg. away from fixed brg.)  
D\*\* = 1/8" per each 100' of expansion for every 15° fall below the normal temp. of 50°F  
D\*\*\* = 1/8" per each 100' of expansion for every 15° rise above the normal temp. of 50°F
- b) After beams have been erected and dimensions D\* or D\*\* determined, holes shall be drilled and anchor bolts shall be grouted in place. All fixed anchor bolts may be built into the masonry.

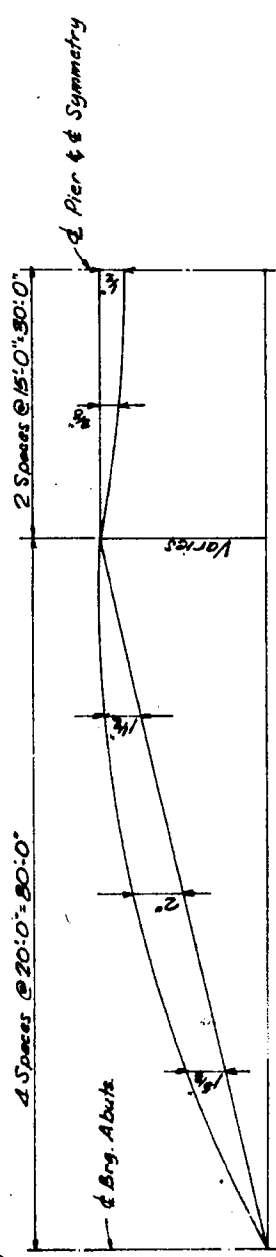


**HALF CAMBER DIAGRAM**

(Includes allowance for Vertical Curvature of Roadway.)

DESIGNED	J. AFEL
CHECKED	C.D.C.
ESTIMATED	
PASSED	





NO. 103	MS	WHITE	106
NO. 103	MS	WHITE	106
NO. 103	MS	WHITE	106

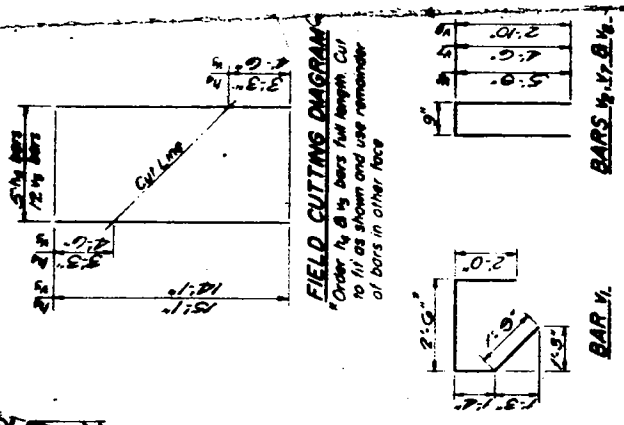

**TWO ABUTMENTS  
BILL OF MATERIAL**




Bar No.	Size	Length	Shape
1	1/2"	208	5
2	1/2"	40	4
3	1/2"	124	4
4	1/2"	198	8
5	3/8"	204	5
6	1/2"	120	5
7	1/2"	120	5
8	1/2"	208	5
9	1/2"	84	4
10	1/2"	64	4
11	1/2"	20	4
12	1/2"	72	4
13	1/2"	208	5
14	1/2"	40	4
15	1/2"	124	4
16	1/2"	198	8
17	3/8"	204	5
18	1/2"	120	5
19	1/2"	120	5
20	1/2"	208	5
21	1/2"	84	4
22	1/2"	64	4
23	1/2"	20	4
24	1/2"	72	4
25	1/2"	208	5
26	1/2"	40	4
27	1/2"	124	4
28	1/2"	198	8
29	3/8"	204	5
30	1/2"	120	5
31	1/2"	120	5
32	1/2"	208	5
33	1/2"	84	4
34	1/2"	64	4
35	1/2"	20	4
36	1/2"	72	4
37	1/2"	208	5
38	1/2"	40	4
39	1/2"	124	4
40	1/2"	198	8
41	3/8"	204	5
42	1/2"	120	5
43	1/2"	120	5
44	1/2"	208	5
45	1/2"	84	4
46	1/2"	64	4
47	1/2"	20	4
48	1/2"	72	4
49	1/2"	208	5
50	1/2"	40	4
51	1/2"	124	4
52	1/2"	198	8
53	3/8"	204	5
54	1/2"	120	5
55	1/2"	120	5
56	1/2"	208	5
57	1/2"	84	4
58	1/2"	64	4
59	1/2"	20	4
60	1/2"	72	4

**ABUTMENTS**  
 F.A. RT. 203 SEC. 105-2 H/S  
 WHITESIDE COUNTY  
 STATION 180+08.52

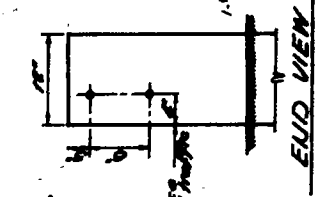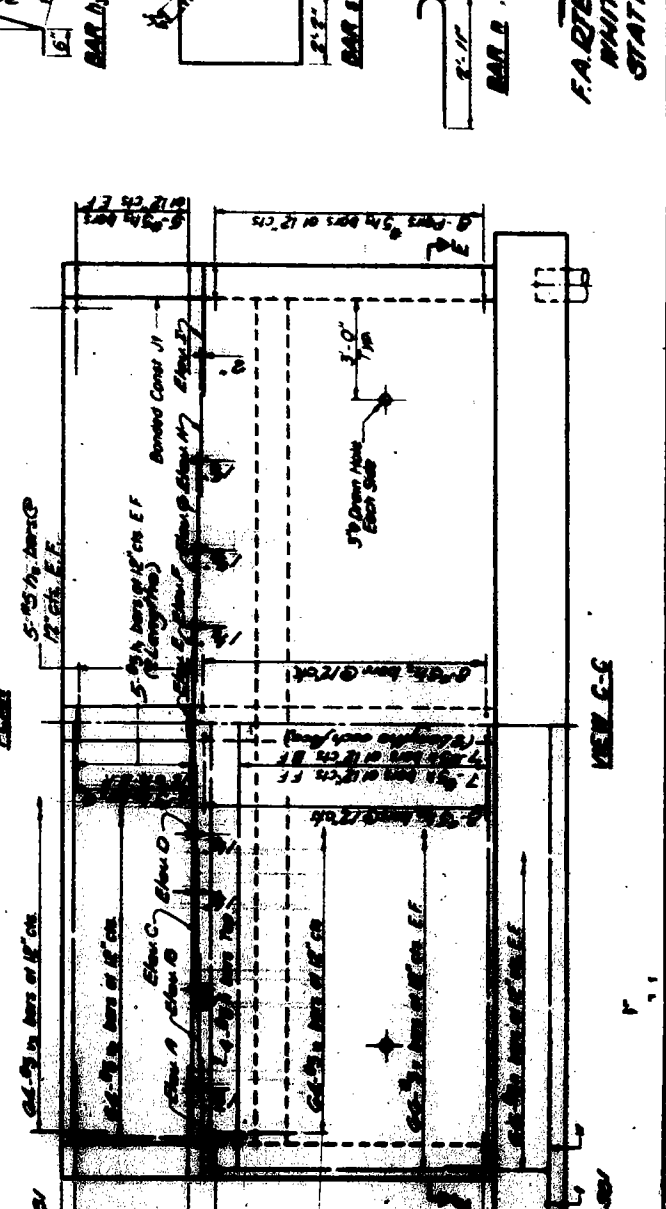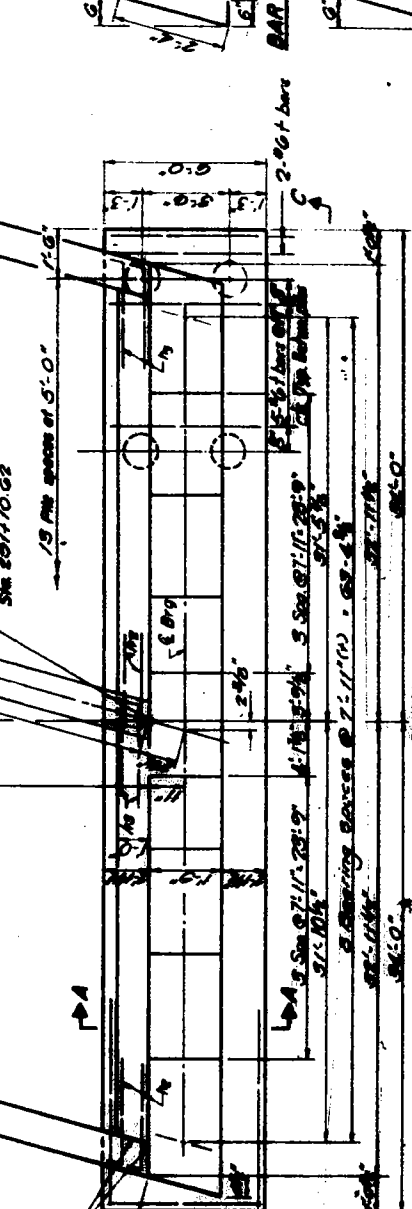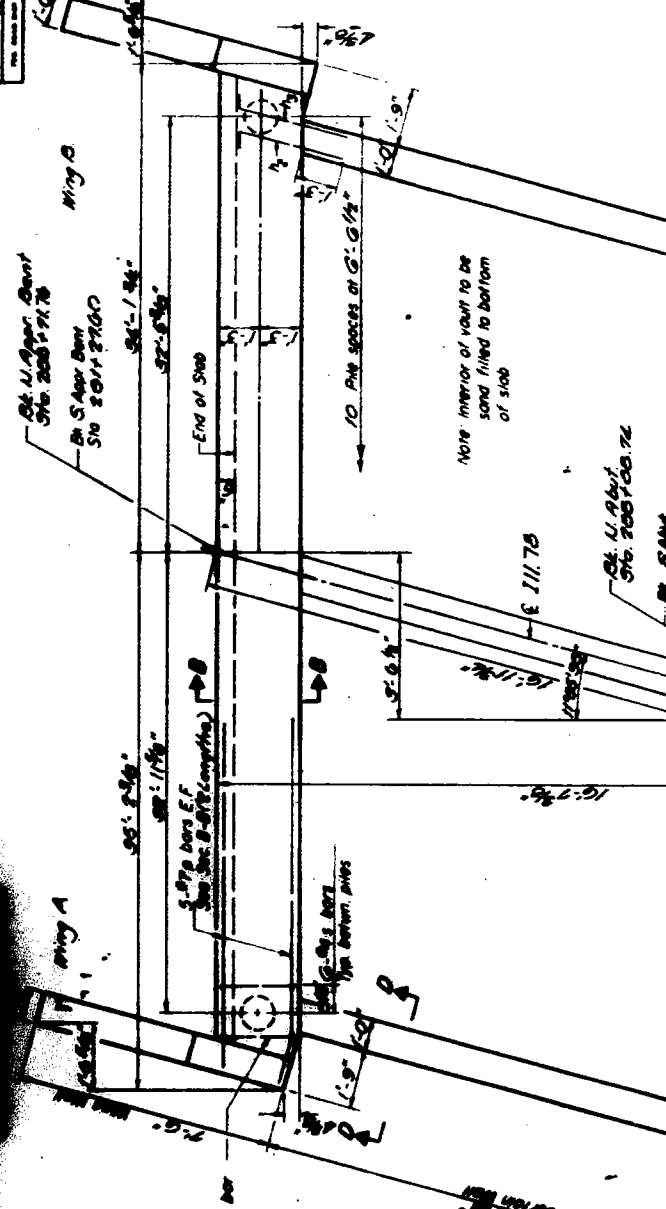

**TABLE OF ELEVATIONS**

Point	Elevation
A	111.75
B	111.75
C	111.75
D	111.75
E	111.75
F	111.75
G	111.75
H	111.75
I	111.75
J	111.75
K	111.75
L	111.75
M	111.75
N	111.75
O	111.75
P	111.75
Q	111.75
R	111.75
S	111.75
T	111.75
U	111.75
V	111.75
W	111.75
X	111.75
Y	111.75
Z	111.75

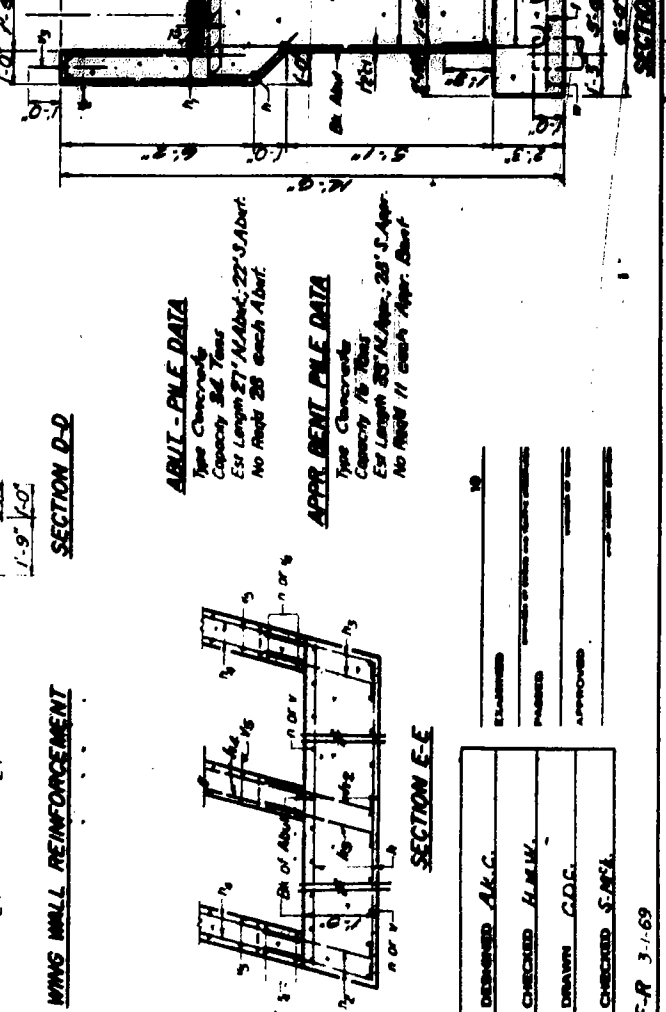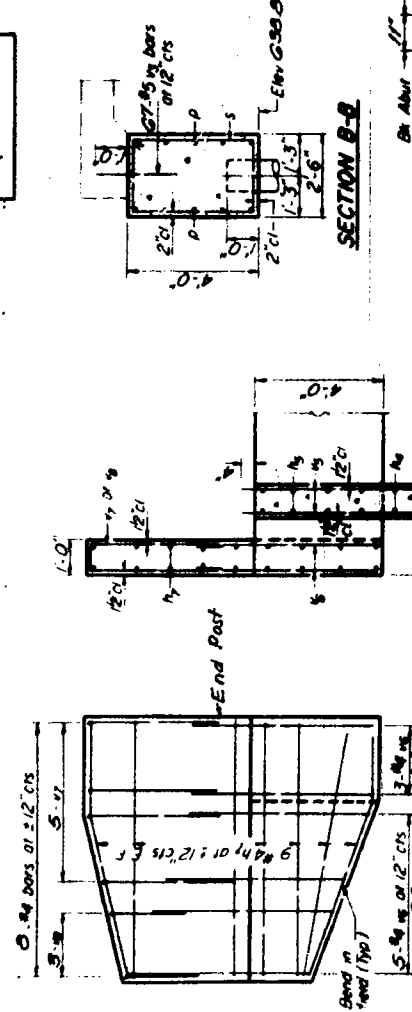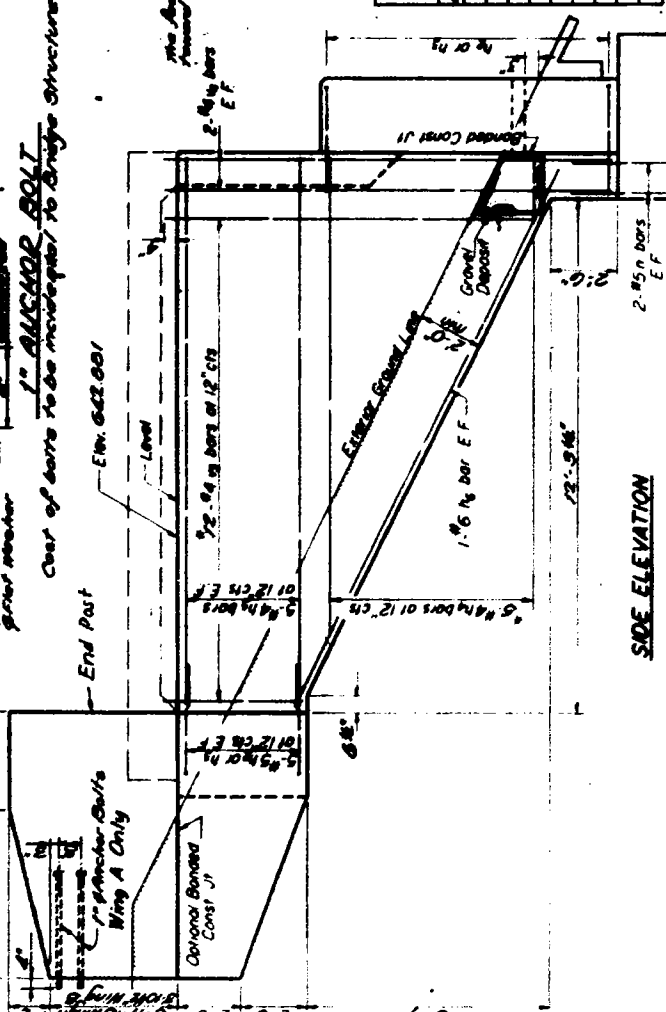

**ABUT-PILE DATA**  
 Type Concrete  
 Capacity 34 Tons  
 Est Length 27' 11/16" Abut; 22' 5/8" Abut;  
 No Rebar 28 each Abut.

**APPR. BENT PILE DATA**  
 Type Concrete  
 Capacity 16 Tons  
 Est Length 20' 11/16" Abut; 20' 5/8" Abut;  
 No Rebar 11 each Appr. Abut.

DESIGNED	A.K.C.
CHECKED	H.M.M.
DRAWN	C.D.C.
CHECKED	S.A.S.






DATE	195	WHITESIDE	480	100
NO.	403	211		
DESIGNER				
CHECKED				
DRAWN				
APPROVED				

Note: 6" Crimp shall either be supplied on the cylindrical section or made in the field as detailed.

**FIELD CRIMP DETAIL**

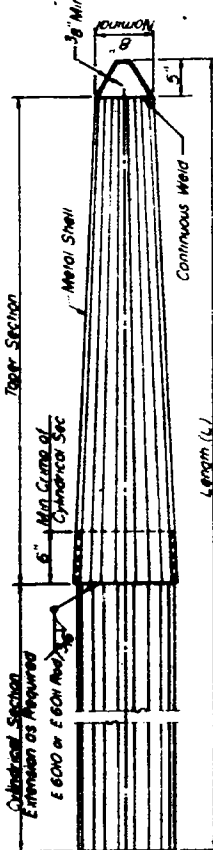



**OPTIONAL FLAT END**




**ALLOWABLE TAPER SECTIONS**

- 10' Length - Taper 1" in 2'-6"
- 17' Length - Taper 1" in 4'-0"
- 25' Length - Taper 1" in 7'-0"
- 30' Length - Taper 1" in 7'-0"


Welded wire fabric 6" x 6" mesh #4 wires - Wt 58#/100 sq ft. The cost of Class X Concrete Encasement and Reinforcement is incidental to the cost of furnishing piles. The thickness of the shell shall be .1793 inches with a tolerance of 5%. Forms for encasement may be omitted when soil conditions will permit.

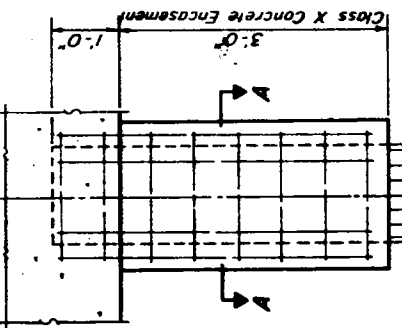

**DETAIL OF TAPERED METAL SHELL FOR CAST IN PLACE CONCRETE PILES**

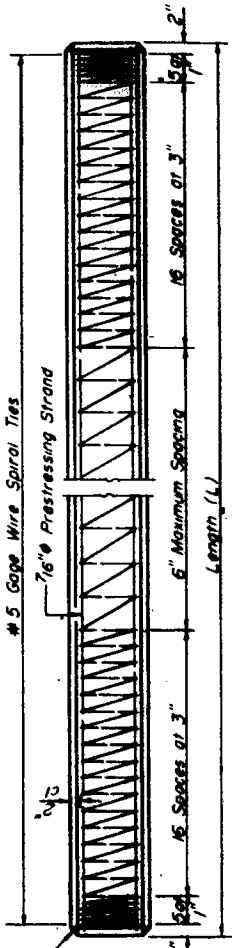

**PILE PLAN**

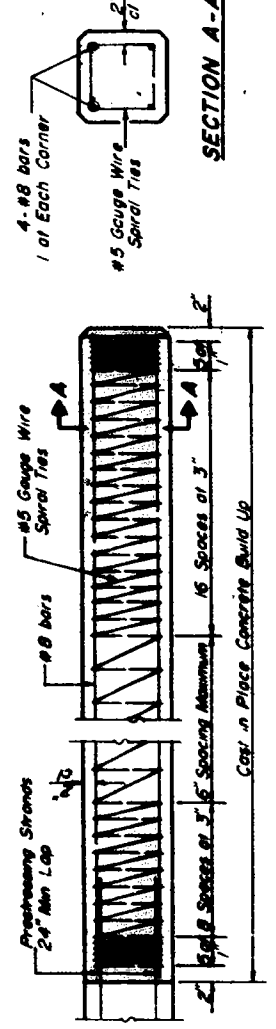

**PILE BUILD UP**

Note: Prestressing steel shall be non-pretensioned extra high strength stress-relieved 7 wire strand. The nominal diameter shall be 7/16" and the minimum nominal cross-sectional area shall be 6959 square inch. Handling: For pile lengths up to 45', use two slings placed at a distance of 0.21L from each end. For piles longer than 45', use three slings placed at a distance of 0.12L from each end and at midpoint of pile.

**DESIGN STRESSES**

- f<sub>c</sub> = 4,000 psi
- f<sub>s</sub> = 205,000 psi (21,000 lbs.)
- f<sub>t</sub> = 100,000 psi (21,700 lbs.)


**ELONGATION (End Reinforcement)**





**PILE DETAILS**

FA. RTE. 408-SEC. 195-218  
WINTERSIDE COUNTY  
STATION 150+00.52


**DETAIL OF PRECAST PRESTRESSED CONCRETE PILES**



Forms for encasement may be omitted when soil conditions will permit. Welded wire fabric 6" x 6" mesh #4 wire - Wt 58#/100 sq ft. The cost of Class X Concrete Encasement and Reinforcement is incidental to the cost of furnishing piles. The thickness of the shell shall be .1793 inches with a tolerance of 5%. Note: Driving and bearing ends of pipe shall be cut square.

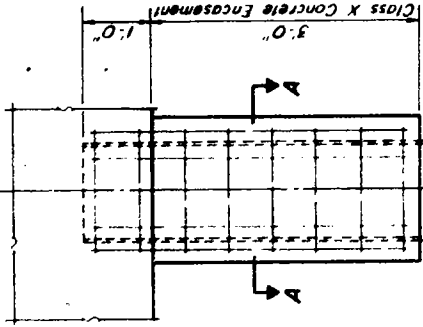


**DETAIL OF CYLINDRICAL STEEL SHELL FOR CAST IN PLACE CONCRETE PILES**

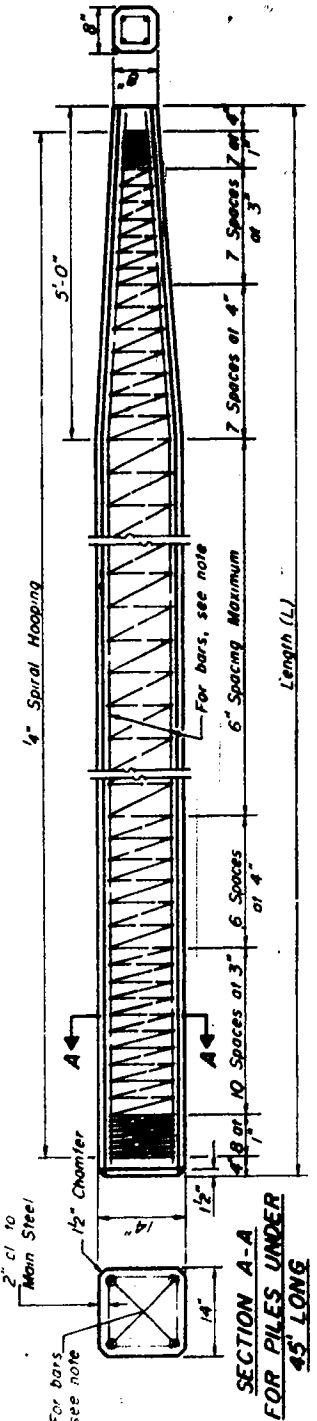

**SECTION A-A FOR PILES UNDER 45' LONG**

Note: For 14" Piles 45' long or more use 8-#8 bars 4 for the full length and 4 to the point of belv. For 14" Piles under 45' long use 4-#9 bars full length. Handling: For Pile lengths up to 45', use two slings placed at a distance of 0.21L from each end. For Piles longer than 45', use three slings placed at a distance of 0.12L from each end and at mid-point of pile.



Note: For length of piles (L) see sheet 9.

DESIGNED	TR
CHECKED	
DRAWN	
CHECKED	

**DETAIL OF PRECAST CONCRETE PILES**