







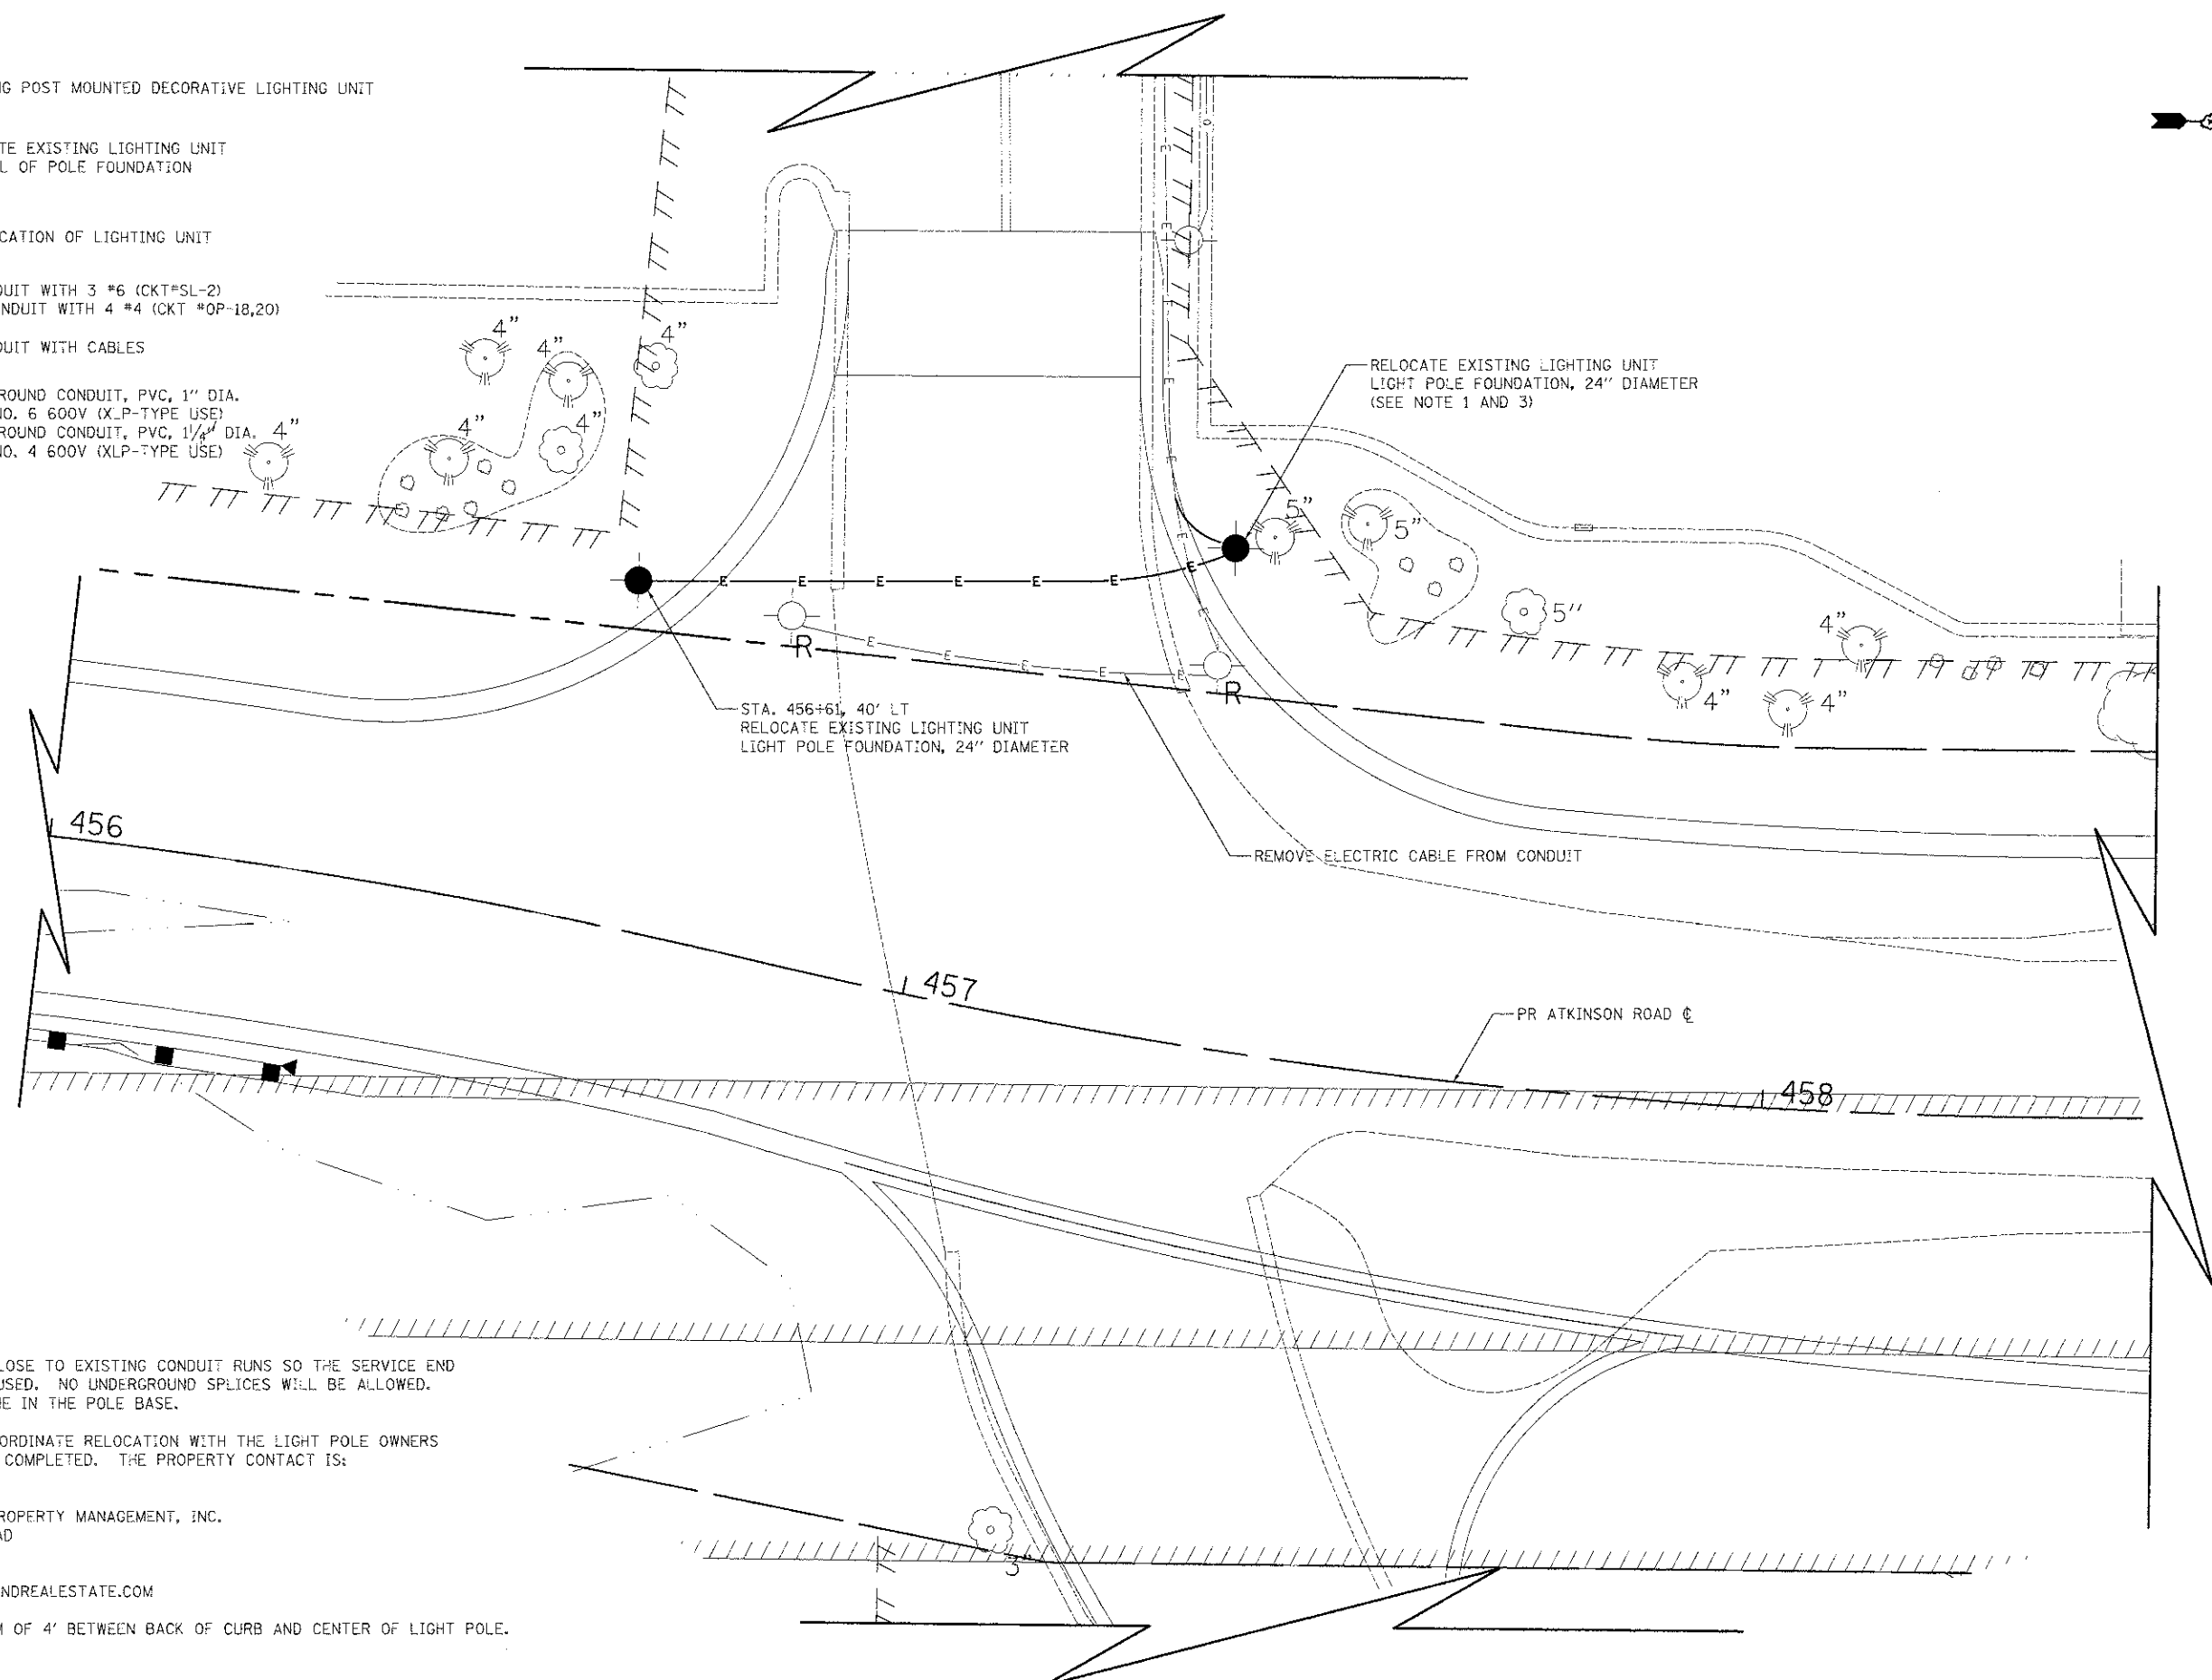




LEGEND

-  EXISTING POST MOUNTED DECORATIVE LIGHTING UNIT
-  RELOCATE EXISTING LIGHTING UNIT
REMOVAL OF POLE FOUNDATION
-  NEW LOCATION OF LIGHTING UNIT
-  1" CONDUIT WITH 3 #6 (CKT#SL-2)
-  1 1/4" CONDUIT WITH 4 #4 (CKT #OP-18,20)
-  1" CONDUIT WITH CABLES
-  UNDERGROUND CONDUIT, PVC, 1" DIA.
3-1/C NO. 6 600V (XLP-TYPE USE)
-  UNDERGROUND CONDUIT, PVC, 1 1/4" DIA.
4-1/C NO. 4 600V (XLP-TYPE USE)



NOTES

1. POLE SHALL BE LOCATED CLOSE TO EXISTING CONDUIT RUNS SO THE SERVICE END OF THE CABLE CAN BE RE-USED. NO UNDERGROUND SPLICES WILL BE ALLOWED. ALL SPLICES SHALL BE DONE IN THE POLE BASE.
2. THE CONTRACTOR SHALL COORDINATE RELOCATION WITH THE LIGHT POLE OWNERS PRIOR TO ANY WORK BEING COMPLETED. THE PROPERTY CONTACT IS:
KARA A. CROUSORE
PROPERTY MANGER
INLAND COMMERCIAL PROPERTY MANAGEMENT, INC.
2901 BUTTERFIELD ROAD
OAKBROOK, IL 60523
TEL: 630.218.2747
EMAIL: CROUSORE@INLANDREALESTATE.COM
3. THERE SHALL BE A MINIMUM OF 4' BETWEEN BACK OF CURB AND CENTER OF LIGHT POLE.

	USER NAME = eds	DESIGNED = JSM	REVISED =	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	ATKINSON ROAD LIGHTING RELOCATION PLAN	F.A.U. RTE. 198	SECTION 00-00045-00-PV	COUNTY LAKE	TOTAL SHEETS 195	SHEET NO. 117
	FILE NAME = ..\2189-shs-1-gh-01.dgn	DRAWN = JSM	REVISED =			SCALE: 1" = 10'	SHEET NO. 1 OF 1 SHEETS	STA. 456+00 TO STA. 458+50	CONTRACT NO. 63640	
PLOT SCALE = 1/8" = 1' / 1" = 10'	CHECKED = DMN	REVISED =	DATE = 02/06/12	FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT						