



PLAN VIEW
N.T.S.


POLE #	DIM. A
F1,F2	3'-0"

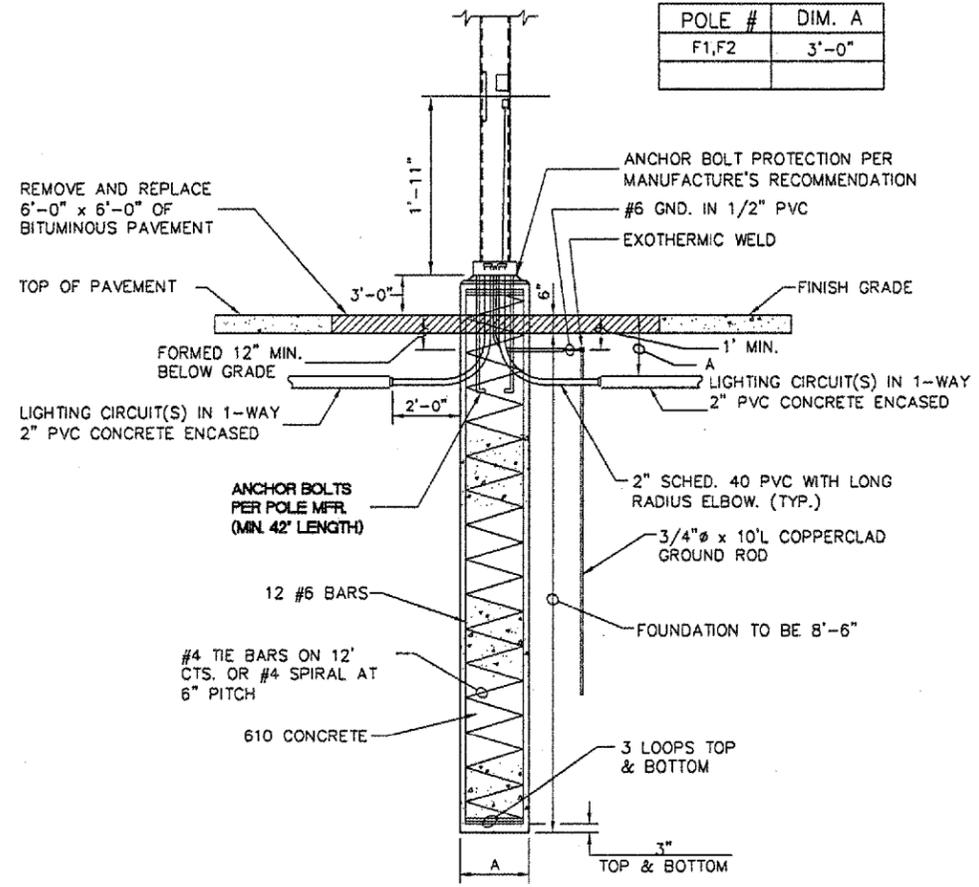


FOUNDATION DETAIL
N.T.S.

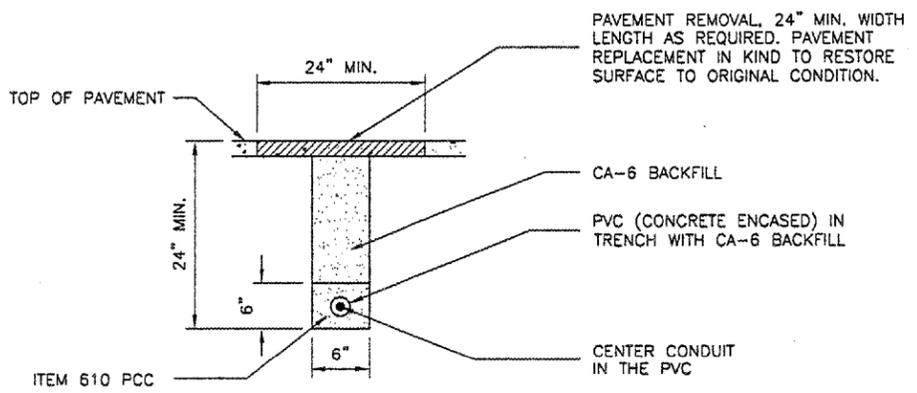

TRENCH DETAIL
N.T.S.

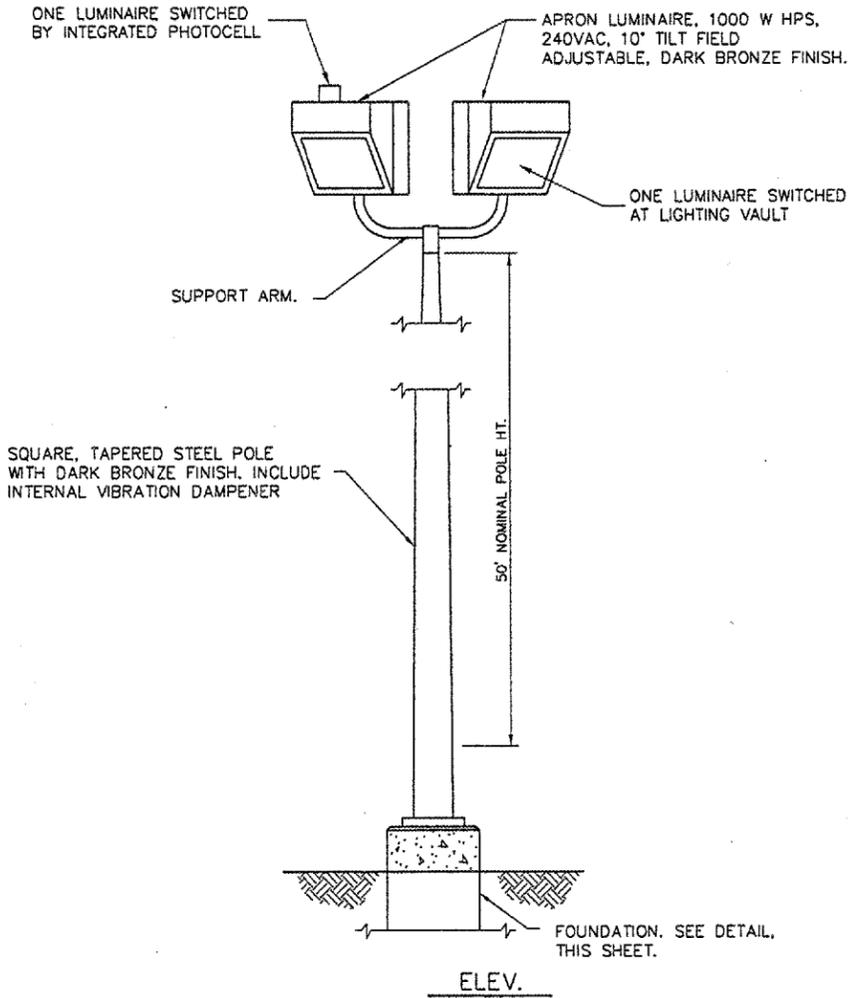

APRON LIGHT FIXTURE DETAILS
N.T.S.

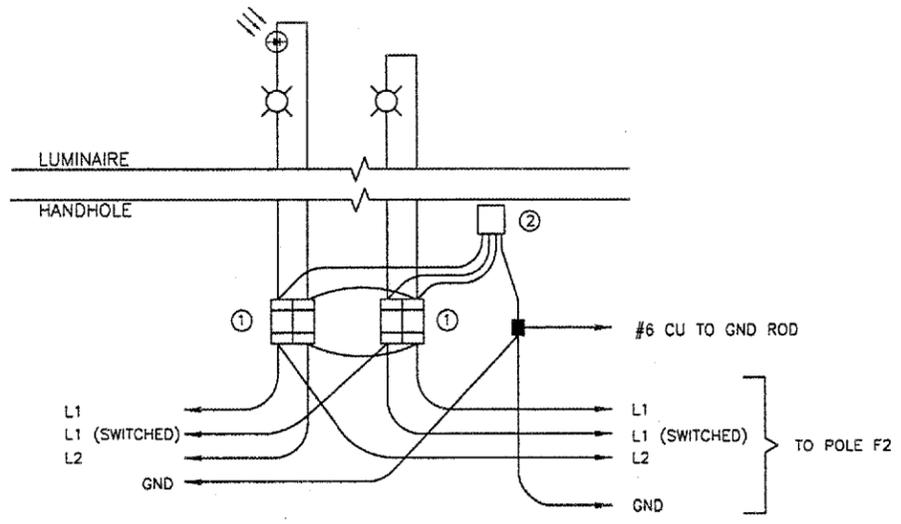


POLE BASE WIRING
(POLE F1 SHOWN)

- ① IN LINE BREAKAWAY FUSE HOLDER WITH 2-10 AMP FUSES, BUCHANAN D-65 OR EQUIVALENT
- ② 240V LIGHTNING ARRESTOR WITH 3200 V IMPULSE SPARKOVER, MINIMUM 10,000 A DISCHARGE, INSTALLED IN HANDHOLE

REVISIONS

NUMBER	BY	DATE



WILLARD AIRPORT
 UNIVERSITY OF ILLINOIS
 REHABILITATE GA/SCHOOL APRON
 APRON LIGHTING DETAILS

© Copyright CMT, Inc.
CMT
 CRAWFORD, MURPHY & TILLY, INC.
 CONSULTING ENGINEERS
 License No. 184-000613

DESIGN BY:	JEF
DRAWN BY:	CMT
CHECKED BY:	SMH
APPROVED BY:	JEF
DATE:	06/09/2006
JOB No:	0605902
IL PROJ. NO.	CMI-3589
AIP PROJ. NO.	3-17-00XX-XX
SHEET	12 OF 16 SHEETS