
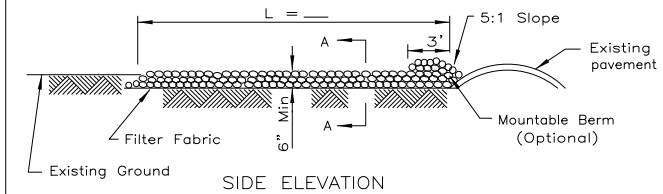




STABILIZED CONSTRUCTION ENTRANCE PLAN

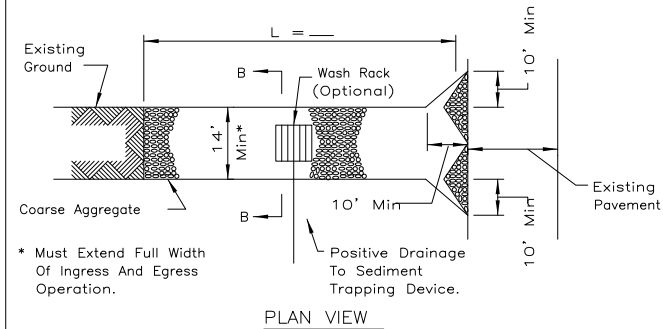

- NOTES:
- 1 Filter fabric shall meet the requirements of material specification 592 GEOTEXTILE, Table 1 or 2, Class I or II and shall be placed over the cleared area prior to the placing of rock.
 - 2 Rock or reclaimed concrete shall meet one of the following IDOT coarse aggregate gradation, CA-1, CA-2, CA-3 or CA-4 and be placed according to construction specification 25 ROCKFILL using placement Method 1 and Class III compaction.
 - 3 Any drainage facilities required because of washing shall be constructed according to manufacturers specifications.
 - 4 If wash racks are used they shall be installed according to the manufacturer's specifications.

REFERENCE Project _____		STANDARD DWG. NO. IL-630
Designed _____ Date _____		SHEET 1 OF 2
Checked _____ Date _____		DATE 8-18-94
Approved _____ Date _____		

STABILIZED CONSTRUCTION ENTRANCE PLAN

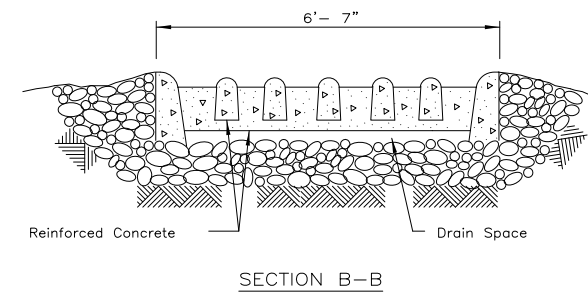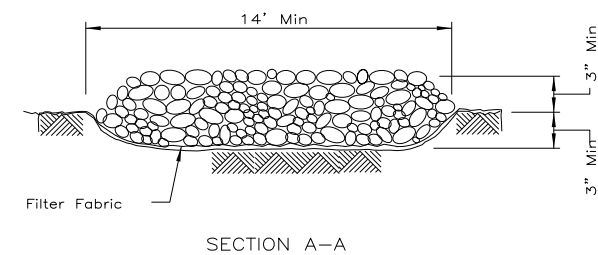

REFERENCE Project _____		STANDARD DWG. NO. IL-630
Designed _____ Date _____		SHEET 2 OF 2
Checked _____ Date _____		DATE 8-18-94
Approved _____ Date _____		



PA049

PATH:
FILE:
UPDATE BY:
SURVEY BOOK #
XREF DWG:
XREF DWG:
DATE:

REVISIONS		
NUMBER	BY	DATE

0 1 2
THIS BAR IS EQUAL TO 2" AT FULL SCALE (34X22).


SILT FENCE WITH WIRE SUPPORT PLAN

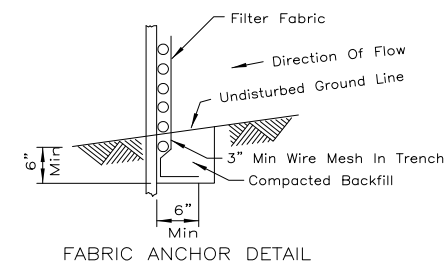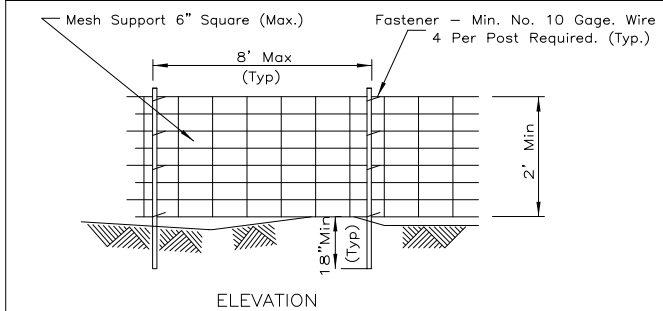

- NOTES:
- 1 Wires of mesh support shall be min. gage no. 12.
 - 2 Temporary sediment fence shall be installed prior to any grading work in the area to be protected. They shall be maintained throughout the construction period and removed in conjunction with the final grading and site stabilization.
 - 3 Filter fabric shall meet the requirements of material specification 592 Geotextile Table 1 or 2, Class I with equivalent opening size of at least 30 for nonwoven and 50 for woven.
 - 4 Fence posts shall be either standard steel post or wood post with a minimum cross-sectional area of 3.0 sq. in.

REFERENCE Project _____		STANDARD DWG. NO. IL-620W
Designed _____ Date _____		SHEET 1 OF 2
Checked _____ Date _____		DATE 3-3-95
Approved _____ Date _____		

SILT FENCE

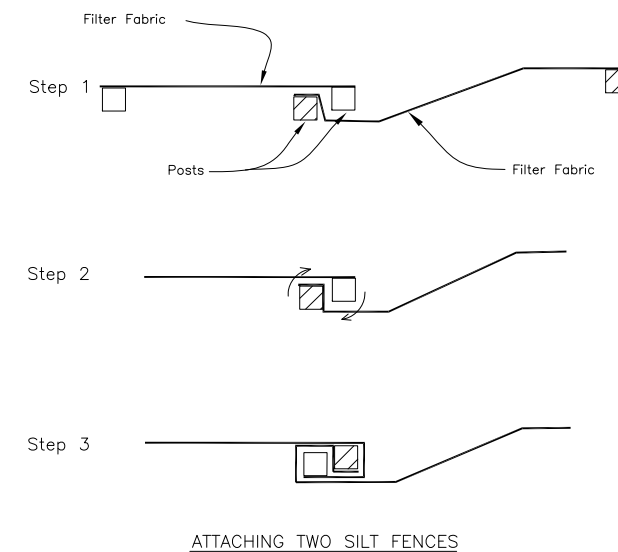

- NOTES:
1. Place the end post of the second fence inside the end post of the first fence.
 2. Rotate both posts at least 180 degrees in a clockwise direction to create a tight seal with the fabric material.
 3. Drive both posts a minimum of 18 inches into the ground and bury the flap.

REFERENCE Project _____		STANDARD DWG. NO. IL-620(W)
Designed _____ Date _____		SHEET 2 OF 2
Checked _____ Date _____		DATE 1-29-99
Approved _____ Date _____		

CHICAGO EXECUTIVE AIRPORT
WHEELING/PROSPECT HEIGHTS, ILLINOIS
CONSTRUCT SOUTHEAST QUADRANT APRON

STORM WATER POLLUTION
PREVENTION PLAN (SWPPP)
DETAILS

© Copyright GMT, Inc.
GMT
 CRAWFORD, MURPHY & TILLY, INC.
 CONSULTING ENGINEERS
 License No. 184-000613

DESIGN BY:	MJW
DRAWN BY:	MJW
CHECKED BY:	
APPROVED BY:	
DATE:	07/24/09
JOB No:	09290-04

ILLINOIS PROJECT: PWK-3581
A.I.P. PROJECT: 3-17-0018-B37