



NOTES:

- Length of railing & edge distance shown are based on a Three-Sided Precast Concrete structure with 10" thick walls. The railing fabricator shall coordinate with the precaster and adjust dimensions accordingly.
- Railing shall be in accordance with Section 509 of the Standard Specifications, except as noted, and will be paid for at the contract unit price per foot for Bicycle Railing, Special or Parapet Railing, Special.
- Hollow Structural Steel Tubing shall conform to the requirements of ASTM Designation of 500, Grade B, Structural Steel Tubing. Anchor bolts shall conform to ASTM A307 unless noted otherwise.
- All other steel shapes and plates shall conform to the requirements of AASHTO M 270 Grade 36.
- The bicycle railing and parapet railing shall be powder coated and the color shall be black.
- The exterior steel surface shall be blast cleaned to Steel Structures Painting Council Surface Preparation Specification No. 6 (SSPC-SP6) requirements using cast steel abrasives conforming to the Society of Automotive Engineers (SAE) recommended Practice J827. The blast method used is a recirculating, closed cycle centrifugal wheel system with abrasive conforming to SAE Shot Number S280.
- All exterior surfaces shall be coated with a Urethane or Triglycidyl Isocyanurate (TGIC) Polyester Powder to a minimum film thickness of 0.002". The coating shall be electrostatically applied and cured in a gas fired convection oven by heating the steel substrate to a minimum of 350 degrees fahrenheit and a maximum of 400 degrees fahrenheit. The thermosetting powder resin shall provide both intercoat as well as substrate fusion adhesion that meets 5A or 5B classifications of ASTM D3359.
- Ship railing in a manner to prevent damage to the powder coating.

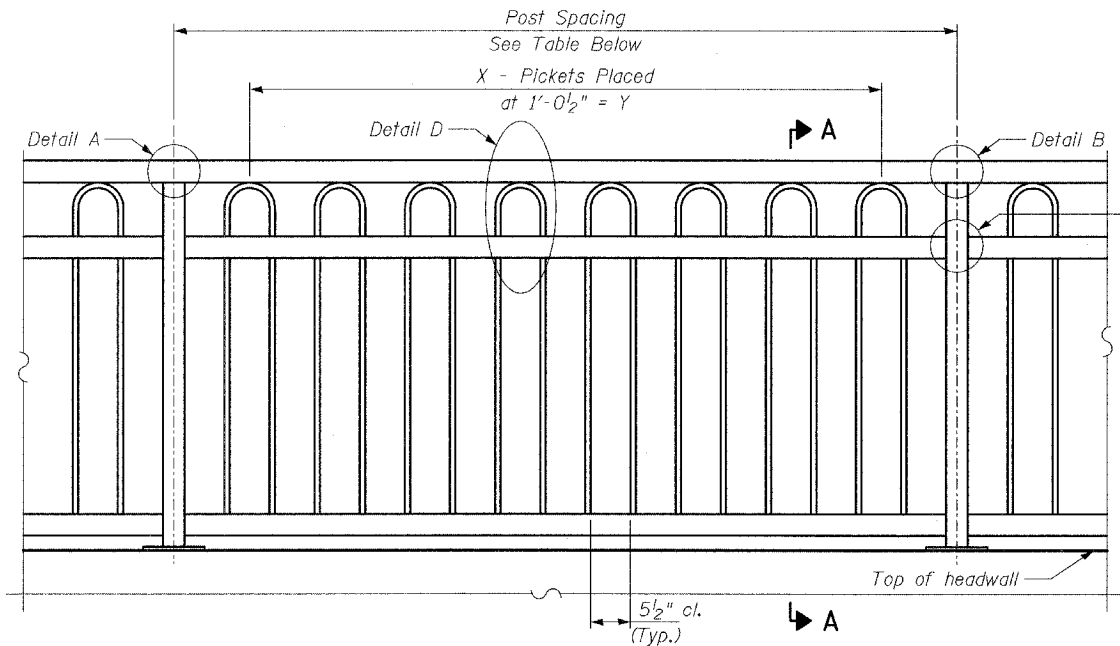


ELEVATION - TYPICAL SECTION

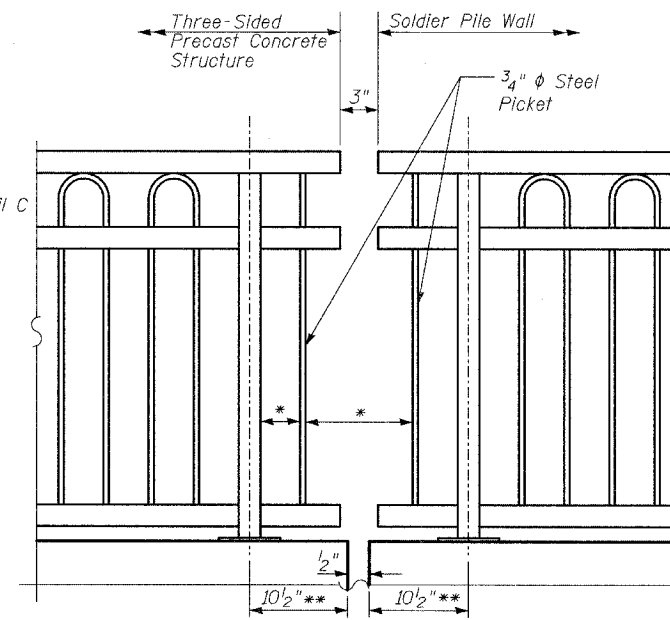

* Max Spacing is 6". Rail Fabricator shall add pickets as necessary.
** See Note 1


BICYCLE RAILING

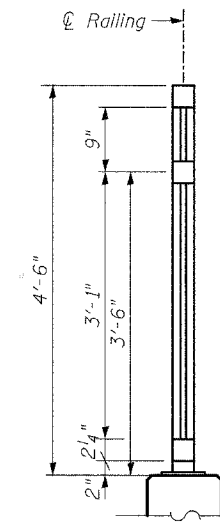


SECTION A-A

BICYCLE & PARAPET RAILING LAYOUT


Post Spacing	Picket Layout	
	X	Y
5'-11"	5	4'-2"
6'-11 1/2"	6	5'-2 1/2"
8'-0"	7	6'-3"
9'-0 1/2"	8	7'-3 1/2"

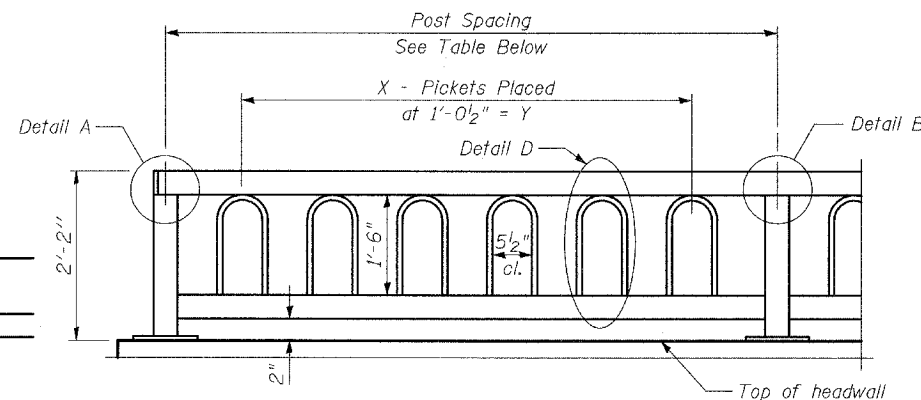


PARAPET RAILING ELEVATION

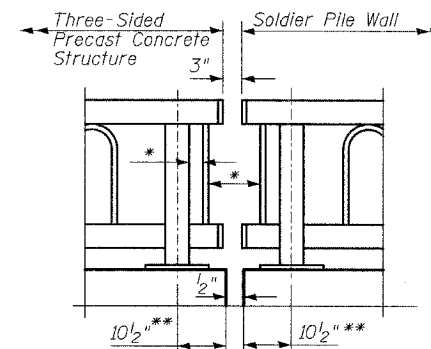


PARAPET RAILING ELEVATION AT EXPANSION JOINT

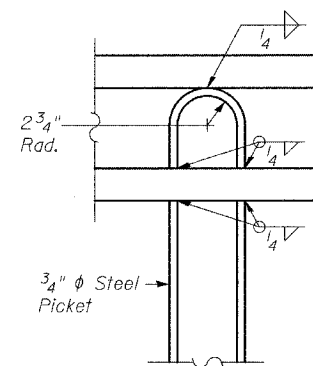

DETAIL D


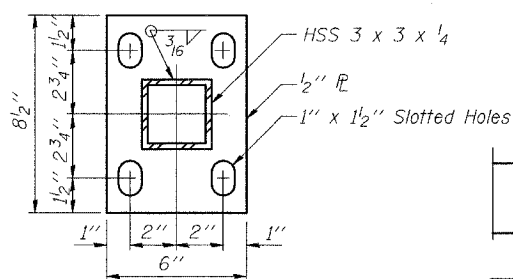


BASE PL

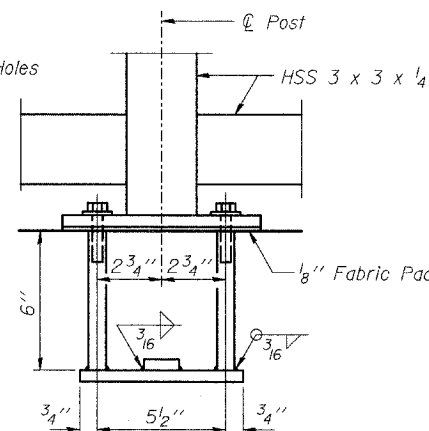


TYPICAL ANCHOR BOLT DETAILS

In lieu of the cast-in-place anchor device shown, the Contractor has the option of drilling and setting 5/8" φ anchor rods according to Article 509.06 of the Standard Specifications. Embedment shall be according to the manufacturer's specifications.

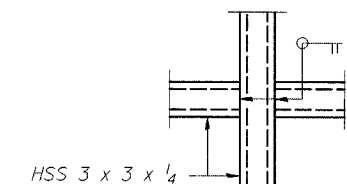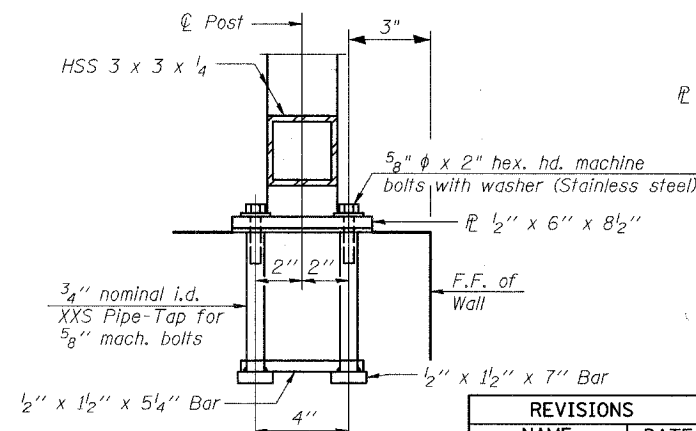

DETAIL C

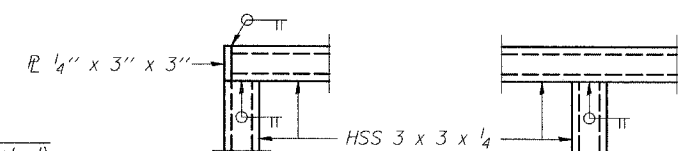

DETAIL A

DETAIL B

BILL OF MATERIAL

Item	Unit	Quantity
Bicycle Railing, Special	Foot	31.4
Parapet Railing, Special	Foot	31.4

REVISIONS


NAME	DATE

PEDESTRIAN TUNNEL RAILING DETAILS

WASHINGTON - 75TH STREET
F.A.U. ROUTE 2552
SECTION 00-00114-00-PV
DUPAGE COUNTY

TYLIN INTERNATIONAL

DESIGNED	- SP
CHECKED	- SP
DRAWN	- SP
CHECKED	- SP

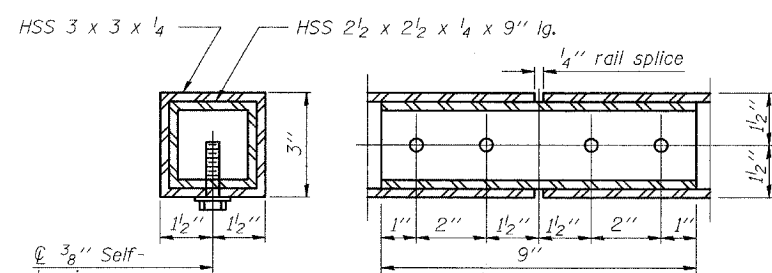

TYPICAL RAIL SPLICE DETAILS