

ASBESTOS SURVEY REPORT

PTB 196-032

Asbestos Survey for Building Demolition (I-80)

509 & 511 Illinois Street, Joliet, Illinois

Region One/District One

Prepared for:



**Illinois Department of Transportation
District 1**

Submitted to:

**WSP USA
30 N. LaSalle Street
Chicago, IL, 60602**

Prepared by:



August 8, 2025



August 8, 2025

David Skaleski, P.E.
Project Manager
WSP USA
30 N. LaSalle Street, Suite 4200
Chicago, Illinois 60602

Asbestos Survey Report
PTB 198-003
FAI-80 (I-80) over Des Plaines River Bridge
Job N. D-91-204-19
509 & 511 Illinois Street, Joliet, IL
Parcel No. 1P10105

Dear Mr. Skaleski:

GSG Consultants Inc has conducted an Asbestos Survey for the above referenced property in accordance with our contractual agreement. The report provides a description of the site, survey methodology, analytical results, abatement cost estimates, and recommendations.

Should you have any questions or require additional information, please call us at 630-994-2600.

Prepared by:	<u><i>epahomi</i></u>	<u>August 8, 2025</u>
	Erin Pahomi	Date
	Asbestos Building Inspector	
	Inspector License No: 100-20674	

Reviewed By:	<u><i>Vincent Gee</i></u>	<u>August 8, 2025</u>
	Vince Gee, M.S.	Date
	Senior Project Manager	

QA Manager:	<u><i>Ala Sassila</i></u>	<u>August 8, 2025</u>
	Ala E Sassila, Ph.D., PE	Date

TABLE OF CONTENTS

1.0	INTRODUCTION	4
2.0	SURVEY METHODOLOGY	5
2.1	VISUAL INSPECTION	5
2.2	SAMPLING PROCEDURES	6
2.3	QUANTIFICATION.....	7
3.0	ANALYTICAL RESULTS.....	8
3.1	TESTING PROCEDURES	8
3.2	FINDINGS.....	8
4.0	RECOMMENDATIONS.....	9
5.0	LIMITATIONS	11
6.0	CERTIFICATION	12

TABLES

Table 1	Materials Sampled for ACM.....	2
----------------	---------------------------------------	----------

EXHIBITS

Figure 1	Asbestos Bulk Sampling Locations
-----------------	---

APPENDICES

Appendix A	Analytical Testing Results
Appendix B	Reference Photographs
Appendix C	Inspector Licenses and Training Certificates
Appendix D	Laboratory Accreditations

ACRONYMS AND ABBREVIATIONS

ACM	Asbestos-Containing Materials
ACBM	Asbestos-Containing Building Materials
AHERA	Asbestos Hazard Emergency Response Act
CFR	Code of Federal Regulations
COC	Chain of Custody
GSG	GSG Consultants, Inc.
IDOT	Illinois Department of Transportation
IDPH	Illinois Department of Public Health
NESHAP	National Emissions Standards for Hazardous Air Pollutant
NVLAP	National Voluntary Laboratory Accreditation Program
OSHA	Occupational Safety and Health Administration
PLM	Polarized Light Microscopy
RACM	Regulated Asbestos-Containing Material
TSI	Thermal System Insulation
USEPA	United States Environmental Protection Agency

SURVEY SUMMARY

SITE INFORMATION			
FAP Route:	FAI-80 (I-80)	Address:	509 & 511 Illinois Street
County:	Will	City, State, Zip	Joliet, IL 60433
Section:	N/A	Property Type:	Single-Family Residential
IDOT Job No.	D-91-204-19	Construction Date:	1900
Parcel No.	1P10105	Building Size:	1,600 SF

ASBESTOS CONTAINING MATERIALS	
Survey Date:	July 15 (509 Illinois St.) and July 24 (511 Illinois St.), 2025
Weather Conditions:	89°F, Sunny & 84°F, Cloudy
By Whom:	
Firm:	GSG Consultants, Inc
Inspector:	Tim Walsh
IDPH License No.	100-08900
Results:	<p>Number of Material Types Sampled <u>19</u></p> <p>Number of Samples Collected: <u>57</u></p> <p>Number of Materials Tested Positive: <u>0</u></p> <p>Was Friable ACM Found? <u>No</u></p> <p>Were Roofing Materials Sampled? <u>Yes</u></p> <p>Are There Unique State or Local Requirements? <u>No</u></p>
Laboratory Used:	<p>Name: Sterling Labs</p> <p>Address: 2242 W. Harrison Street, Chicago, Illinois</p> <p>NVLAP: 101202-0</p>
Building Access Limitations:	None

ASBESTOS-CONTAINING MATERIALS (ACM) SURVEY RESULTS:

**Parcel No. 1P10105
Residential Property
509 & 511 Illinois Street, Joliet, Illinois**

Table 1 provides a list of the homogeneous building material types that were sampled as part of the asbestos survey and the laboratory testing results.

HA No.	Material Description	Location	Type ⁽¹⁾	Condition	Friable	% Asbestos*	# of Samples	Estimated Quantity ⁽²⁾
509 Illinois Street								
1	Drywall System	Throughout	Misc.	Good	No	ND	3	N/A
2	Interior Window Caulk	Throughout	Misc.	Good	No	ND	3	N/A
3	Roofing Material (5 layer)	House Roof	Misc.	Good	No	ND	3	N/A
4	Chimney Brick	Roof	Misc.	Good	No	ND	3	N/A
5	Chimney Flashing	Roof	Misc.	Good	No	ND	3	N/A
6	Exterior Door Caulk	Exterior	Misc.	Good	No	ND	3	N/A
7	Exterior Window Caulk	Exterior	Misc.	Good	No	ND	3	N/A
8	Exterior Siding	Exterior	Misc.	Good	No	ND	3	N/A
9	Roofing Material Garage (6 Layers)	Garage	Misc.	Good	No	ND	3	N/A
10	1' x 1' Ceiling Tile & Adhesive	Garage	Misc.	Good	No	ND	3	N/A
511 Illinois Street								
1	Drywall System	Throughout	Misc.	Good	No	ND	3	N/A
2	Plaster	Throughout	Surf.	Good	No	ND	3	N/A
3	Interior Window Caulk	Throughout	Misc.	Good	No	ND	3	N/A
4	Textured Ceiling	Throughout	Surf.	Good	No	ND	3	N/A
5	Chimney Brick	Roof	Misc.	Good	No	ND	3	N/A
6	Exterior Siding	Exterior	Misc.	Good	No	ND	3	N/A

Asbestos Survey Report

Survey Summary

509 & 511 Illinois Street, Joliet, IL

HA No.	Material Description	Location	Type ⁽¹⁾	Condition	Friable	% Asbestos*	# of Samples	Estimated Quantity ⁽²⁾
7	Exterior Window Caulk	Exterior	Misc.	Good	No	ND	3	N/A
8	Exterior Door Caulk	Exterior	Misc.	Good	No	ND	3	N/A
9	Roofing Material (4 Layers)	Roof	Misc.	Good	No	ND	3	N/A
Total Estimated Quantity of ACM								0 SF

(1) TSI= Thermal System Insulation, Surf. = Surfacing Material, and Misc. = Miscellaneous.

(2) Quantities are estimates only, all quantities must be field verified.

1.0 INTRODUCTION

GSG Consultants Inc. (GSG) conducted an Asbestos Survey at Parcel No. 1P10105 located at 509 & 511 Illinois Street in Joliet, Illinois. The site is improved with two (2) one-story structures, both with an attic and a basement. The houses were constructed in 1900 and are approximately 1,600 square feet in size combined with asphalt shingled roofs. The interior walls and ceilings are drywall and plaster, and the floors are wood and ceramic tile. The building exterior is of masonry and aluminum over wood construction.

GSG conducted the asbestos survey to satisfy requirements of the United States Environmental Protection Agency (USEPA) regulations under 40 CFR Part 61, Subpart M of the National Emission Standards for Hazardous Air Pollutants (NESHAP) and applicable state and local regulations. This was accomplished by conducting a visual inspection of the structures to be impacted by the planned demolition and collecting samples of suspect ACM based on these observations.

The results, findings, conclusions, and recommendations expressed in this report are based on conditions observed during GSG's survey of the project area. The information contained in this report represents conditions at the time of the survey and may not accurately represent conditions at a later date. The conclusions in this report are based on conditions observed in accessible areas of the project area. The possibility exists that suspect hazardous building materials or conditions may exist within wall cavities, voids, or other areas hidden from view which were not observed and cannot be ruled out. Any additional potential hazardous building materials encountered that will be disturbed during the demolition activities and that differ from the materials assessed during this survey, were hidden from view, or were located in an area not accessible will require further sampling and analysis prior to disturbance. The estimated quantities provided herein should be considered approximate and are accurate to the extent allowable under the terms and conditions of our contract. This report has been prepared with generally accepted industry practices and procedures. No other warranty, either expressed or implied, is made.

The investigation did not include access or inspection of confined spaces, underground piping, conduits, and building footings, if any. Materials associated with electrical components and energized equipment were not safely accessible and were not sampled.

2.0 SURVEY METHODOLOGY

The asbestos survey was conducted in compliance with the United States Environmental Protection Agency (USEPA) National Emissions Standards for Hazardous Air Pollutants (NESHAPs), applicable State of Illinois and local asbestos regulations. NESHAP regulations defined regulated asbestos-containing material (RACM) as a friable asbestos material, a Category I non-friable ACM that has become friable, a Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting or abrading, or Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces acting on it during demolition or renovation. The materials were then classified with regard to whether they are friable or non-friable and classified as Class I or Class II non-friable materials, using the following definitions.

- **Friable:** NESHAP defines a friable ACM as any material containing more than one percent (1%) asbestos, which, when dry, may be crumbled, pulverized, or reduced to powder by hand pressure, and includes previously non-friable material where previously non-friable material becomes damaged to the extent that it may be crumbled, pulverized, or reduced to powder by hand pressure.
- **Category I Non-friable ACM:** NESHAP defines a Category I non-friable ACM as packing, gaskets, resilient floor covering (except vinyl sheet flooring products that are considered friable), and asphalt roofing products that contain more than one (1) percent asbestos as determined using the method specified in **Appendix A**, Subpart F, 40 CFR Part 763, Section 1, Polarized Light Microscopy
- **Category II Non-friable ACM:** means any material, excluding Category I non-friable ACM, containing more than 1 percent asbestos as determined using the methods specified in **Appendix A**, Subpart F, 40 CFR Part 763, Section 1, Polarized Light Microscopy that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.

The survey consisted of three major activities: visual inspection, sampling, and quantification of building materials. A brief description of each of the above elements is provided in the following sections.

2.1 Visual Inspection

The inspector conducted an initial building walkthrough to determine the presence and condition of suspect asbestos-containing materials (ACMs) that were accessible and/or exposed. The survey consisted of accessing accessible areas of the buildings to identify and quantify regulated RACM. The inspector identified homogeneous areas (HA) comprised of building materials that appear similar throughout in terms of color and texture and assumed date of installation. Materials that were similar in general appearance were grouped into homogeneous sampling areas. Following the EPA inspection protocol, each identified suspect homogeneous material was placed in one of the following EPA classifications:

1. Surfacing Materials (spray or trowel applied to building members)
2. Thermal System Insulation (materials generally applied to various mechanical systems)
3. Miscellaneous Materials (any materials which do not fit either of the above categories)

2.2 Sampling procedures

The asbestos inspector collected a representative number of samples from each HA. Building materials identified as concrete (not including cement panels or pipe and soft concrete), glass (including fiberglass), wood, masonry, metal, and plastic are not considered suspect ACM and were not sampled. The survey included destructive, intrusive, and/or exploratory testing unless specifically prohibited by IDOT. Destructive sampling is performed to identify materials that are concealed or obstructed. Concealed or obstructed areas include but are not limited to wall cavities, pipe chases, spaces above fixed ceilings, materials located under carpeting or subfloors, and ceramic tile grout/adhesive. Bulk samples of suspect ACM were collected in general accordance with Asbestos Hazard Emergency Response Act (AHERA) sampling protocols, based on the results of the visual observation. Random samples of suspect materials were collected of each HA.

A total of 57 bulk samples of suspect ACM, three (3) samples for each of the 19 homogeneous areas, were collected from various homogeneous areas of the buildings. Bulk samples were collected from the following materials/homogeneous area(s):

509 Illinois Street

- Drywall System
- Interior Window Caulk
- House Roofing Material (5 Layers)
- Chimney Brick
- Chimney Flashing
- Exterior Door Caulk
- Exterior Window Caulk
- Exterior Siding
- Garage Roofing Material (6 Layers)
- 1' x 1' Ceiling Tile & Adhesive

511 Illinois Street

- Drywall System
- Plaster
- Interior Window Caulk
- Textured Ceiling
- Chimney Brick
- Exterior Siding
- Exterior Window Caulk
- Exterior Door Caulk
- Roofing Material (4 Layers)

Exhibit 1, Suspect ACM Sample Locations, shows the approximate locations of the suspect ACM collected during the field survey. Samples were placed in new sealable containers and labeled with unique sample numbers using

an indelible marker. All non-disposable sampling equipment was wet-wiped and cleaned before and after each use. Bulk material samples were collected in 4-milliliter plastic bags, and tightly sealed for transport to the laboratory. Bulk samples were submitted under a chain-of-custody (COC) protocol to Sterling Labs in Chicago, Illinois.

2.3 Quantification

The inspector estimated the quantities of accessible and/or exposed materials that were suspected of containing asbestos using a measuring wheel and/or visual estimation. Actual quantities may differ between visually estimated values and physical measurements. The asbestos abatement contractor is responsible for verifying reported quantities of ACM.

3.0 ANALYTICAL RESULTS

3.1 Testing Procedures

Sterling Lab analyzed the bulk samples using polarized light microscopy (PLM) method with dispersion staining techniques per USEPA methodology “Method for the Determination of Asbestos in Bulk Building Materials, EPA/600/R-93/116, July 1993”. This is a standard method of analysis in optical mineralogy and the currently accepted method for the determination of asbestos in bulk samples. A suspect material is immersed in a solution of known refractive index and subjected to illumination by polarized light. The characteristic color displays which enable mineral identification. It should be noted that some ACM may not be accurately identified and/or quantified by PLM. The percentage of asbestos applicable was determined by microscopic visual estimation. Sterling analyzed each layer of each sample, which means if multiple layers are detected in the same sample (i.e., roof field), each layer was analyzed, and a separate result was provided for each layer. If any of the sample results from a homogeneous group had a positive result, that homogeneous group was considered to be ACM. Sterling Labs is accredited under the National Voluntary Laboratory Accreditation Program (NVLAP Accreditation Number 101202-0). Refer to **Appendix D** for laboratory accreditations.

3.2 Findings

GSG identified a total of 19 HAs from which 57 samples were collected and analyzed. Results are summarized in **Table 1** and include a description of each material, location, material type, test results, and estimated quantity. Materials indicated to have a “negative” result were confirmed by PLM analysis to be non-asbestos-containing. The laboratory results are provided in **Appendix A** and reference photographs are included in **Appendix B**. The USEPA defines ACM as a material containing greater than 1% asbestos. Materials containing less than 1% asbestos are not regulated by the USEPA or the State of Illinois, but their disturbance is regulated by OSHA.

The laboratory reported that asbestos was Not Detected (ND) in all of the bulk samples collected by GSG.

4.0 RECOMMENDATIONS

GSG understands that the residential property will be demolished as part of the I-80 improvement project. ACMs identified at the site must be removed/managed in accordance with all federal, state, and local regulations governing asbestos. ACMs abatement and management are subject to the US Environmental Protection Agency (USEPA), the Occupational and Health Administration (OSHA), Illinois Department of Public Health (IDPH), the Illinois Environmental Protection Agency (Illinois EPA), and other applicable Federal, State, and Local Government regulations. The following regulations governing asbestos removal and disposal:

1. U.S. Environmental Protection Agency Regional National Emissions Standards for Hazardous Air Pollutants (NESHAP) (40 CFR Part 61 Subpart A and M).
2. U.S. Department of Transportation "Hazardous Substances Final Rule" 49 CFR 171 and 172, November 21, 1986, February 17, 1987.
3. U.S. Department of Labor Occupational Safety and Health Administration (OSHA) Asbestos Regulations (Code of Federal Regulations Title 29, Part 1910, Section 1910.1001 and Part 1926, Section 1926.1101).
4. State of Illinois, Commercial and Public Building Asbestos Abatement Act. Illinois Department of Public Health, Rules for Asbestos Abatement for Public and Private Schools and Commercial and Public Buildings in Illinois (77 IL Admin. Code 855).

All friable asbestos-containing building materials (ACBMs) identified shall be removed from any building(s) or other structures before demolition. Non-friable ACMs may be left in place, unless during demolition, the ACMs may become friable.

Any suspect material that is discovered during the project activities and is not listed in **Table 1**, were not tested during this survey. Such materials shall be assumed and treated as ACM until tested and proven otherwise. If ACM is identified, GSG recommends the preparation of an asbestos abatement project design before any demolition. An asbestos abatement design plan and specifications should include information regarding the location of containments and barriers, type of sealant, and air sampling requirements and clearance during the asbestos abatement activities. The asbestos design plan and specifications shall be prepared and signed by an IDPH licensed asbestos project designer following Illinois regulations. Before starting any abatement activities, an Asbestos Abatement notification is required for all asbestos projects and must be applied for at least ten (10) working days before the start of the project. A building demolition notification is required for all demolition projects and must be applied for at least ten (10) working days before the start of the project.

Abatement and Emergency Response shall be conducted only by IDPH licensed asbestos abatement contractor(s) under the supervision of a licensed asbestos project manager in accordance with all applicable federal, state, and local regulations. Workers who abate or manage asbestos must receive the proper training and licensing. OSHA prescribes required personnel monitoring including air monitoring and medical monitoring (ref 29 CFR 1926.1101). Personnel protective equipment and procedures are also required.

All asbestos waste generated from the required pre-demolition removal activities during the project must be wetted before it is double bagged in 6-millimeter plastic bags and enclosed in a plastic, leak-tight container with a lid and proper labeling. Discharge no visible emissions to the outside air during the collection, processing, packaging, or transporting of any asbestos-containing waste material. Asbestos waste is a "special waste" in

Illinois. Asbestos-containing waste can only be disposed of in Subtitle D landfills that are designated to receive asbestos waste.

5.0 LIMITATIONS


This report has been prepared for the exclusive use of the Illinois Department of Transportation (IDOT) and its Design Section Engineer consultant. GSG warrants that the investigations and methodology reflect our best efforts based upon the prevailing standard of care in the environmental field. This assessment was limited to those materials which were readily visible and with limited demolition and removal of building components. Additional suspect materials may be located behind walls and ceilings. The survey is subject to the following limitations.

- The investigation did not include sampling on any system which may present a hazard to the inspection team such as energized electrical systems or within confined spaces
- Materials associated with electrical components and energized equipment were not safely accessible and were not sampled.
- Estimated quantities of the ACMs are based on observations during the field survey and additional materials may be concealed or were not accessible. Therefore, all estimated quantities shall be field verified by the abatement contractor.

6.0 CERTIFICATION

The undersigned hereby affirm that the conditions described herein are accurate to the best of our knowledge and belief and are subject to the limitations inherent in the investigative techniques used and any expressed limitations of this survey. Applicable licensing to perform the described survey activities was valid at the time of performance of services in accordance with applicable federal, state and local laws, rules, and regulations.

Inspection Performed By:

<u>Tim Walsh</u>	<u>100-08900</u>
Asbestos Inspector's Name	IDPH License Number
<u></u>	<u>8.8.2025</u>
Asbestos Inspector's Signature	Date


EXHIBITS

Exhibit 1

Suspect ACM Sample Location Plans

EXHIBIT 1

**SL-1, SL-2, SL-3, SL-4, and SL-5
Suspect ACM Sample Location Plans**

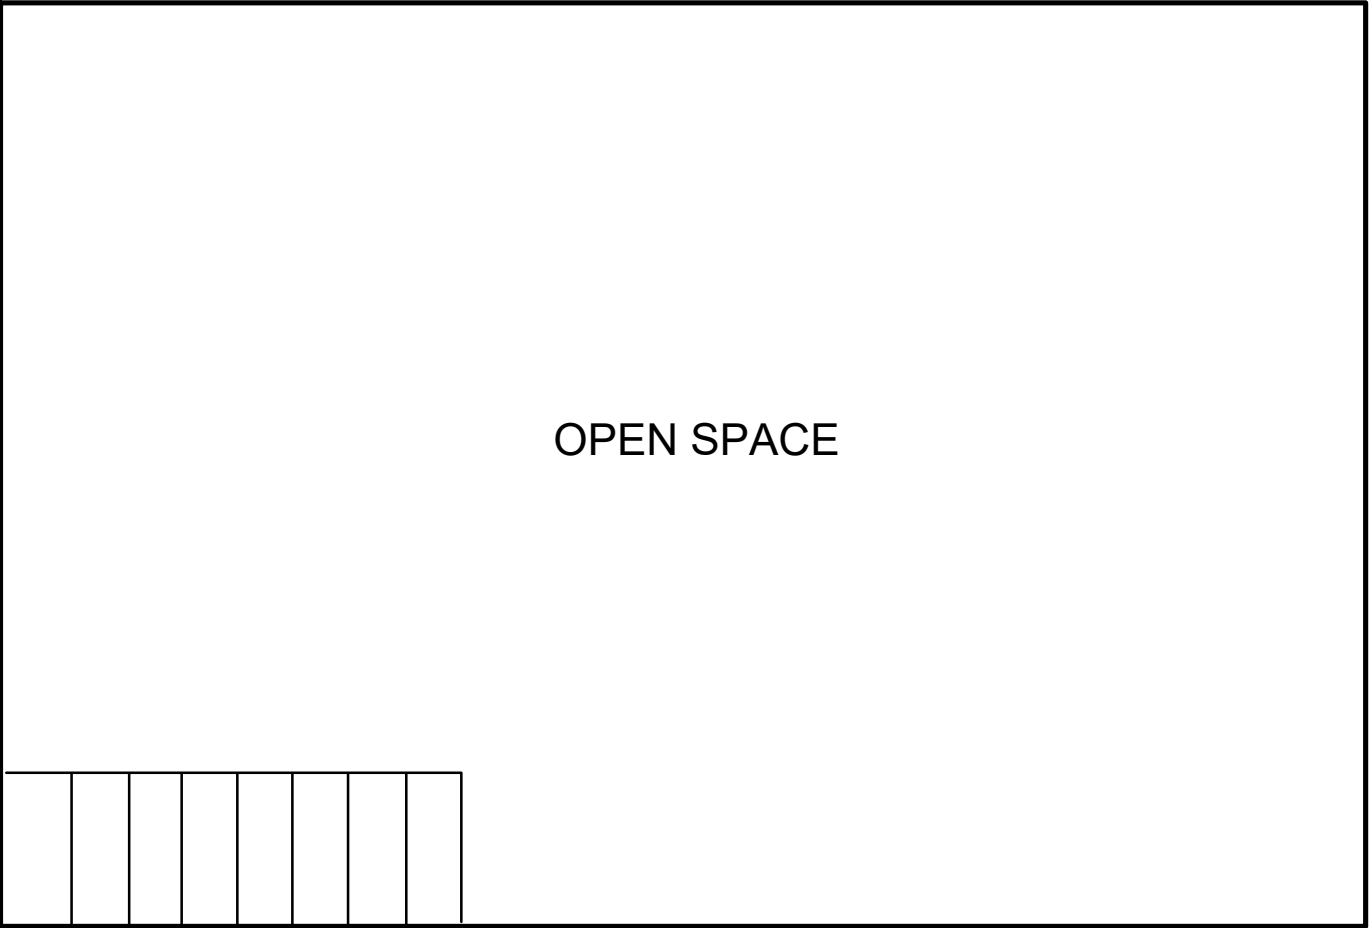

509 ILLINOIS STREET - BASEMENT
SCALE = N.T.S.



*NO SUSPECT ACM WAS SAMPLED IN THE BASEMENT


SUSPECT ASBESTOS-CONTAINING MATERIALS SAMPLE LOCATION PLAN

ASBESTOS SURVEY FOR BUILDING DEMOLITION (I-80)
509 & 511 ILLINOIS STREET
JOLIET, IL 60433

GSG CONSULTANTS, INC.
732 E. BROADWAY, SUITE 200, JOLIET, IL 60433
TEL: 815-741-1111 FAX: 815-741-1112
ILLINOIS PROFESSIONAL DESIGN FIRM 18-000002

DRAWN BY:	PROJECT:
EP	21-2007
CHECKED BY:	SCALE:
TC	NTS
DATE:	SHEET #:
8/6/2025	1 OF 5
SHEET NAME:	

SL-1

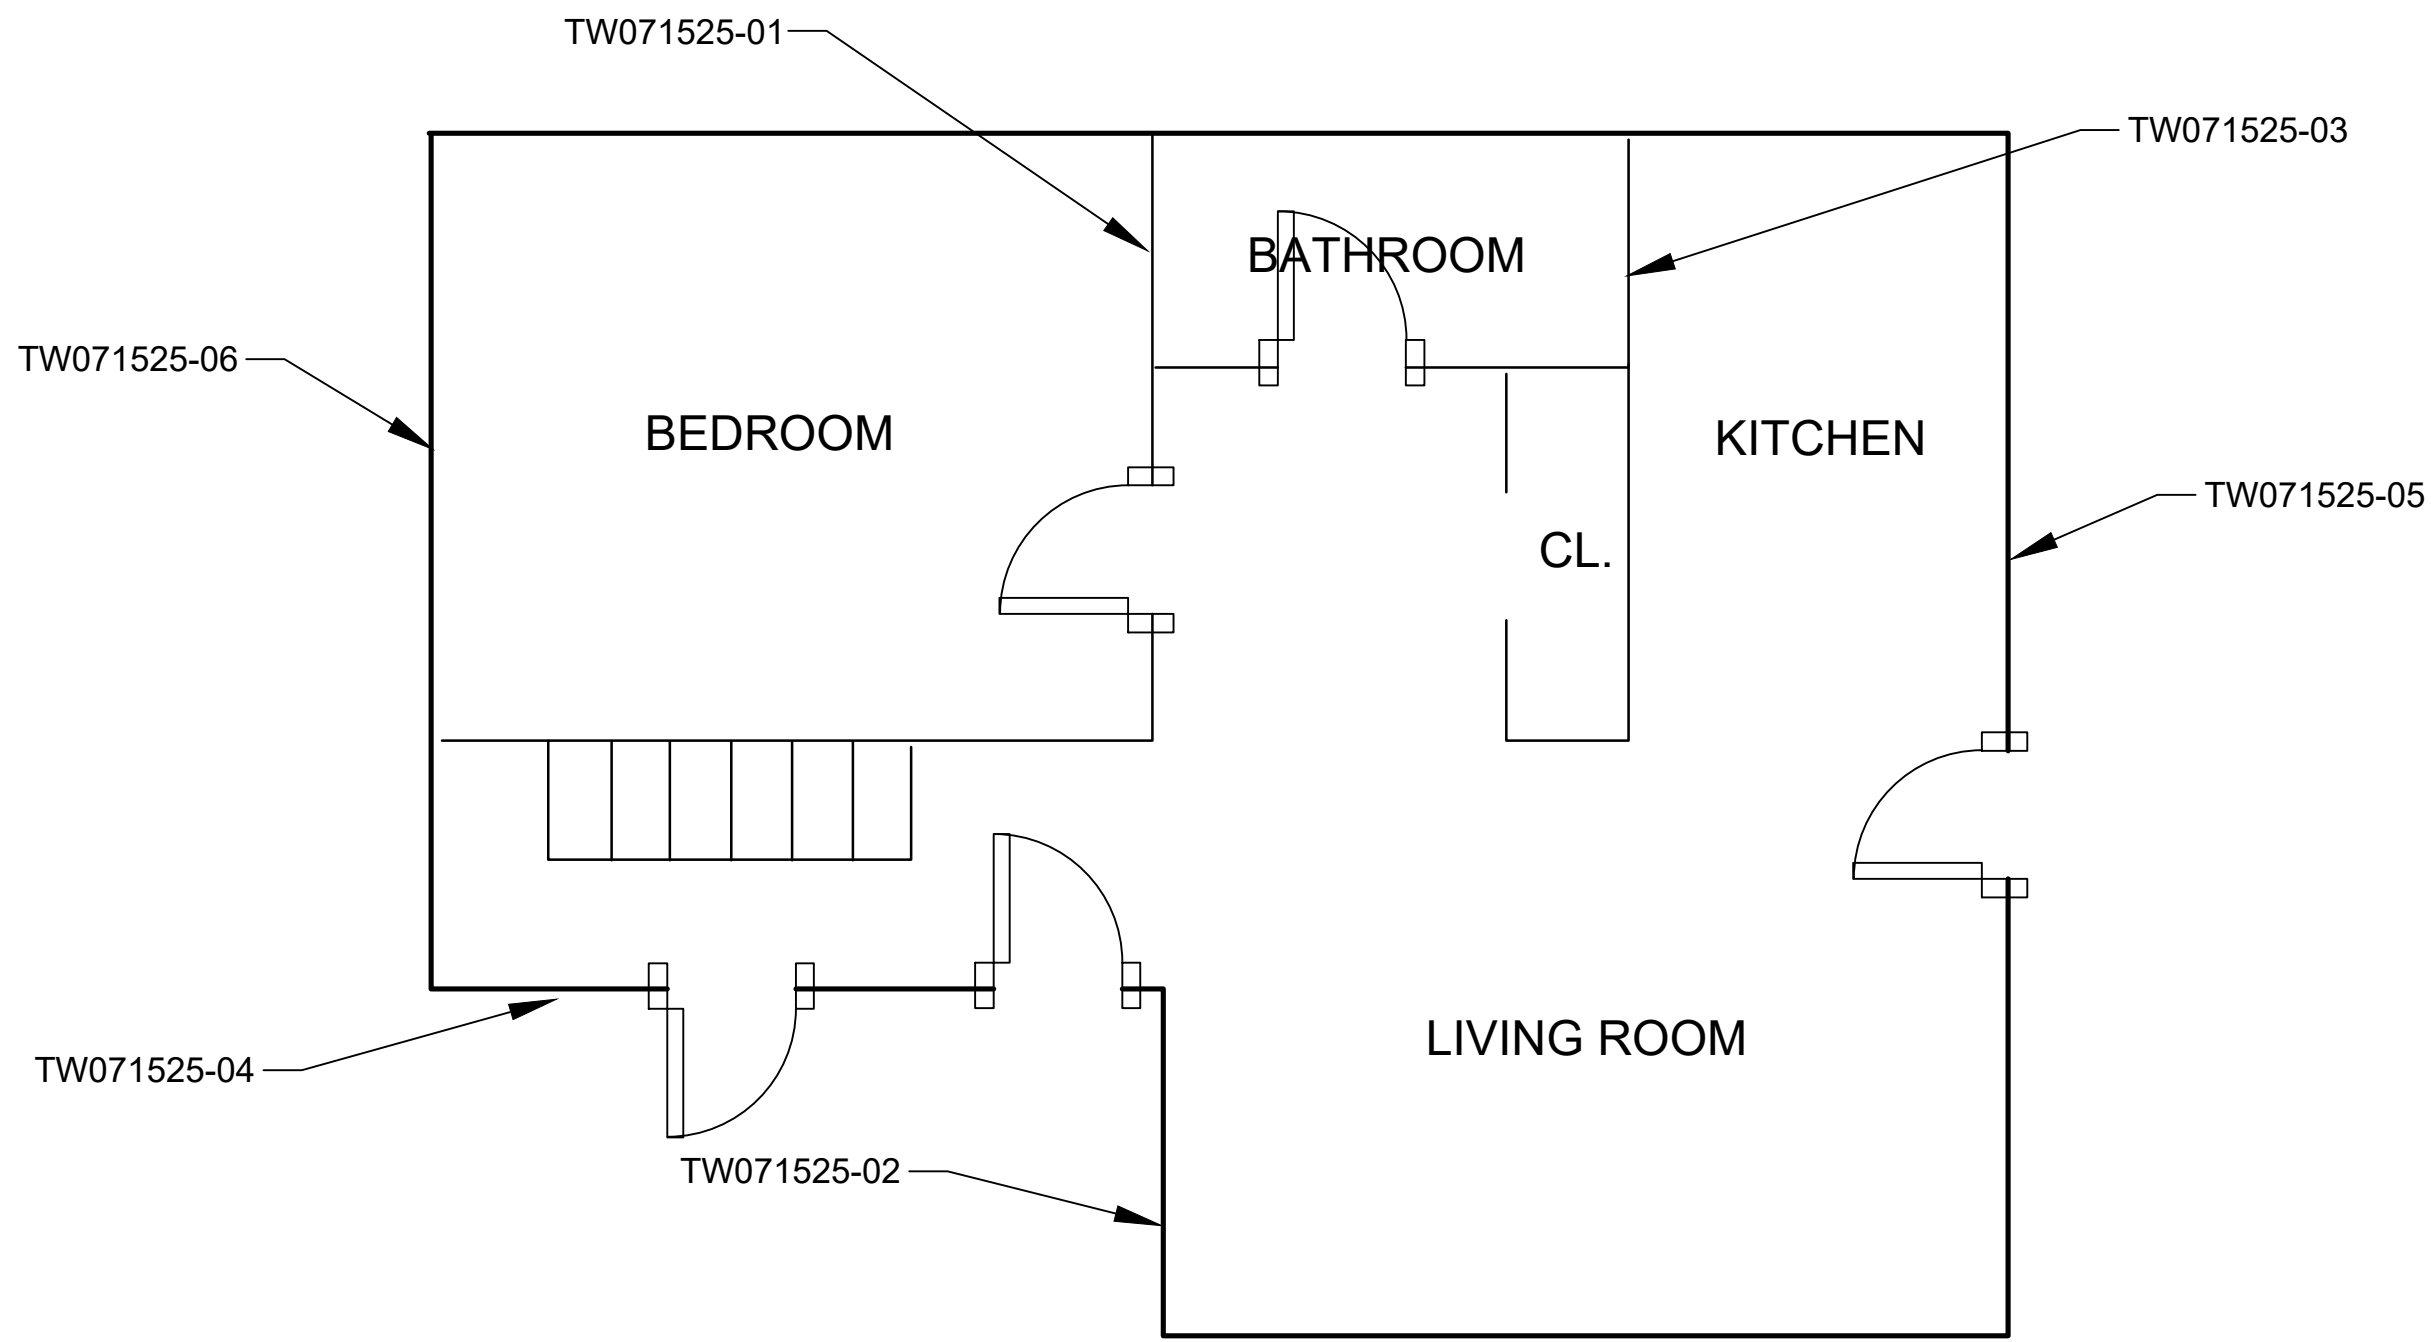

509 ILLINOIS STREET - FIRST FLOOR
SCALE = N.T.S.



LEGEND
SUSPECT ACM SAMPLE LOCATIONS: TW071525-XX
BATCH NUMBER: 375547


SUSPECT ASBESTOS-CONTAINING MATERIALS SAMPLE LOCATION PLAN

ASBESTOS SURVEY FOR BUILDING DEMOLITION (I-80)
509 & 511 ILLINOIS STREET
JOLIET, IL 60433



DRAWN BY:	PROJECT:
EP	21-2007
CHECKED BY:	SCALE:
TC	NTS
DATE:	SHEET #:
8/6/2025	2 OF 5
SHEET NAME:	

SL-2

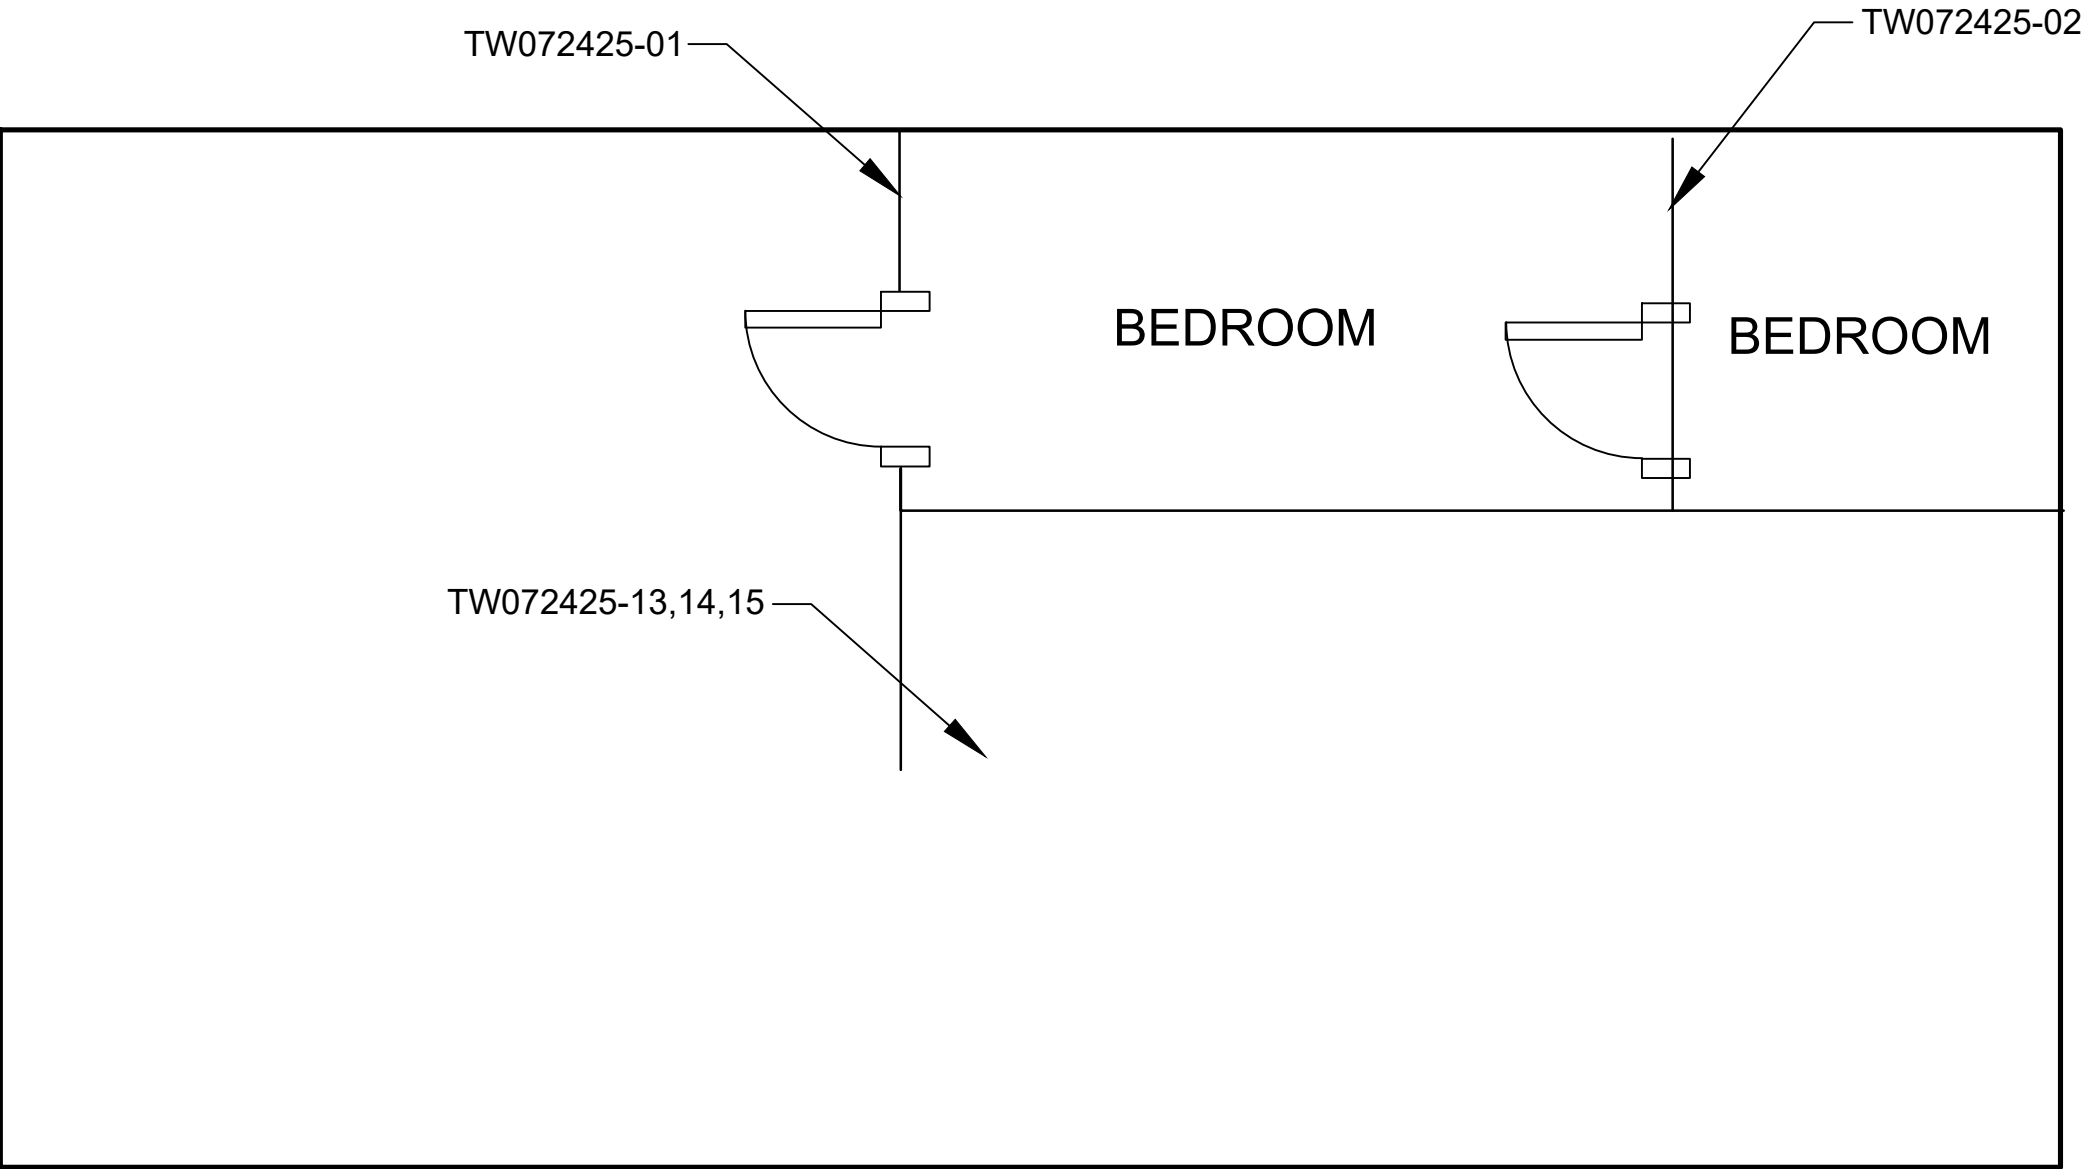

511 ILLINOIS STREET - BASEMENT
SCALE = N.T.S.



LEGEND

SUSPECT ACM SAMPLE LOCATIONS: TW072425-XX
BATCH NUMBER: 375657


SUSPECT ASBESTOS-CONTAINING MATERIALS SAMPLE LOCATION PLAN

ASBESTOS SURVEY FOR BUILDING DEMOLITION (I-80)
509 & 511 ILLINOIS STREET
JOLIET, IL 60433

GSG CONSULTANTS, INC.
742 E. BROADWAY, SUITE 200, JOLIET, IL 60433
TEL: 815-740-1111 FAX: 815-740-1112
ILLINOIS PROFESSIONAL DESIGN FIRM 14-000002

DRAWN BY:	PROJECT:
EP	21-2007
CHECKED BY:	SCALE:
TC	NTS
DATE:	SHEET #:
8/6/2025	3 OF 5
SHEET NAME:	

SL-3

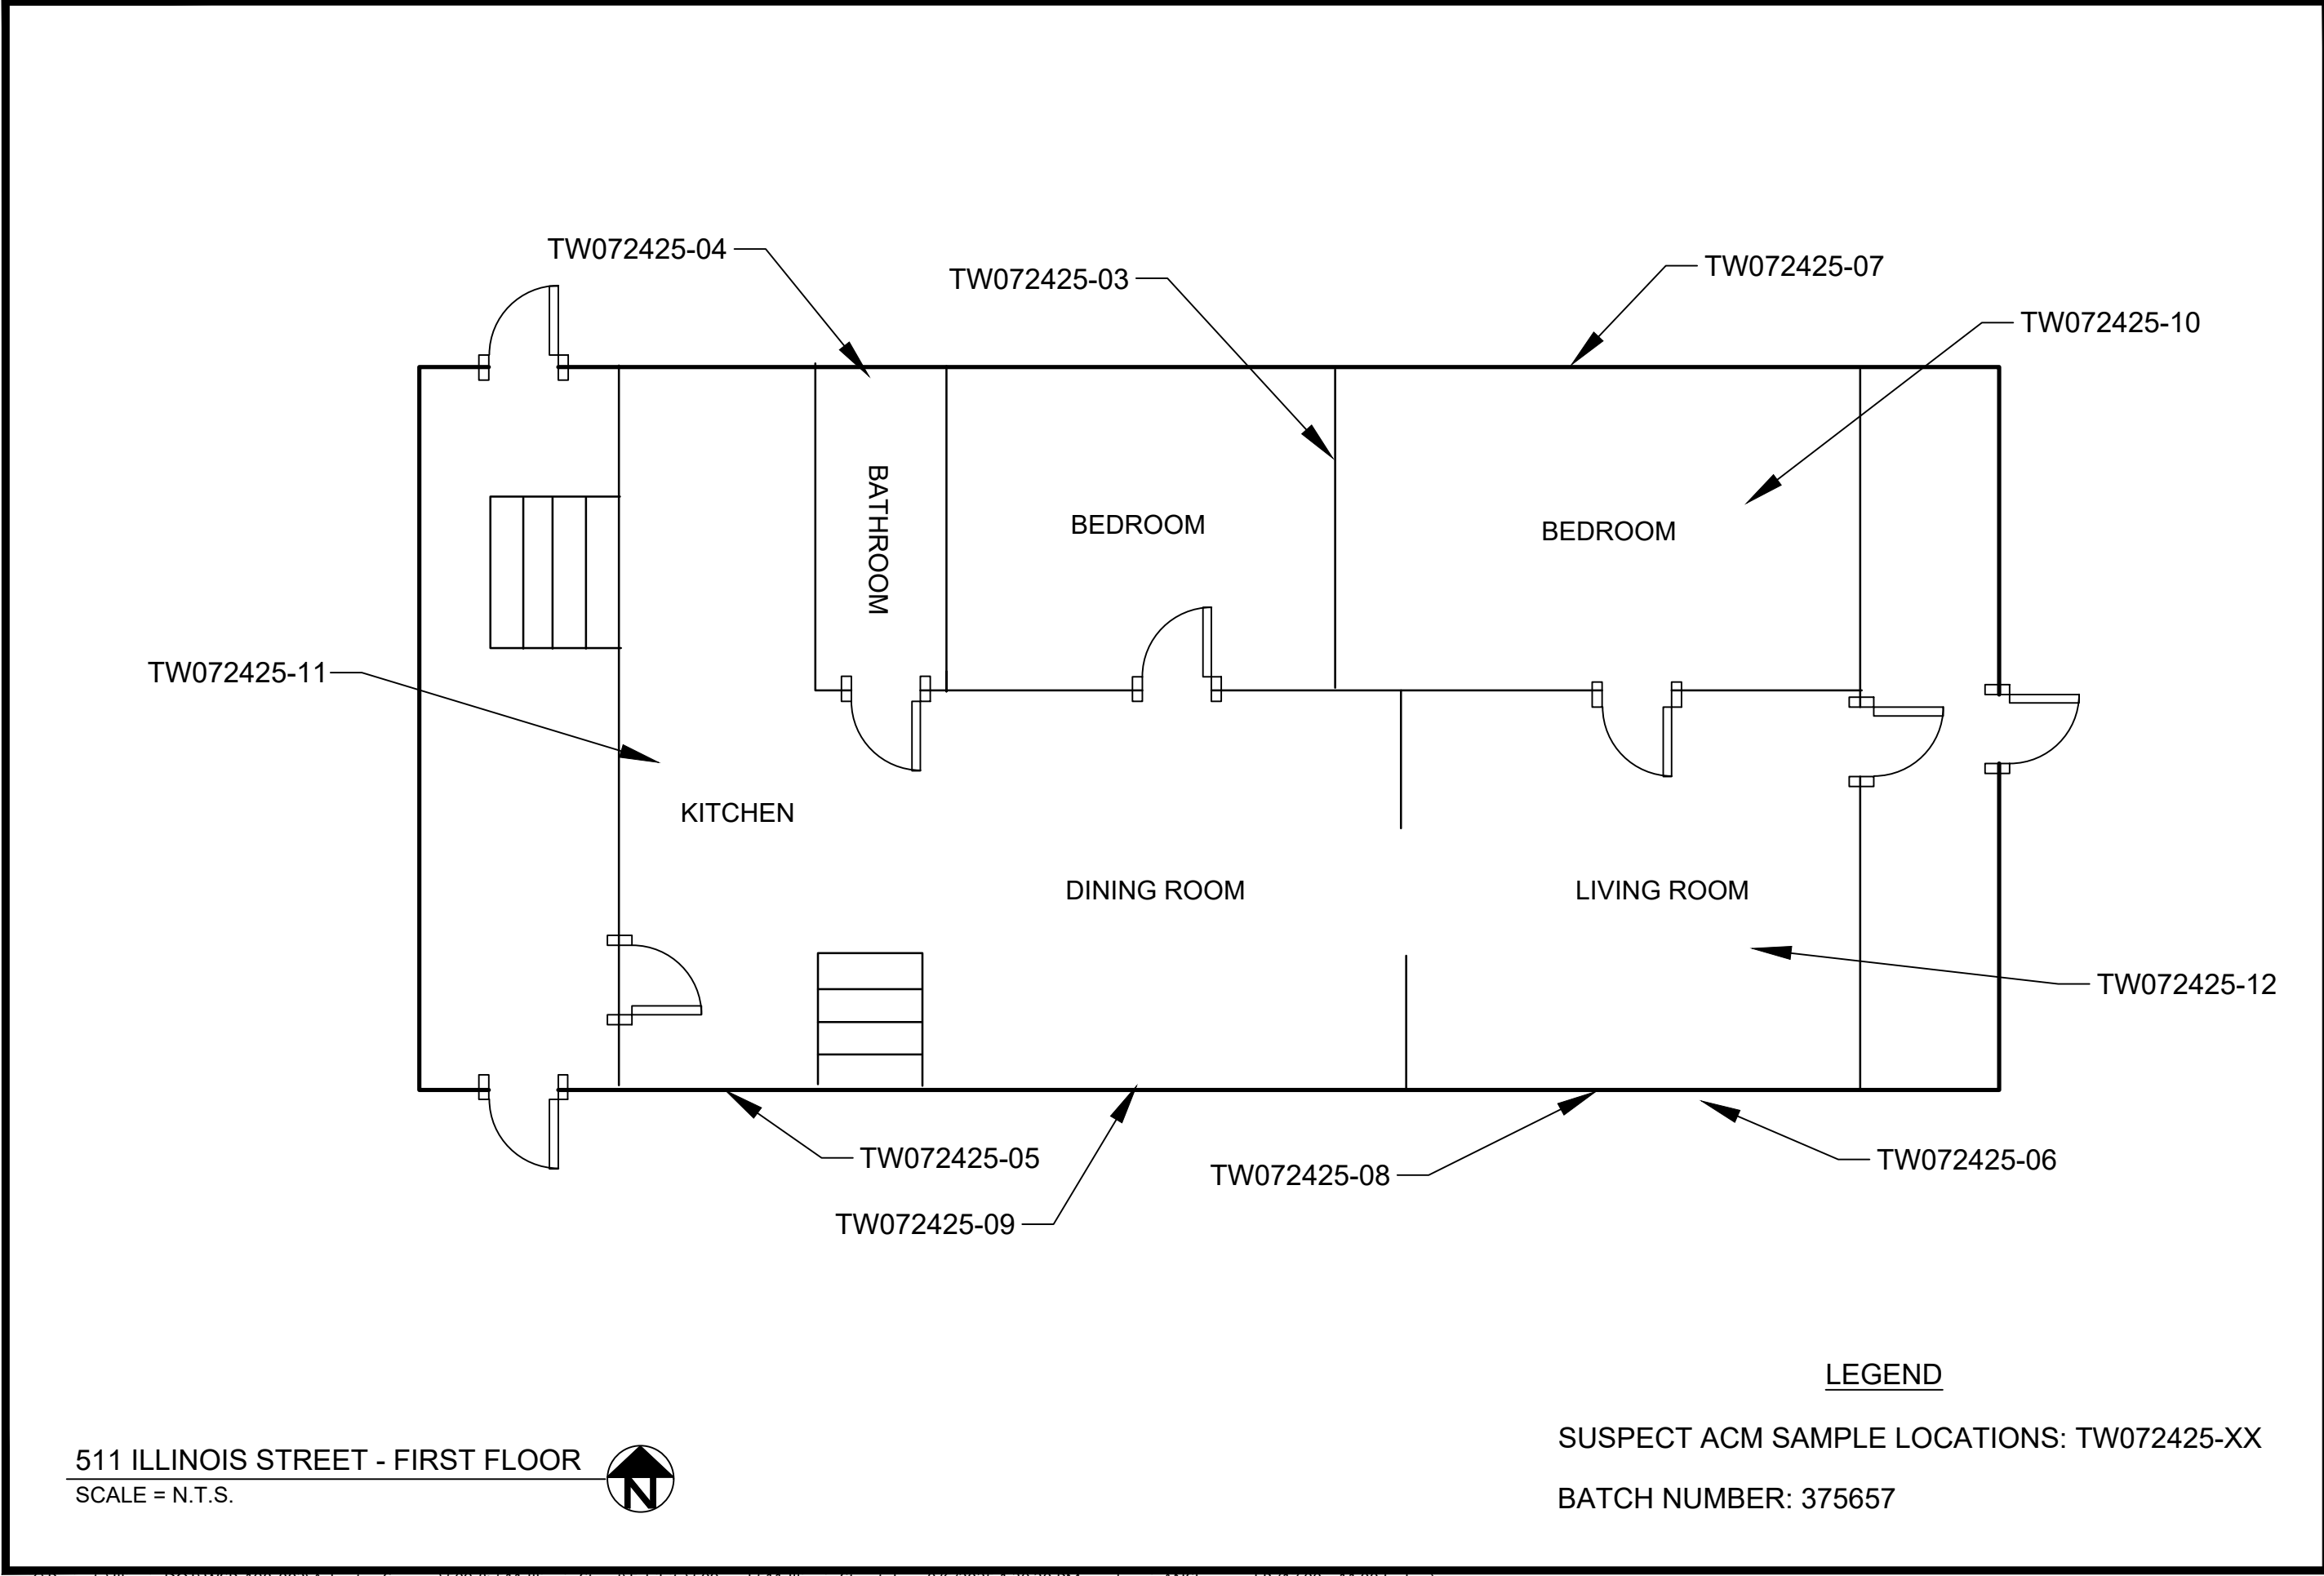


SUSPECT ASBESTOS-CONTAINING MATERIALS SAMPLE LOCATION PLAN

ASBESTOS SURVEY FOR BUILDING DEMOLITION (I-80)
509 & 511 ILLINOIS STREET
JOLIET, IL 60433

GSG CONSULTANTS, INC.
745 E. BROADWAY, SUITE 200, JOLIET, IL 60433
TEL: 815-725-1111 FAX: 815-725-1112
ILLINOIS PROFESSIONAL DESIGN FIRM 18-000002

DRAWN BY:	PROJECT:
EP	21-2007
CHECKED BY:	SCALE:
TC	NTS
DATE:	SHEET #:
8/6/2025	4 OF 5
SHEET NAME:	
SL-4	



SUSPECT ASBESTOS-CONTAINING MATERIALS SAMPLE LOCATION PLAN

ASBESTOS SURVEY FOR BUILDING DEMOLITION (I-80)
509 & 511 ILLINOIS STREET
JOLIET, IL, 60433

GSG CONSULTANTS, INC.
1825 E. RICHMOND AVE., SUITE 200, JOLIET, IL 60433
TEL: 815/741-1111 FAX: 815/741-1112
ILLINOIS PROFESSIONAL DESIGN FIRM 18-0000002



DRAWN BY:	PROJECT:
EP	21-2007
CHECKED BY:	SCALE:
TC	NTS
DATE:	SHEET #:
8/6/2025	5 OF 5

SHEET NAME:

SL-5

LEGEND

SUSPECT ACM SAMPLE LOCATIONS: TW071525-XX, TW072425-XX
BATCH NUMBER: 375547, 375657

APPENDIX A

Analytical Testing Results

ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.
 735 Remington Road
 Schaumburg, IL 60173
 Phone: (630) 994-2600
 Fax: (312) 733-5612

Reference:

Location: 509 Illinois
 Batch No.: 375547
 Customer No.: 4651

Date Received: 07/17/2025

Date Analyzed: 07/23/2025

Date Reported: 07/23/2025

Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375547001	TW071525-1	ND	Cellulose 10-15% Binder 85-90%
375547002	TW071525-2	ND	Cellulose 10-15% Binder 85-90%
375547003	TW071525-3	ND	Cellulose 10-15% Binder 85-90%
375547004	TW071525-4	ND	Cellulose 1-5% Binder 95-99%
375547005	TW071525-5	ND	Cellulose 1-5% Binder 95-99%
375547006	TW071525-6	ND	Cellulose 1-5% Binder 95-99%
375547007	TW071525-7Black	ND	Binder 85-90% Glass 10-15%
375547008	TW071525-8Black	ND	Binder 85-90% Glass 10-15%
375547009	TW071525-9Black	ND	Binder 85-90% Glass 10-15%
375547010	TW071525-7Gray	ND	Binder 85-90% Glass 10-15%


ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :


 Daniel Mikos / Microscopist

Date: 07/23/2025

ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.
 735 Remington Road
 Schaumburg, IL 60173
 Phone: (630) 994-2600
 Fax: (312) 733-5612

Reference:

Location: 509 Illinois
 Batch No.: 375547
 Customer No.: 4651

Date Received: 07/17/2025

Date Analyzed: 07/23/2025

Date Reported: 07/23/2025

Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375547011	TW071525-8Gray	ND	Binder 85-90% Glass 10-15%
375547012	TW071525-9Gray	ND	Binder 85-90% Glass 10-15%
375547013	TW071525-7Brown	ND	Binder 85-90% Glass 10-15%
375547014	TW071525-8Brown	ND	Binder 85-90% Glass 10-15%
375547015	TW071525-9Brown	ND	Binder 85-90% Glass 10-15%
375547016	TW071525-7Black/Brown	ND	Binder 85-90% Glass 10-15%
375547017	TW071525-8Black/Brown	ND	Binder 85-90% Glass 10-15%
375547018	TW071525-9Black/Brown	ND	Binder 85-90% Glass 10-15%
375547019	TW071525-7Black/Gray	ND	Binder 85-90% Glass 10-15%
375547020	TW071525-8Black/Gray	ND	Binder 85-90% Glass 10-15%


ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :



Daniel Mikos / Microscopist

Date: 07/23/2025

ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.
 735 Remington Road
 Schaumburg, IL 60173
 Phone: (630) 994-2600
 Fax: (312) 733-5612

Reference: Date Received: 07/17/2025
 Location: 509 Illinois Date Analyzed: 07/23/2025
 Batch No.: 375547 Date Reported: 07/23/2025
 Customer No.: 4651 Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375547021	TW071525-9Black/Gray	ND	Binder 85-90% Glass 10-15%
375547022	TW071525-10	ND	Cellulose 1-5% Binder 95-99%
375547023	TW071525-11	ND	Cellulose 1-5% Binder 95-99%
375547024	TW071525-12	ND	Cellulose 1-5% Binder 95-99%
375547025	TW071525-13	ND	Binder 85-90% Glass 10-15%
375547026	TW071525-14	ND	Binder 85-90% Glass 10-15%
375547027	TW071525-15	ND	Binder 85-90% Glass 10-15%
375547028	TW071525-16	ND	Cellulose 1-5% Binder 95-99%
375547029	TW071525-17	ND	Cellulose 1-5% Binder 95-99%
375547030	TW071525-18	ND	Cellulose 1-5% Binder 95-99%

ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :



ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.
735 Remington Road
Schaumburg, IL 60173
Phone: (630) 994-2600
Fax: (312) 733-5612

Reference: Date Received: 07/17/2025
Location: 509 Illinois Date Analyzed: 07/23/2025
Batch No.: 375547 Date Reported: 07/23/2025
Customer No.: 4651 Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375547031	TW071525-19	ND	Cellulose 1-5% Binder 95-99%
375547032	TW071525-20	ND	Cellulose 1-5% Binder 95-99%
375547033	TW071525-21	ND	Cellulose 1-5% Binder 95-99%
375547034	TW071525-22	ND	Cellulose 10-15% Binder 85-90%
375547035	TW071525-23	ND	Cellulose 10-15% Binder 85-90%
375547036	TW071525-24	ND	Cellulose 10-15% Binder 85-90%
375547037	TW071525-25Black	ND	Cellulose 10-15% Binder 85-90%
375547038	TW071525-26Black	ND	Cellulose 10-15% Binder 85-90%
375547039	TW071525-27Black	ND	Cellulose 10-15% Binder 85-90%
375547040	TW071525-25Gray	ND	Cellulose 10-15% Binder 85-90%


ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :



ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.

735 Remington Road

Schaumburg, IL 60173

Phone: (630) 994-2600

Fax: (312) 733-5612

Reference:

Location: 509 Illinois

Batch No.: 375547

Customer No.: 4651

Date Received: 07/17/2025

Date Analyzed: 07/23/2025

Date Reported: 07/23/2025

Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375547041	TW071525-26Gray	ND	Cellulose 10-15% Binder 85-90%
375547042	TW071525-27Gray	ND	Cellulose 10-15% Binder 85-90%
375547043	TW071525-25Green	ND	Cellulose 10-15% Binder 85-90%
375547044	TW071525-26Green	ND	Cellulose 10-15% Binder 85-90%
375547045	TW071525-27Green	ND	Cellulose 10-15% Binder 85-90%
375547046	TW071525-25Green/White	ND	Cellulose 10-15% Binder 85-90%
375547047	TW071525-26Green/White	ND	Cellulose 10-15% Binder 85-90%
375547048	TW071525-27Green/White	ND	Cellulose 10-15% Binder 85-90%
375547049	TW071525-25Brown/Black	ND	Binder 85-90% Glass 10-15%
375547050	TW071525-26Brown/White	ND	Binder 85-90% Glass 10-15%

ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :


 Daniel Mikos / Microscopist

Date: 07/23/2025

ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.
 735 Remington Road
 Schaumburg, IL 60173
 Phone: (630) 994-2600
 Fax: (312) 733-5612

Reference:		Date Received: 07/17/2025
Location:	509 Illinois	Date Analyzed: 07/23/2025
Batch No.:	375547	Date Reported: 07/23/2025
Customer No.:	4651	Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375547051	TW071525-27Brown/White	ND	Binder 85-90% Glass 10-15%
375547052	TW071525-25Brown	ND	Binder 85-90% Glass 10-15%
375547053	TW071525-26Brown	ND	Binder 85-90% Glass 10-15%
375547054	TW071525-27Brown	ND	Binder 85-90% Glass 10-15%
375547055	TW071525-28	ND	Cellulose 80-85% Binder 15-20%
375547056	TW071525-29	ND	Cellulose 80-85% Binder 15-20%
375547057	TW071525-30	ND	Cellulose 80-85% Binder 15-20%
375547058	TW071525-28Adhesive	ND	Cellulose 1-5% Binder 95-99%
375547059	TW071525-29Adhesive	ND	Cellulose 1-5% Binder 95-99%
375547060	TW071525-30Adhesive	ND	Cellulose 1-5% Binder 95-99%

ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :





GSG CONSULTANTS, INC.

Engineering and Industrial Hygiene Services

735 Remington Road

Schaumburg, IL 60173

(630) 994-2600 Fax: (312) 733-5612

www.gsg-consultants.com

Page 1 of 2

375547

PLM BULK LABORATORY ANALYSIS FORM

Project Name:		Project Manager:	
Project Number:		Building Inspector:	
Project Address: 509 Illinois		IDPH Number:	
City/ State:		Work Day: S M T W TH F S	
Client:		Analyze by Method:	
Date: 7/15/25		EPA/600/R-93-116	

Field Number	HA Number	Type of material, specific sample location (i.e. Room Number, Building Construction Date)
1	HA-1	Drywall System
2		
3		
4	HA-2	Interior Window Caulk
5		
6		
7	HA-3	Roofing Material - 5 layers
8		House
9		
10	HA-4	Chimney Brick
11		
12		
13	HA-5	Chimney Flashing
14		
15		

TURN AROUND TIME:	1 Day 2 Days 3 Days (5 Day) Other	COMMENTS: E-mail Results to: twalsh@gsg-consultants.com epahomi@gsg-consultants.com STOP AT FIRST POSITIVE
-------------------	--	--

CHAIN OF CUSTODY RECORD

Collected By (Signature): <i>[Signature]</i>	Date: 7/15/25	Time:	Relinquished by (Signature): <i>[Signature]</i>	Date: 7/16/25	Time:
Received by: (Signature)	Date:	Time:	Relinquished by: (signature)	Date:	Time:
Dispatched by: (Signature, if mailed)	Date:	Time:	Received for Laboratory by: <i>[Signature]</i>	Date: 7/16/25	Time: 15:53

Definitions: BLK-Bulk Sample, PLM-Polarized Light Microscopy, TEM-Transmission Electron Microscope.



GSG CONSULTANTS, INC.

Engineering and Industrial Hygiene Services

735 Remington Road

Schaumburg, IL 60173

(630) 994-2600 Fax: (312) 733-5612

www.gsg-consultants.com

Page 2 of 2

375547

PLM BULK LABORATORY ANALYSIS FORM

Project Name:		Project Manager:	
Project Number:		Building Inspector:	
Project Address: 509 Illinois		IDPH Number:	
City/ State:		Work Day: S M T W TH F S	
Client:		Analyze by Method:	
Date: 7/15/25		EPA/600/R-93-116	

Field Number	HA Number	Type of material, specific sample location (i.e. Room Number, Building Construction Date)
TR071525-16	HA-6	Exterior Door Caulk
17	↓	↓
18	↓	↓
19	HA-7	Exterior Window Caulk
20	↓	↓
21	↓	↓
22	HA-8	Exterior Siding
23	↓	↓
24	↓	↓
25	HA-9	Garage Roofing Material - 6 layers
26	↓	↓
27	↓	↓
28	HA-10	1x1 Ceiling Tile / Adhesive garage
29	↓	↓
30	↓	↓

TURN AROUND TIME: 1 Day 2 Days 3 Days (5 Day) Other	COMMENTS: E-mail Results to: twalsh@gsg-consultants.com epahomi@gsg-consultants.com STOP AT FIRST POSITIVE
--	--

CHAIN OF CUSTODY RECORD

Collected By (Signature): <i>[Signature]</i>	Date: 7/15/25	Time:	Relinquished by (Signature): <i>[Signature]</i>	Date: 7/16/25	Time:
Received by: (Signature)	Date:	Time:	Relinquished by: (signature)	Date:	Time:
Dispatched by: (Signature, if mailed)	Date:	Time:	Received for Laboratory by: <i>[Signature]</i>	Date: 7/16/25	Time: 15:53

Definitions: BLK-Bulk Sample, PLM-Polarized Light Microscopy, TEM-Transmission Electron Microscope.

ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.

735 Remington Road

Schaumburg, IL 60173

Phone: (630) 994-2600

Fax: (312) 733-5612

Reference:

Location: 511 Illinois

Batch No.: 375657

Customer No.: 4651

Date Received: 07/28/2025

Date Analyzed: 08/01/2025

Date Reported: 08/01/2025

Turn Around Time: 5 Days


Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375657001	TW072425-1	ND	Cellulose 5-10% Binder 90-95%
375657002	TW072425-2	ND	Cellulose 5-10% Binder 90-95%
375657003	TW072425-3	ND	Cellulose 5-10% Binder 90-95%
375657004	TW072425-4	ND	Cellulose 1-5% Binder 95-99%
375657005	TW072425-5	ND	Cellulose 1-5% Binder 95-99%
375657006	TW072425-6	ND	Cellulose 1-5% Binder 95-99%
375657007	TW072425-7	ND	Cellulose 1-5% Binder 95-99%
375657008	TW072425-8	ND	Cellulose 1-5% Binder 95-99%
375657009	TW072425-9	ND	Cellulose 1-5% Binder 95-99%
375657010	TW072425-10	ND	Cellulose 1-5% Binder 95-99%

ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name : 

ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.
735 Remington Road
Schaumburg, IL 60173
Phone: (630) 994-2600
Fax: (312) 733-5612

Reference:

Location: 511 Illinois
Batch No.: 375657
Customer No.: 4651

Date Received: 07/28/2025
Date Analyzed: 08/01/2025
Date Reported: 08/01/2025
Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375657011	TW072425-11	ND	Cellulose 1-5% Binder 95-99%
375657012	TW072425-12	ND	Cellulose 1-5% Binder 95-99%
375657013	TW072425-13	ND	Cellulose 1-5% Binder 95-99%
375657014	TW072425-14	ND	Cellulose 1-5% Binder 95-99%
375657015	TW072425-15	ND	Cellulose 1-5% Binder 95-99%
375657016	TW072425-16	ND	Cellulose 10-15% Binder 85-90%
375657017	TW072425-17	ND	Cellulose 10-15% Binder 85-90%
375657018	TW072425-18	ND	Cellulose 10-15% Binder 85-90%
375657019	TW072425-19	ND	Binder 99-100%
375657020	TW072425-20	ND	Binder 99-100%
375657021	TW072425-21	ND	Binder 99-100%
375657022	TW072425-22	ND	Binder 99-100%

ND = Asbestos Not Detected (Not Present) NA = Not Analyzed NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :

Zineb Nasri / Microscopist

ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY

Method: EPA/600/R-93/116

GSG Consultants, Inc.
735 Remington Road
Schaumburg, IL 60173
Phone: (630) 994-2600
Fax: (312) 733-5612

Reference:

Location: 511 Illinois
Batch No.: 375657
Customer No.: 4651

Date Received: 07/28/2025

Date Analyzed: 08/01/2025

Date Reported: 08/01/2025

Turn Around Time: 5 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
375657023	TW072425-23	ND	Binder 99-100%
375657024	TW072425-24	ND	Binder 99-100%
375657025	TW072425-25	ND	Binder 85-90% Glass 10-15%
375657026	TW072425-26	ND	Binder 85-90% Glass 10-15%
375657027	TW072425-27	ND	Binder 85-90% Glass 10-15%

ND = Asbestos Not Detected (Not Present)

NA = Not Analyzed

NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).

Analyzed by Name :

Zineb Nasri / Microscopist



GSG CONSULTANTS, INC.

Engineering and Industrial Hygiene Services

735 Remington Road

Schaumburg, IL 60173

(630) 994-2600 Fax: (312) 733-5612

www.gsg-consultants.com

MP 7/25/25

Page 2 of

~~375656~~ 375657

PLM BULK LABORATORY ANALYSIS FORM

Project Name:		Project Manager:	
Project Number:		Building Inspector:	
Project Address: 511 Illinois		IDPH Number:	
City/ State:		Work Day: S M T W TH F S	
Client:		Analyze by Method:	
Date: 7/24/25		EPA/600/R-93-116	

Field Number	HA Number	Type of material, specific sample location (i.e. Room Number, Building Construction Date)
2072425-1	HA-1	Drywall System
2	↓	↓
3	↓	↓
4	HA-2	Plaster
5	↓	↓
6	↓	↓
7	HA-3	Interior Window Caulk
8	↓	↓
9	↓	↓
10	HA-4	Textured Ceiling - Throughout
11	↓	↓
12	↓	↓
13	HA-5	Chimney Brick
14	↓	↓
15	↓	↓

TURN AROUND TIME: 1 Day 2 Days 3 Days (5 Day) Other	COMMENTS: E-mail Results to: twalsh@gsg-consultants.com epahomi@gsg-consultants.com STOP AT FIRST POSITIVE
--	---

CHAIN OF CUSTODY RECORD

Collected By (Signature) <i>[Signature]</i>	Date: 7/24/25	Time:	Relinquished by (Signature) <i>[Signature]</i>	Date: 7/25/25	Time:
Received by: (Signature)	Date:	Time:	Relinquished by: (signature)	Date:	Time:
Dispatched by: (Signature, if mailed)	Date:	Time:	Received for Laboratory by: <i>[Signature]</i>	Date: 7/25/25	Time: 16:00

Definitions: BLK-Bulk Sample, PLM-Polarized Light Microscopy, TEM-Transmission Electron Microscope.



GSG CONSULTANTS, INC.

Engineering and Industrial Hygiene Services

735 Remington Road
Schaumburg, IL 60173

(630) 994-2600 Fax: (312) 733-5612

www.gsg-consultants.com

MP 7/25/25

Page 1 of 1

~~375656~~ 375657

PLM BULK LABORATORY ANALYSIS FORM

Project Name:		Project Manager:	
Project Number:		Building Inspector:	
Project Address: 511 Illinois		IDPH Number:	
City/ State:		Work Day: S M T W TH F S	
Client:		Analyze by Method:	
Date: 7/24/25		EPA/600/R-93-116	

Field Number	HA Number	Type of material, specific sample location (i.e. Room Number, Building Construction Date)
72072425-16	HA-6	Exterior Siding
17	↓	↓
18	↓	↓
19	HA-7	Exterior Window Caulk
20	↓	↓
21	↓	↓
22	HA-8	Exterior Door Caulk
23	↓	↓
24	↓	↓
25	HA-9	Roofing Material
26	↓	4 Layers
27	↓	↓
		Fiberglass Attic Insulation
		Assume Chimney Flashing

TURN AROUND TIME:	1 Day 2 Days 3 Days (5 Day) Other	<p>COMMENTS: E-mail Results to: twalsh@gsg-consultants.com epahomi@gsg-consultants.com</p> <p>STOP AT FIRST POSITIVE</p>
-------------------	--	---

CHAIN OF CUSTODY RECORD

Collected By (Signature)	Date: 7/24/25	Time:	Relinquished by (Signature)	Date: 7/25/25	Time:
Received by: (Signature)	Date:	Time:	Relinquished by: (signature)	Date:	Time:
Dispatched by: (Signature, if mailed)	Date:	Time:	Received for Laboratory by:	Date: 7/25/25	Time: 16:00

Definitions: BLK-Bulk Sample, PLM-Polarized Light Microscopy, TEM-Transmission Electron Microscope.

APPENDIX B

Reference Photographs



Material Description:
Suspect ACM Door Caulking

Photo Location:
Exterior - 509 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025



Material Description:
Suspect ACM Siding

Photo Location:
Exterior - 509 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025



Material Description:
Suspect ACM Window Caulk


Photo Location:
Exterior - 509 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025

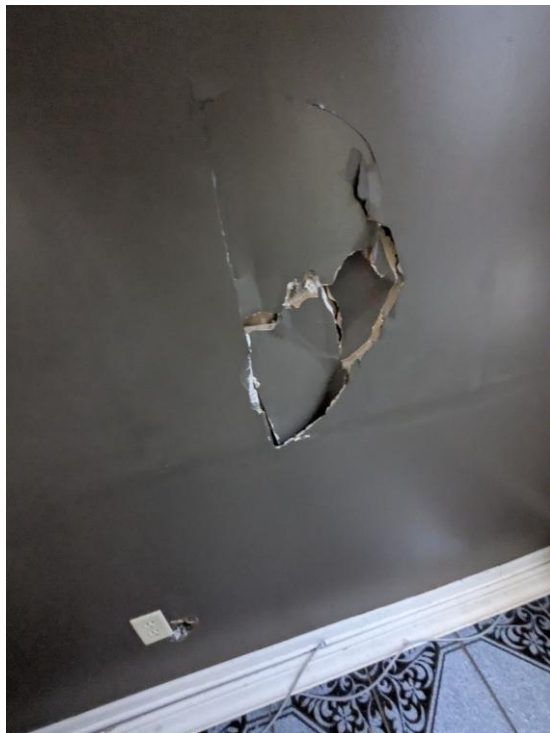

Material Description:
Suspect ACM Drywall

Photo Location:
Kitchen - 509 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025



Material Description:
Suspect ACM Interior
Window Caulk

Photo Location:
Living Room - 509 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025



Material Description:
Suspect ACM House Roofing
Material

Photo Location:
House Roof - 509 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025



Material Description:
Suspect ACM Chimney Brick
& Flashing


Photo Location:
House Roof - 509 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025

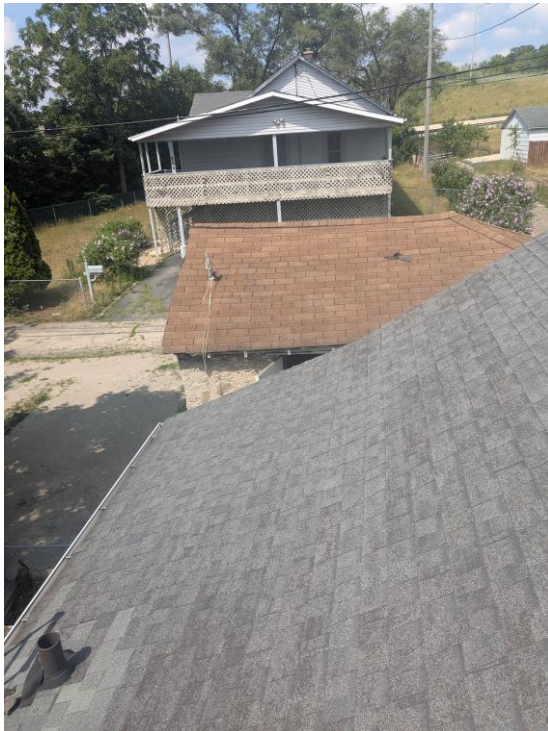

Material Description:
Suspect ACM Garage Roof

Photo Location:
Garage Roof - 509 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025



Material Description:
Suspect ACM 12"x12"
Ceiling Tile & Adhesive

Photo Location:
Garage - 509 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/15/2025



Material Description:
Suspect ACM Chimney Brick

Photo Location:
House Roof

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

511 Illinois St.

Date: 7/24/2025



Material Description:
Suspect ACM Roofing
Material

Photo Location:
House Roof - 511 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Drywall

Photo Location:
Living Room - 511 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Plaster

Photo Location:
Bedroom - 511 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Interior
Window Caulk

Photo Location:
Bedroom - 511 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Textured
Ceiling


Photo Location:
Bedroom - 511 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025

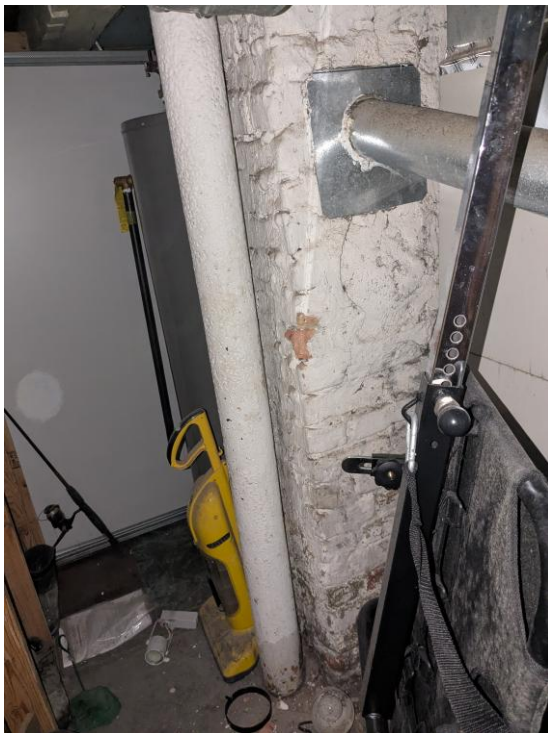

Material Description:
Suspect ACM Chimney Brick

Photo Location:
Basement - 511 Illinois
Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Siding

Photo Location:
Exterior - 511 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Exterior
Window Caulk

Photo Location:
Exterior - 511 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Exterior Door
Caulk

Photo Location:
Exterior - 511 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025



Material Description:
Suspect ACM Roof &
Chimney Overview

Photo Location:
Exterior - 511 Illinois Street

**ILLINOIS DEPARTMENT OF
TRANSPORTATION
I-80 OVER DES PLAINES RIVER BRIDGE
IMPROVEMENTS**



GSG Consultants, Inc.
735 Remington Road
Schaumburg, Illinois 60173

Date: 7/24/2025

APPENDIX C

Inspector Licenses and Training Certifications



525-535 West Jefferson Street • Springfield, Illinois 62761-0001 • www.dph.illinois.gov

TIMOTHY WALSH
15237 LAPORTE AVE
OAK FOREST, IL 60452



4/22/2025

ASBESTOS PROFESSIONAL LICENSE ID NUMBER: 08900

Enclosed is your Asbestos Professional License. Please note the expiration date on the card and in the image depicted below.

COPY OF THE ASBESTOS PROFESSIONAL LICENSE

Front of License

		
ASBESTOS PROFESSIONAL LICENSE		
ID NUMBER	ISSUED	EXPIRES
100 - 08900	4/22/2025	05/15/2026
TIMOTHY WALSH 15237 LAPORTE AVE OAK FOREST, IL 60452 Environmental Health		

Back of License

ENDORSEMENTS	TC EXPIRES
INSPECTOR	1/18/2026
PROJECT MANAGER	10/2/2025
AIR SAMPLING PROFESSIONAL	
Alteration of this license shall result in legal action This license issued under authority of the State of Illinois Department of Public Health This license is valid only when accompanied by a valid training course certificate.	

If you have any questions or need further assistance, contact the Asbestos Program at (217)782-3517 or fax (217)785-5897.

Our WEB address is: dph.illinois.gov/topics-services/environmental-health-protection/asbestos
EMAIL Address: dph.asbestos@illinois.gov

APPENDIX D

Laboratory Accreditations

United States Department of Commerce
National Institute of Standards and Technology



Certificate of Accreditation to ISO/IEC 17025:2017

NVLAP LAB CODE: 101202-0

STAT Analysis Corporation
Chicago, IL


*is accredited by the National Voluntary Laboratory Accreditation Program for specific services,
listed on the Scope of Accreditation, for:*

Asbestos Fiber Analysis

*This laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2017.
This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality
management system (refer to joint ISO-ILAC-IAF Communique on ISO/IEC 17025).*

2025-07-01 through 2026-06-30
Effective Dates




For the National Voluntary Laboratory Accreditation Program

SCOPE OF ACCREDITATION TO ISO/IEC 17025:2017

STAT Analysis Corporation

Sterling Labs
2242 W. Harrison Suite 200
Chicago, IL 60612
Joseph Gusek
Phone: 312-733-0551
Email: jgusek@thesterlinglab.com
www.thesterlinglab.com

ASBESTOS FIBER ANALYSIS

NVLAP LAB CODE 101202-0

Bulk Asbestos Analysis

<u>Code</u>	<u>Description</u>
18/A01	EPA -- 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples
18/A03	EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials

Airborne Asbestos Analysis

<u>Code</u>	<u>Description</u>
18/A02	U.S. EPA's "Interim Transmission Electron Microscopy Analytical Methods-Mandatory and Nonmandatory-and Mandatory Section to Determine Completion of Response Actions" as found in 40 CFR, Part 763, Subpart E, Appendix A.



For the National Voluntary Laboratory Accreditation Program