


LEGEND

	WATER MAIN, EXISTING
	WATER MAIN, REPLACEMENT
	FIRE HYDRANT
	FLUSHING HYDRANT
	EXISTING SERVICE RECONNECT INSIDE BUILDING
	REESTABLISH SERVICE FROM MAIN TO INSIDE BUILDING
	EXISTING SERVICE RECONNECT AT NEW MAIN ONLY

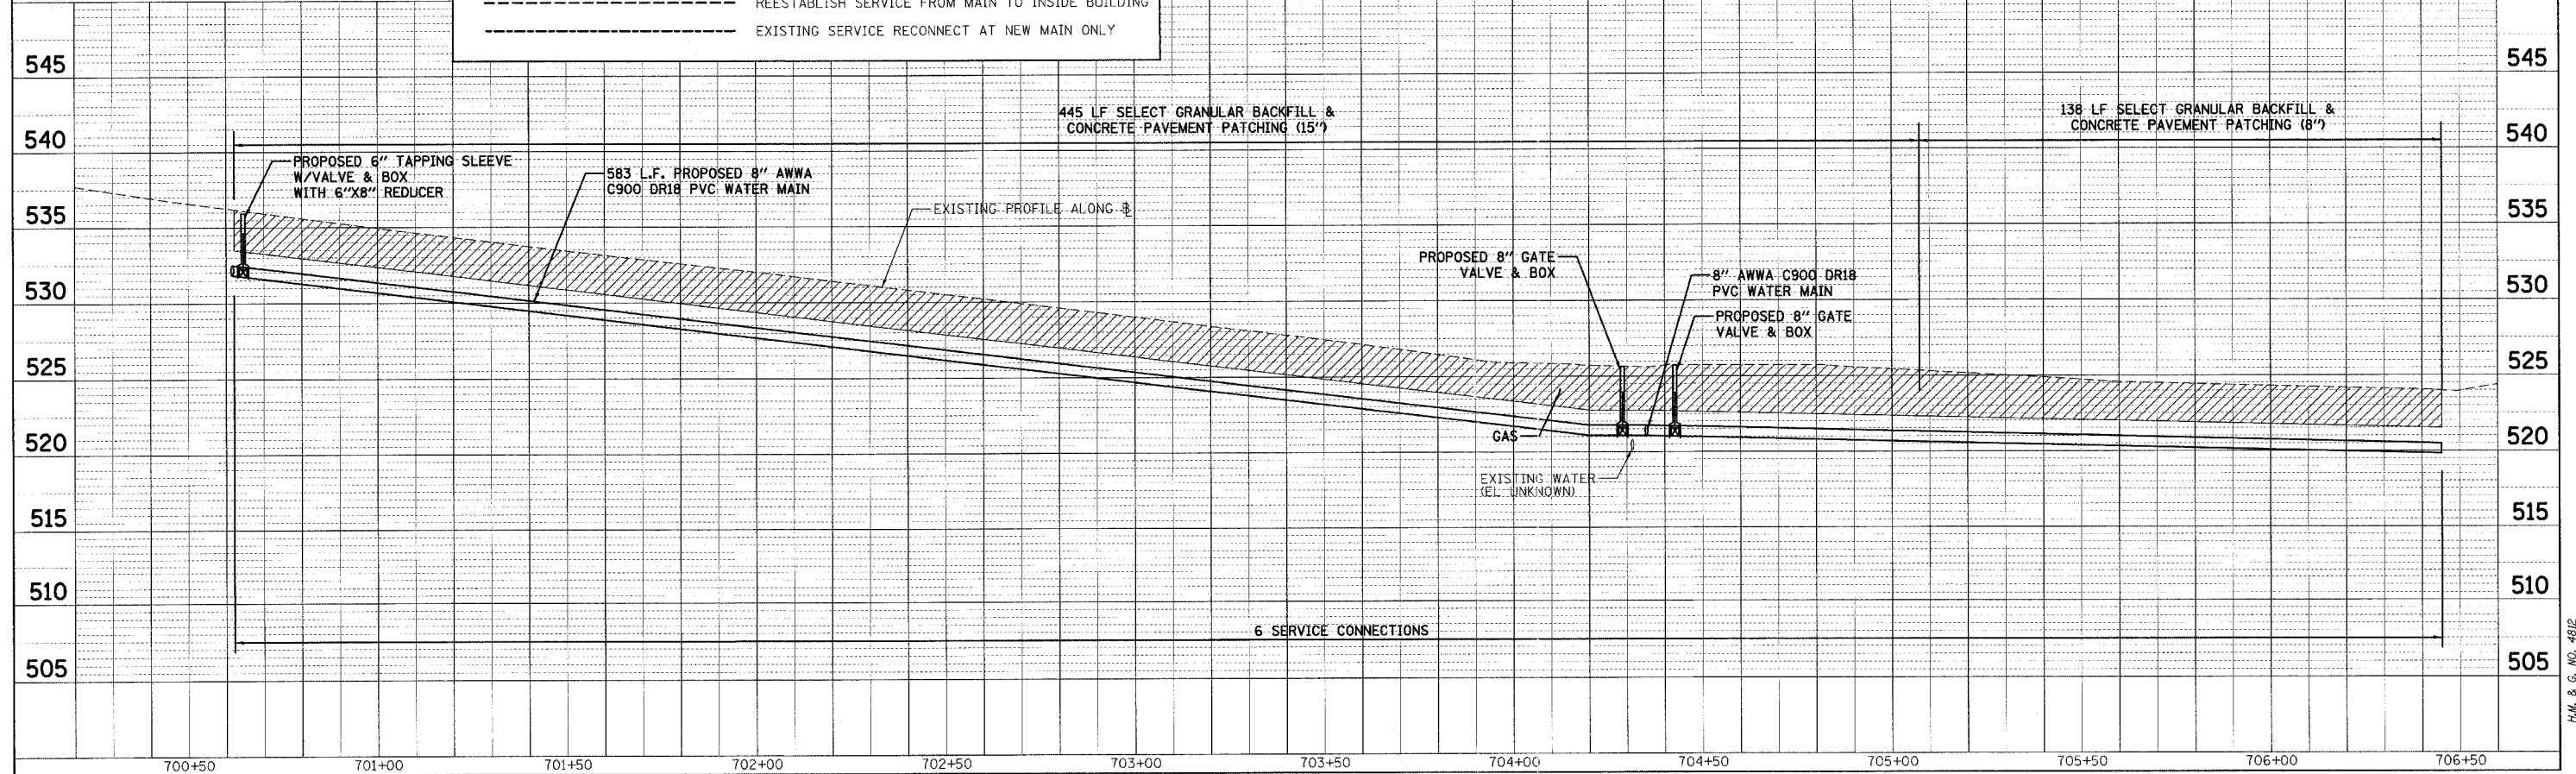

DATE: _____
 BY: _____
 CHECKED: _____
 PLOTTED: _____
 P.L. AN: _____
 NOTE BOOK: _____
 NO.: _____

DATE: _____
 BY: _____
 CHECKED: _____
 PLOTTED: _____
 P.L. AN: _____
 NOTE BOOK: _____
 NO.: _____

CADD FILE: 14812/W-SevenSt.dwg
 PLOTTED: 7/30/2007