DK051

NOTES:

1. COORDINATE ELECTRIC SERVICE WITH THE SERVING ELECTRIC UTILITY AND THE AIRPORT MANAGER. UTILITY CONTACT IS MR. JIM ACKERT, COM ED, 17028 S. STATE RT 23, DEKALB, IL 60115, PHONE 815-748-2271, FAX 815-748-2267. AIRPORT MANAGER IS MR. TOM CLEVELAND, CITY OF DEKALB AIRPORT DIVISION, 3232 PLEASANT STREET, DEKALB, IL 60115, PHONE 815-748-2020, FAX. 815-748-2022.

2. CONTRACTOR SHALL FURNISH & INSTALL UTILITY TRANSFORMER PAD PER SERVING ELECTRIC UTILITY CO. REQUIREMENTS. SEE "UTILITY TRANSFORMER PAD DETAIL" ON SHEET 42 FOR REQUIREMENTS.

3. SEE GLIDE SLOPE ELECTRICAL ONE LINE, RUNWAY 02, DKB-D-GS02-E02 FOR ADDITIONAL REQUIREMENTS ON ELECTRIC SERVICE.

4. FURNISH & INSTALL TELEPHONE SERVICE CABLE FROM THE PHONE SERVICE DEMARCATION POINT AT THE FBO/TERMINAL BUILDING TO THE GLIDE SLOPE SHELTER. SEE PROPOSED UTILITY PLAN FOR CABLE ROUTE. TELEPHONE CABLE SHALL BE 6 PAIR #19 AWG SOLID ANNEALED COPPER COMMUNICATIONS CABLE, GOPHER RESISTANT, JELLY FILLED TO RESIST MOISTURE ENTRY AND TO INHIBIT CORROSION, SUITABLE FOR DIRECT BURIAL AND FOR USE IN DUCT, COMPLYING WITH ANSI/ICEA S-84-608-2002 AND RDUP 7 CFR 1755.390 (PE-39); SUPERIOR ESSEX PART NO. 04-026-94 OR APPROVED EQUAL. PROVIDE GRSC WHERE EMERGING FROM GRADE. PROVIDE SUFFICIENT SLACK CABLE TO TERMINATE IN GLIDE SLOPE REMOTE MAINTENANCE MONITOR AT G.S. SHELTER.

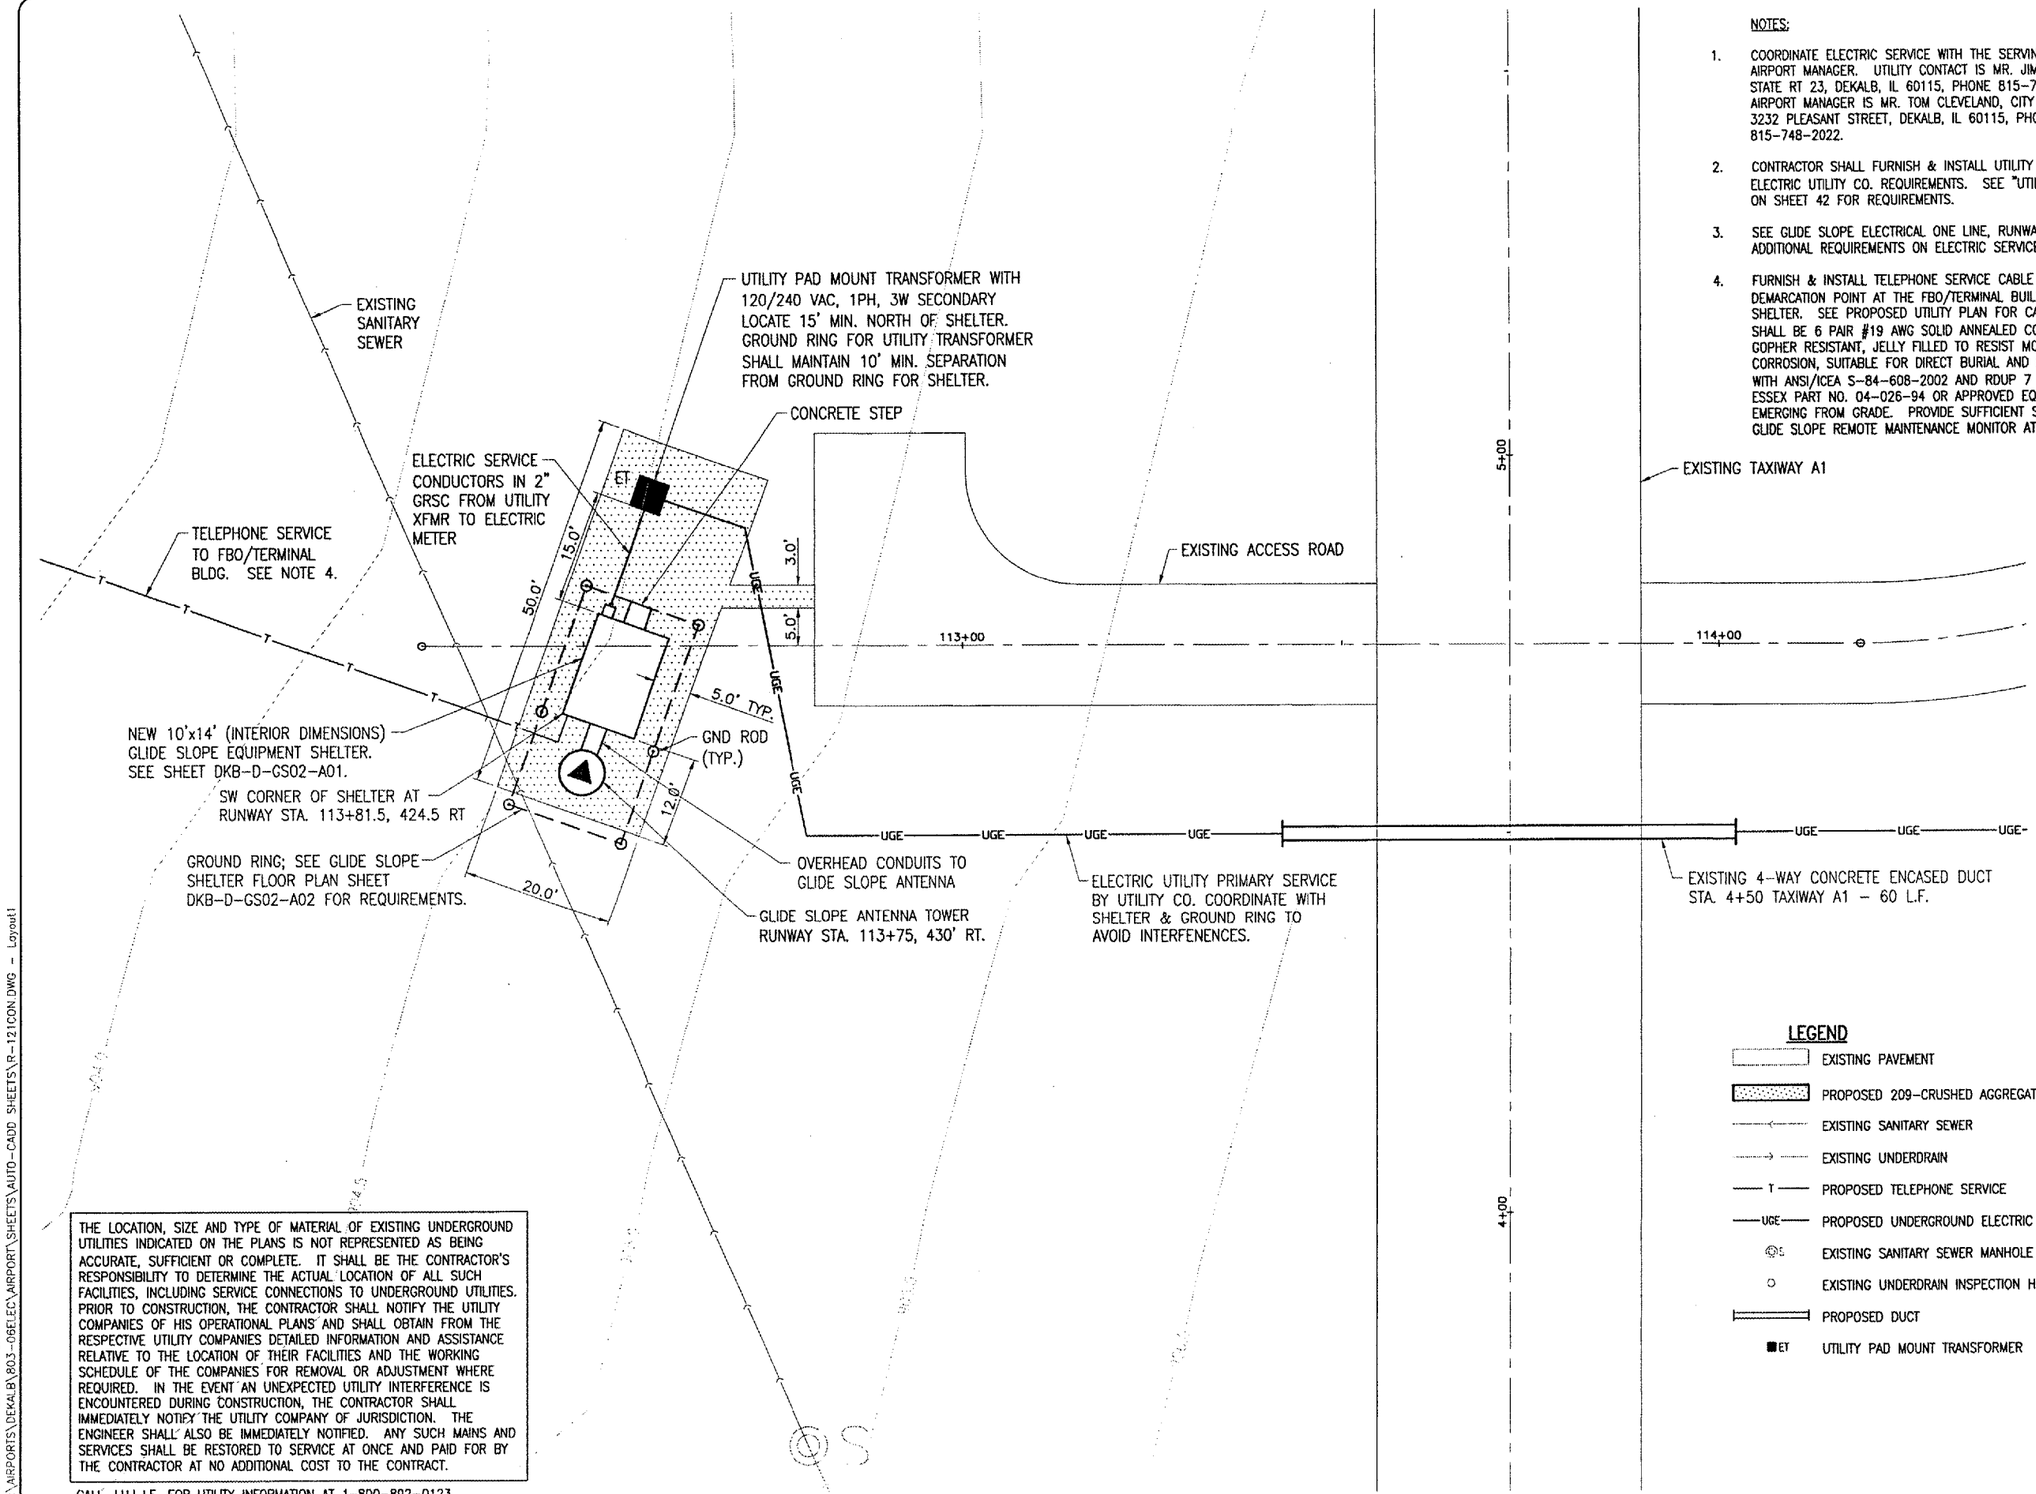

THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123.

DATE	REVISION	BY

DITMAR

DEKALB TAYLOR MUNICIPAL AIRPORT

IL. PROJ.: DKB-3225 A.I.P. PROJ.: 3-17-0139-B37

HANSON PROJECT No. 803-06ELEC
Filename R-121CON.DWG
Scale 1"= 10'
Date 04/20/07

LAYOUT	KWL	03/23/07
DRAWN	MV	03/25/07
REVIEWED	C.A.H.	03/29/07

HANSON

Hanson Professional Services Inc.
1525 South Sixth Street
Springfield, Illinois 62703-2888
Offices Nationwide

INSTALL MALSR & GLIDE SLOPE

GLIDE SLOPE
PROP. SITE PLAN, RUNWAY 02
DKB-D-GS02-C01

34

34 of 48 sheets

JUN 22, 2007 2:08 PM CAH
I:\AIRPORTS\DEKALB\803-06ELEC\AIRPORT\SHEETS\AUTO-CADD SHEETS\R-121CON.DWG - Layout1