




**SECTION W-W**

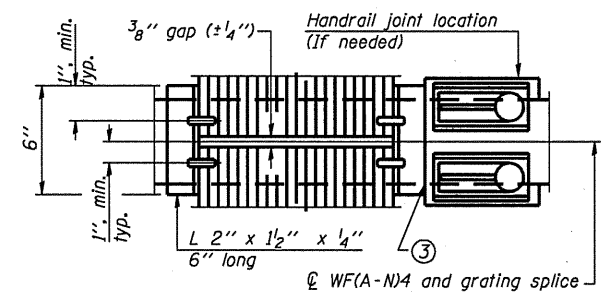

**(AT WALKWAY GRATING SPLICE)**

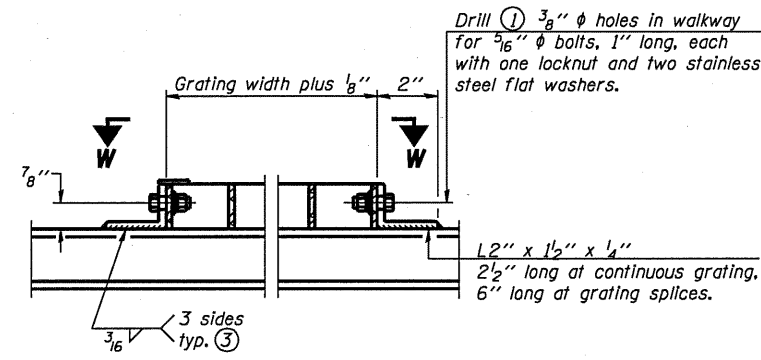


**DETAIL W**  
(Walkway grating)





**DETAIL T'**

(Truss grating splice)  
Details not shown same as Detail T. Alternate materials may be used subject to the Engineer's review and approval.

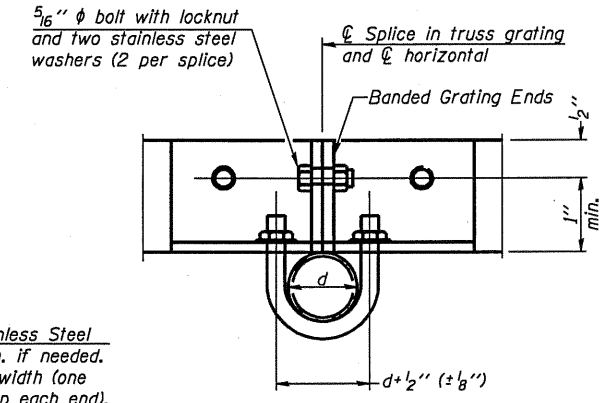


**SECTION T'-T'**

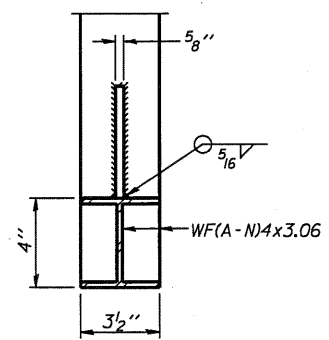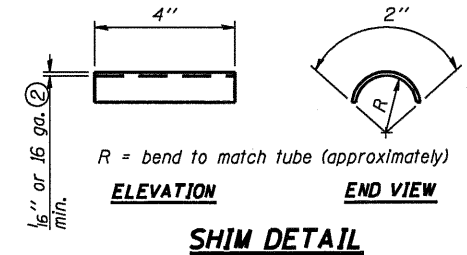

**SECTION B-B**

Sign shall be even with the top of the bracket, but it may extend no more than 6" above the top of the bracket for field adjustments.

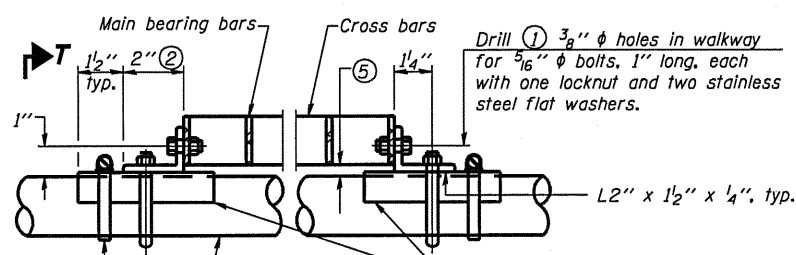


**SECTION D-D**

Screw type stainless steel tube clamp at shim location

Horizontal

Stainless steel shim(s). If needed, place on top of horizontals and horizontal diagonals. Secure with one stainless steel clamp per side. See "Shim Detail".

Drill 1/2" φ holes in angles for 5/16" φ stainless steel u-bolts. Two stainless steel washers and hot dip galvanized steel nuts required per bolt. U-bolt and angle connections required at horizontals only.

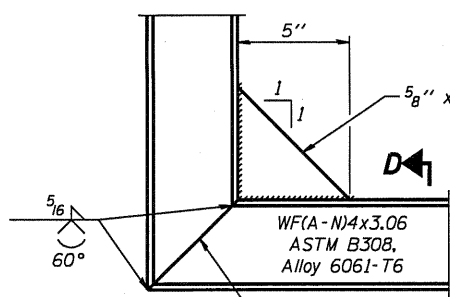

**DETAIL T**

(Continuous Truss grating)

**DETAIL D**

Structure Number	Station	A	B	C	D
3C0381057L269.3	1374+50	7 5/8"	1'-6"	5'-6"	7'-6"

**SPECIFICATIONS FOR STANDARD ALUMINUM GRATING**  
Main Bearing Bars (MBB) shall be 3/16" x 1 1/2" on 1 3/16" centers and conform to ASTM B221 Alloy 6061-T6.  
Cross bars (CB) shall be 3/16" x 1 1/2" on 4" centers and conform to ASTM B221 Alloy 6063-T5 or 6061-T6.

**OR**  
Aluminum Grating with modified "I" sections for main bearing bars shall meet the following requirements:  
Main bars shall conform to ASTM B221 Alloy 6061-T6 and have a minimum section modulus equal to 0.0705 in.<sup>3</sup> per bar, a depth of 1 1/2", spaced on 1 3/16" centers.  
Cross bars shall conform to ASTM B221 Alloy 6063-T5 or T-42 and spaced on 4" centers.

- Drilling holes in grating may be done in shop or field, based on Contractor's preference and subject to accurate alignment.
- Stainless steel shims shall be placed as shown in Detail T if needed to compensate for alignment variations between horizontal and diagonal pipes beyond adjustment provided by angles. Thicker shims may be used subject to shims performing properly.
- If Handrail Joint present, weld angle to WF(A-N)4 and 1/4" extension bars. (See Base Sheet OSC-A-8.)
- 1/8" x 1/2" x 2" welded to handrail posts to protect locations that contact grating.
- Tube to grating gap may vary from 0 to 1/2", max. to align walkway, allow for camber, etc.
- Based on actual sign height, D<sub>s</sub>, given on OSC-A-1.

**LOCATIONS 3 AND 4  
THIS SHEET FOR INFORMATION ONLY**