

# STANDARD INLET FOR CURB & GUTTER TYPE B-6.24

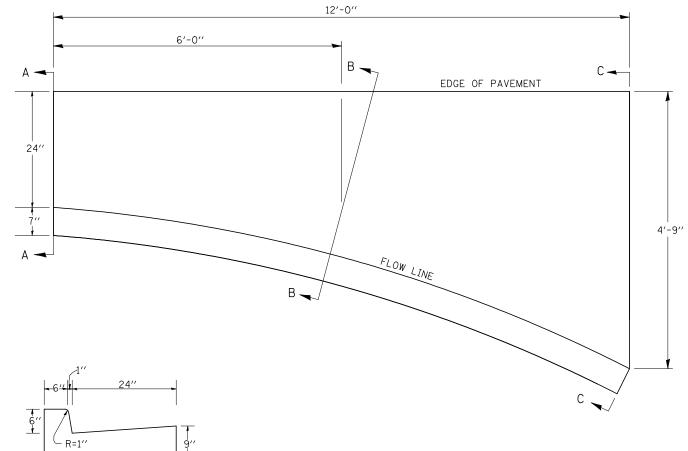

SECTION A-A



### NOTES


Class SI Concrete shall be used throughout.

The Curb and Gutter inlet will be paid for at the contract unit price per cubic yard for Class SI Concrete (OUTLETS).

Joints shall be constructed in accordance with the requirements of Article 606.07 of the Standard Specifications.

When curb and gutter is constructed adjacent to flexible pavement, a 1" expansion joint shall be installed at construction joints.

SECTION B-B



SECTION C-C

- QUANTITY -


Section A-A to C-C (1.23 Cu. Yds.)
Class SI Concrete

REVISED - 10-10-06

STANDARD INLET FOR CURB & GUTTER TYPE B-6.24


## 21.2

## DISABLED RAMP DETAIL FOR TYPE A

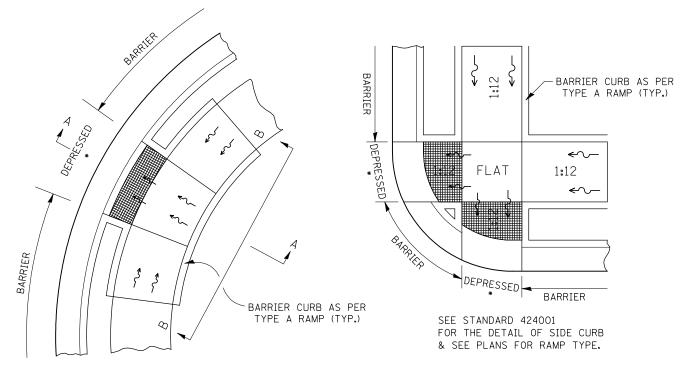


ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED.

\* SEE NOTE BELOW

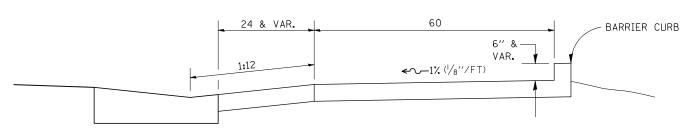

SECTION A-A



#### SECTION B-B

NOTES: THIS DETAIL TO BE USED IN CONJUNCTION WITH STATE STANDARD 424001.

THE MAXIMUM ALLOWABLE CROSS SLOPE FOR SIDEWALK IS 1% (1/8"/FT).

THE MAXIMUM ALLOWABLE SIDEWALK GRADE IS 8% (1/12"/FT). IF SPACE

LIMITATIONS PROHIBIT THE USE OF THE 1:12 SLOPE, THEN SLOPES BETWEEN 1:10

ARE 1:12 ARE PERMITTED FOR A MAXIMUM RISE OF 6. SLOPES 1:8 AND 1:10

ARE ALLOWED FOR A MAXIMUM RISE OF 3. SLOPES STEEPER THAN 1:8 ARE

NOT PERMITTED.

REVISED - 10-14-11 THE DEPRESSED CURB IS NOT STANDARD. THE RISE IS 1/2 INSTEAD OF 11/2.

### DISABLED RAMP DETAIL FOR TYPE A

60.2

REVISED -		F.A.P RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
REVISED -	REGION 2 / DISTRICT 2 STANDARD	303	129R	WINNEBAGO	968	704
REVISED -				CONTRACT		4988
REVISED -	SCALE: 20.0000 / IN SHEET NO. OF SHEETS STA. TO STA.	EED BO	AD DIST NO TILINOIS FED A			