

# ASBESTOS SURVEY REPORT

**PTB 196-032**

**Asbestos Survey for Building Demolition (I-80)**

**552 Market Street, Joliet, Illinois**

**Region One/District One**

*Prepared for:*



**Illinois Department of Transportation  
District 1**

*Submitted to:*

**WSP USA  
30 N. LaSalle Street  
Chicago, IL, 60602**

*Prepared by:*



August 16, 2024



August 16, 2024

David Skaleski, P.E.  
Project Manager  
WSP USA  
30 N. LaSalle Street, Suite 4200  
Chicago, Illinois 60602


Asbestos Survey Report  
PTB 198-003  
FAI-80 (I-80) over Des Plaines River Bridge  
Job N. D-91-204-19  
552 Market Street, Joliet, IL  
Parcel No. 1P10115


---


Dear Mr. Skaleski:

GSG Consultants Inc has conducted an Asbestos Survey for the above referenced property in accordance with our contractual agreement. The report provides a description of the site, survey methodology, analytical results, abatement cost estimates, and recommendations.

Should you have any questions or require additional information, please call us at 630-994-2600.

Prepared by:  August 16, 2024  
Erin Pahomi  
Asbestos Building Inspector  
Inspector License No: 100-20674  
Date

Reviewed By:  August 16, 2024  
Thaddeus Cagney, LPG  
Senior Project Manager  
Date

QA Manager:  August 16, 2024  
Ala E Sassila, Ph.D., PE  
Date



## TABLE OF CONTENTS

---

<b>1.0</b>	<b>INTRODUCTION .....</b>	<b>4</b>
<b>2.0</b>	<b>SURVEY METHODOLOGY .....</b>	<b>5</b>
<b>2.1</b>	<b>VISUAL INSPECTION .....</b>	<b>5</b>
<b>2.2</b>	<b>SAMPLING PROCEDURES .....</b>	<b>6</b>
<b>2.3</b>	<b>QUANTIFICATION.....</b>	<b>6</b>
<b>3.0</b>	<b>ANALYTICAL RESULTS.....</b>	<b>7</b>
<b>3.1</b>	<b>TESTING PROCEDURES .....</b>	<b>7</b>
<b>3.2</b>	<b>FINDINGS.....</b>	<b>7</b>
<b>4.0</b>	<b>RECOMMENDATIONS.....</b>	<b>8</b>
<b>6.0</b>	<b>LIMITATIONS .....</b>	<b>11</b>
<b>7.0</b>	<b>CERTIFICATION .....</b>	<b>12</b>

## TABLES

---

<b>Table 1</b>	<b>Materials Sampled for ACM.....</b>	<b>2</b>
----------------	---------------------------------------	----------

## EXHIBITS

---

<b>Figure 1</b>	<b>Asbestos Bulk Sampling Locations</b>
-----------------	---

## APPENDICES

---

<b>Appendix A</b>	<b>Analytical Testing Results</b>
<b>Appendix B</b>	<b>Reference Photographs</b>
<b>Appendix D</b>	<b>Inspector Licenses and Training Certificates</b>
<b>Appendix E</b>	<b>Laboratory Accreditations</b>



---

**ACRONYMS AND ABBREVIATIONS**

---

<b>ACM</b>	<b>Asbestos-Containing Materials</b>
<b>ACBM</b>	<b>Asbestos-Containing Building Materials</b>
<b>AHERA</b>	<b>Asbestos Hazard Emergency Response Act</b>
<b>CFR</b>	<b>Code of Federal Regulations</b>
<b>COC</b>	<b>Chain of Custody</b>
<b>GSG</b>	<b>GSG Consultants, Inc.</b>
<b>IDOT</b>	<b>Illinois Department of Transportation</b>
<b>IDPH</b>	<b>Illinois Department of Public Health</b>
<b>NESHAP</b>	<b>National Emissions Standards for Hazardous Air Pollutant</b>
<b>NVLAP</b>	<b>National Voluntary Laboratory Accreditation Program</b>
<b>OSHA</b>	<b>Occupational Safety and Health Administration</b>
<b>PLM</b>	<b>Polarized Light Microscopy</b>
<b>RACM</b>	<b>Regulated Asbestos-Containing Material</b>
<b>TSI</b>	<b>Thermal System Insulation</b>
<b>USEPA</b>	<b>United States Environmental Protection Agency</b>



## Asbestos Survey Report

55s Market Street, Joliet, IL

### SURVEY SUMMARY

SITE INFORMATION			
FAP Route:	FAI-80 (I-80)	Address:	552 Market Street
County:	Will	City, State, Zip	Joliet, IL 60433
Section:	N/A	Property Type:	Single-Family Residential
IDOT Job No.	D-91-204-19	Construction Date:	1900
Parcel No.	1P10115	Building Size:	572 SF

ASBESTOS CONTAINING MATERIALS	
Survey Date:	August 1, 2024
Weather Conditions:	79°F, Cloudy
By Whom:	
Firm:	GSG Consultants, Inc
Inspector:	Safdar Azeem
IDPH License No.	100-10351
Results:	
	Number of Material Types Sampled <b><u>13</u></b>
	Number of Samples Collected: <b><u>39</u></b>
	Number of Materials Tested Positive: <b><u>0</u></b>
	Was Friable ACM Found? <b><u>No</u></b>
	Were Roofing Materials Sampled? <b><u>Yes</u></b>
	Are There Unique State or Local Requirements? <b><u>No</u></b>
Laboratory Used:	Name: Sterling Labs Address: 2242 W. Harrison Street, Chicago, Illinois NVLAP: 101202-0
Building Access Limitations:	The basement was inaccessible for inspection during this survey and any suspect materials shall be assumed positive for asbestos until sampling can occur.



# Asbestos Survey Report

55s Market Street, Joliet, IL

## ASBESTOS-CONTAINING MATERIALS (ACM) SURVEY RESULTS:

**Parcel No. 1P10115  
Residential Property  
552 Market Street, Joliet, Illinois**

**Table 1** provides a list of the homogeneous building material types that were sampled as part of the asbestos survey and the laboratory testing results.

HA No.	Material Description	Location	Type <sup>(1)</sup>	Condition	Friable	% Asbestos*	# of Samples	Estimated Quantity <sup>(2)</sup>
1	White Counter Caulking	Kitchen	Misc.	Good	No	ND	3	N/A
2	Grey Sink Under Coating	Kitchen	Surf.	Good	No	ND	3	N/A
3	White Drywall	Throughout	Misc.	Good	No	ND	3	N/A
4	Beige Grout	Bathroom, Front Entrance	Misc.	Good	No	ND	3	N/A
5	Grey Ceramic Tile	Bathroom	Misc.	Good	No	ND	3	N/A
6	White Shower Caulking	Bathroom	Misc.	Good	No	ND	3	N/A
7	White Dome Light Insulation	Bedroom	TSI	Good	No	ND	3	N/A
8	Wall Siding (Under Aluminum Siding)	Exterior	Misc.	Good	No	ND	3	N/A
9	Grey Plaster	Exterior	Surf.	Good	No	ND	3	N/A
10	Grey Plaster	East Exterior	Misc.	Good	No	ND	3	N/A
11	Black Shingle #1	Roof	Misc.	Good	No	ND	3	N/A
12	Black Shingle #2	Roof	Misc.	Good	No	ND	3	N/A
13	Black Tar Paper	Roof	Misc.	Good	No	ND	3	N/A
Total Estimated Quantity of ACM								N/A

(1) TSI= Thermal System Insulation, Surf. = Surfacing Material, and Misc. = Miscellaneous.

(2) Quantities are estimates only, all quantities must be field verified.

## 1.0 INTRODUCTION

---

GSG Consultants Inc. (GSG) conducted an Asbestos Survey at Parcel No. 1P10115 located at 552 Market Street in Joliet, Illinois. The site is improved with a one-story single-family house. The house was constructed in 1900 and is approximately 572 square feet in size with an asphalt shingled roof. The interior walls and ceilings are drywall, and the floors are wood and ceramic tile. The building exterior is aluminum over wood siding. Additionally, the basement was inaccessible for inspection during this survey and shall be assumed positive for asbestos until sampling can occur.

GSG conducted the asbestos survey to satisfy requirements of the United States Environmental Protection Agency (USEPA) regulations under 40 CFR Part 61, Subpart M of the National Emission Standards for Hazardous Air Pollutants (NESHAP) and applicable state and local regulations. This was accomplished by conducting a visual inspection of the structures to be impacted by the planned demolition and collecting samples of suspect ACM based on these observations.

The results, findings, conclusions, and recommendations expressed in this report are based on conditions observed during GSG's survey of the project area. The information contained in this report represents conditions at the time of the survey and may not accurately represent conditions at a later date. The conclusions in this report are based on conditions observed in accessible areas of the project area. The possibility exists that suspect hazardous building materials or conditions may exist within wall cavities, voids, or other areas hidden from view which were not observed and cannot be ruled out. Any additional potential hazardous building materials encountered that will be disturbed during the demolition activities and that differ from the materials assessed during this survey, were hidden from view, or were located in an area not accessible will require further sampling and analysis prior to disturbance. The estimated quantities provided herein should be considered approximate and are accurate to the extent allowable under the terms and conditions of our contract. This report has been prepared with generally accepted industry practices and procedures. No other warranty, either expressed or implied, is made.

The investigation did not include access or inspection of confined spaces, underground piping, conduits, and building footings, if any. Materials associated with electrical components and energized equipment were not safely accessible and were not sampled.

## 2.0 SURVEY METHODOLOGY

---

The asbestos survey was conducted in compliance with the United States Environmental Protection Agency (USEPA) National Emissions Standards for Hazardous Air Pollutants (NESHAPs), applicable State of Illinois and local asbestos regulations. NESHAP regulations defined regulated asbestos-containing material (RACM) as a friable asbestos material, a Category I non-friable ACM that has become friable, a Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting or abrading, or Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces acting on it during demolition or renovation. The materials were then classified with regard to whether they are friable or non-friable and classified as Class I or Class II non-friable materials, using the following definitions.

- **Friable:** NESHAP defines a friable ACM as any material containing more than one percent (1%) asbestos, which, when dry, may be crumbled, pulverized, or reduced to powder by hand pressure, and includes previously non-friable material where previously non-friable material becomes damaged to the extent that it may be crumbled, pulverized, or reduced to powder by hand pressure.
- **Category I Non-friable ACM:** NESHAP defines a Category I non-friable ACM as packing, gaskets, resilient floor covering (except vinyl sheet flooring products that are considered friable), and asphalt roofing products that contain more than one (1) percent asbestos as determined using the method specified in **Appendix A**, Subpart F, 40 CFR Part 763, Section 1, Polarized Light Microscopy
- **Category II Non-friable ACM:** means any material, excluding Category I non-friable ACM, containing more than 1 percent asbestos as determined using the methods specified in **Appendix A**, Subpart F, 40 CFR Part 763, Section 1, Polarized Light Microscopy that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.

The survey consisted of three major activities: visual inspection, sampling, and quantification of building materials. A brief description of each of the above elements is provided in the following sections.

### 2.1 Visual Inspection

The inspector conducted an initial building walkthrough to determine the presence and condition of suspect asbestos-containing materials (ACMs) that were accessible and/or exposed. The survey consisted of accessing accessible areas of the buildings to identify and quantify regulated RACM. The inspector identified homogeneous areas (HA) comprised of building materials that appear similar throughout in terms of color and texture and assumed date of installation. Materials that were similar in general appearance were grouped into homogeneous sampling areas. Following the EPA inspection protocol, each identified suspect homogeneous material was placed in one of the following EPA classifications:

1. Surfacing Materials (spray or trowel applied to building members)
2. Thermal System Insulation (materials generally applied to various mechanical systems)
3. Miscellaneous Materials (any materials which do not fit either of the above categories)

Each identified suspect homogeneous material was placed in one of the following EPA classifications:



## 2.2 Sampling procedures

The asbestos inspector collected a representative number of samples from each HA. Building materials identified as concrete (not including cement panels or pipe and soft concrete), glass (including fiberglass), wood, masonry, metal, and plastic are not considered suspect ACM and were not sampled. The survey included destructive, intrusive, and/or exploratory testing unless specifically prohibited by IDOT. Destructive sampling is performed to identify materials that are concealed or obstructed. Concealed or obstructed areas include but are not limited to wall cavities, pipe chases, spaces above fixed ceilings, materials located under carpeting or subfloors, and ceramic tile grout/adhesive. Bulk samples of suspect ACM were collected in general accordance with Asbestos Hazard Emergency Response Act (AHERA) sampling protocols, based on the results of the visual observation. Random samples of suspect materials were collected of each HA.

A total of 39 bulk samples of suspect ACM, three (3) samples for each of the 13 homogeneous areas, were collected from various homogeneous areas of the buildings. Bulk samples were collected from the following materials/homogeneous area(s):

- White Counter Caulking
- Grey Sink Undercoating
- White Drywall System
- 1'x1' Beige Ceramic Tile & Grout
- 2'x1' Grey Ceramic Tile
- White Caulking
- White Dome light Insulation
- Exterior Wall Siding (Under Aluminum)
- Exterior Grey Plaster
- Black Roof Shingles
- Black Roof Tar Paper

**Exhibit 1, Suspect ACM Sample Locations**, shows the approximate locations of the suspect ACM collected during the field survey. Samples were placed in new sealable containers and labeled with unique sample numbers using an indelible marker. All non-disposable sampling equipment was wet-wiped and cleaned before and after each use. Bulk material samples were collected in 4-milliliter plastic bags, and tightly sealed for transport to the laboratory. Bulk samples were submitted under a chain-of-custody (COC) protocol to Sterling Labs in Chicago, Illinois.

## 2.3 Quantification

The inspector estimated the quantities of accessible and/or exposed materials that were suspected of containing asbestos using a measuring wheel and/or visual estimation. Actual quantities may differ between visually estimated values and physical measurements. The asbestos abatement contractor is responsible for verifying reported quantities of ACM.

## 3.0 ANALYTICAL RESULTS

---

### 3.1 Testing Procedures

Sterling Lab analyzed the bulk samples using polarized light microscopy (PLM) method with dispersion staining techniques per USEPA methodology “Method for the Determination of Asbestos in Bulk Building Materials, EPA/600/R-93/116, July 1993”. This is a standard method of analysis in optical mineralogy and the currently accepted method for the determination of asbestos in bulk samples. A suspect material is immersed in a solution of known refractive index and subjected to illumination by polarized light. The characteristic color displays which enable mineral identification. It should be noted that some ACM may not be accurately identified and/or quantified by PLM. The percentage of asbestos applicable was determined by microscopic visual estimation. Sterling analyzed each layer of each sample, which means if multiple layers are detected in the same sample (i.e., roof field), each layer was analyzed, and a separate result was provided for each layer. If any of the sample results from a homogeneous group had a positive result, that homogeneous group was considered to be ACM. Sterling Labs is accredited under the National Voluntary Laboratory Accreditation Program (NVLAP Accreditation Number 101202-0). Refer to **Appendix E** for laboratory accreditations.

### 3.2 Findings

The asbestos survey laboratory results **did not identify** the presence of ACM; however, the basement was inaccessible for inspection during this survey and any suspect materials shall be assumed positive for asbestos until sampling can occur. GSG identified a total of 13 HAs from which 39 samples were collected and analyzed. Results are summarized in **Table 1** and include a description of each material, location, material type, test results, and estimated quantity. Materials indicated to have a “negative” result were confirmed by PLM analysis to be non-asbestos-containing. The laboratory results are provided in **Appendix A** and reference photographs are included in **Appendix B**. The USEPA defines ACM as a material containing greater than 1% asbestos. Materials containing less than 1% asbestos are not regulated by the USEPA or the State of Illinois, but their disturbance is regulated by OSHA.

## 4.0 RECOMMENDATIONS

---

Any suspect materials discovered during the project activities shall be assumed and treated as ACM until tested and proof otherwise. GSG understands that the residential property will be demolished as part of the I-80 improvement project. ACMs identified at the site must be removed/managed in accordance with all federal, state, and local regulations governing asbestos. ACMs abatement and management are subject to the US Environmental Protection Agency (USEPA), the Occupational and Health Administration (OSHA), Illinois Department of Public Health (IDPH), the Illinois Environmental Protection Agency (Illinois EPA), and other applicable Federal, State, and Local Government regulations. The following regulations governing asbestos removal and disposal:

1. U.S. Environmental Protection Agency Regional National Emissions Standards for Hazardous Air Pollutants (NESHAP) (40 CFR Part 61 Subpart A and M).
2. U.S. Department of Transportation "Hazardous Substances Final Rule" 49 CFR 171 and 172, November 21, 1986, February 17, 1987.
3. U.S. Department of Labor Occupational Safety and Health Administration (OSHA) Asbestos Regulations (Code of Federal Regulations Title 29, Part 1910, Section 1910.1001 and Part 1926, Section 1926.1101).
4. State of Illinois, Commercial and Public Building Asbestos Abatement Act. Illinois Department of Public Health, Rules for Asbestos Abatement for Public and Private Schools and Commercial and Public Buildings in Illinois (77 IL Admin. Code 855).

All friable asbestos-containing building materials (ACBMs) identified shall be removed from any building(s) or other structures before demolition. Non-friable ACMs may be left in place, unless during demolition, the ACMs may become friable. If other suspect materials not referenced in this survey report, within or on the outside of the buildings, are identified, not listed in **Table 1**, such materials shall be assumed ACMs until the materials are inspected by a licensed asbestos inspector, sampled, and submitted for laboratory analysis. As the floor tile identified as asbestos containing is a Category I non-friable material which is not likely to become friable during demolition, it does not need to be removed prior to demolition.

If asbestos is identified, GSG recommends the preparation of an asbestos abatement project design before any demolition. An asbestos abatement design plan and specifications should include information regarding the location of containments and barriers, type of sealant, and air sampling requirements and clearance during the asbestos abatement activities. The asbestos design plan and specifications shall be prepared and signed by an IDPH licensed asbestos project designer following Illinois regulations. Before starting any abatement activities, an Asbestos Abatement notification is required for all asbestos projects and must be applied for at least ten (10) working days before the start of the project. A building demolition notification is required for all demolition projects and must be applied for at least ten (10) working days before the start of the project.

Abatement and Emergency Response shall be conducted only by IDPH licensed asbestos abatement contractor(s) under the supervision of a licensed asbestos project manager in accordance with all applicable federal, state, and local regulations. Workers who abate or manage asbestos must receive the proper training and licensing. OSHA prescribes required personnel monitoring including air monitoring and medical monitoring (ref 29 CFR 1926.1101). Personnel protective equipment and procedures are also required.

All asbestos waste generated from the required pre-demolition removal activities during the project must be wetted before it is double bagged in 6-millimeter plastic bags and enclosed in a plastic, leak-tight container with a lid and proper labeling. Discharge no visible emissions to the outside air during the collection, processing, packaging, or transporting of any asbestos-containing waste material. Asbestos waste is a “special waste” in Illinois. Asbestos-containing waste can only be disposed of in Subtitle D landfills that are designated to receive asbestos waste.

## 5.0 ABATEMENT COST ESTIMATE

---

The asbestos survey laboratory results **did not identify** the presence of ACM; therefore, no cost estimates were included in this report.

Because of the hidden nature of many building components, it may be impossible to determine if all building components have been located and subsequently tested. Destructive testing in some instances is not a viable option. GSG does not, therefore, guarantee that all potential asbestos containing materials have been located. For the same reasons, estimates of quantities are subject to readily apparent situations. We do warrant, however, that the investigations and methodology reflect our best efforts based upon prevailing local standard of care in the environmental field.

## 6.0 LIMITATIONS

---

This report has been prepared for the exclusive use of the Illinois Department of Transportation (IDOT) and its Design Section Engineer consultant. GSG warrants that the investigations and methodology reflect our best efforts based upon the prevailing standard of care in the environmental field. This assessment was limited to those materials which were readily visible and with limited demolition and removal of building components. Additional suspect materials may be located behind walls and ceilings. The survey is subject to the following limitations.

- The investigation did not include sampling on any system which may present a hazard to the inspection team such as energized electrical systems or within confined spaces
- Materials associated with electrical components and energized equipment were not safely accessible and were not sampled.
- Estimated quantities of the ACMs are based on observations during the field survey and additional materials may be concealed or were not accessible. Therefore, all estimated quantities shall be field verified by the abatement contractor.

## 7.0 CERTIFICATION

---

The undersigned hereby affirm that the conditions described herein are accurate to the best of our knowledge and belief and are subject to the limitations inherent in the investigative techniques used and any expressed limitations of this survey. Applicable licensing to perform the described survey activities was valid at the time of performance of services in accordance with applicable federal, state and local laws, rules, and regulations.

Inspection Performed By:

Safdar Azeem  
Asbestos Inspector's Name

100-10351  
IDPH License Number



Asbestos Inspector's Signature

8.14.2024  
Date

## EXHIBITS

---


**Exhibit 1**      **Suspect ACM Sample Location Plans**



## EXHIBIT 1

---

### SL-1 and SL-2 Suspect ACM Sample Location Plans

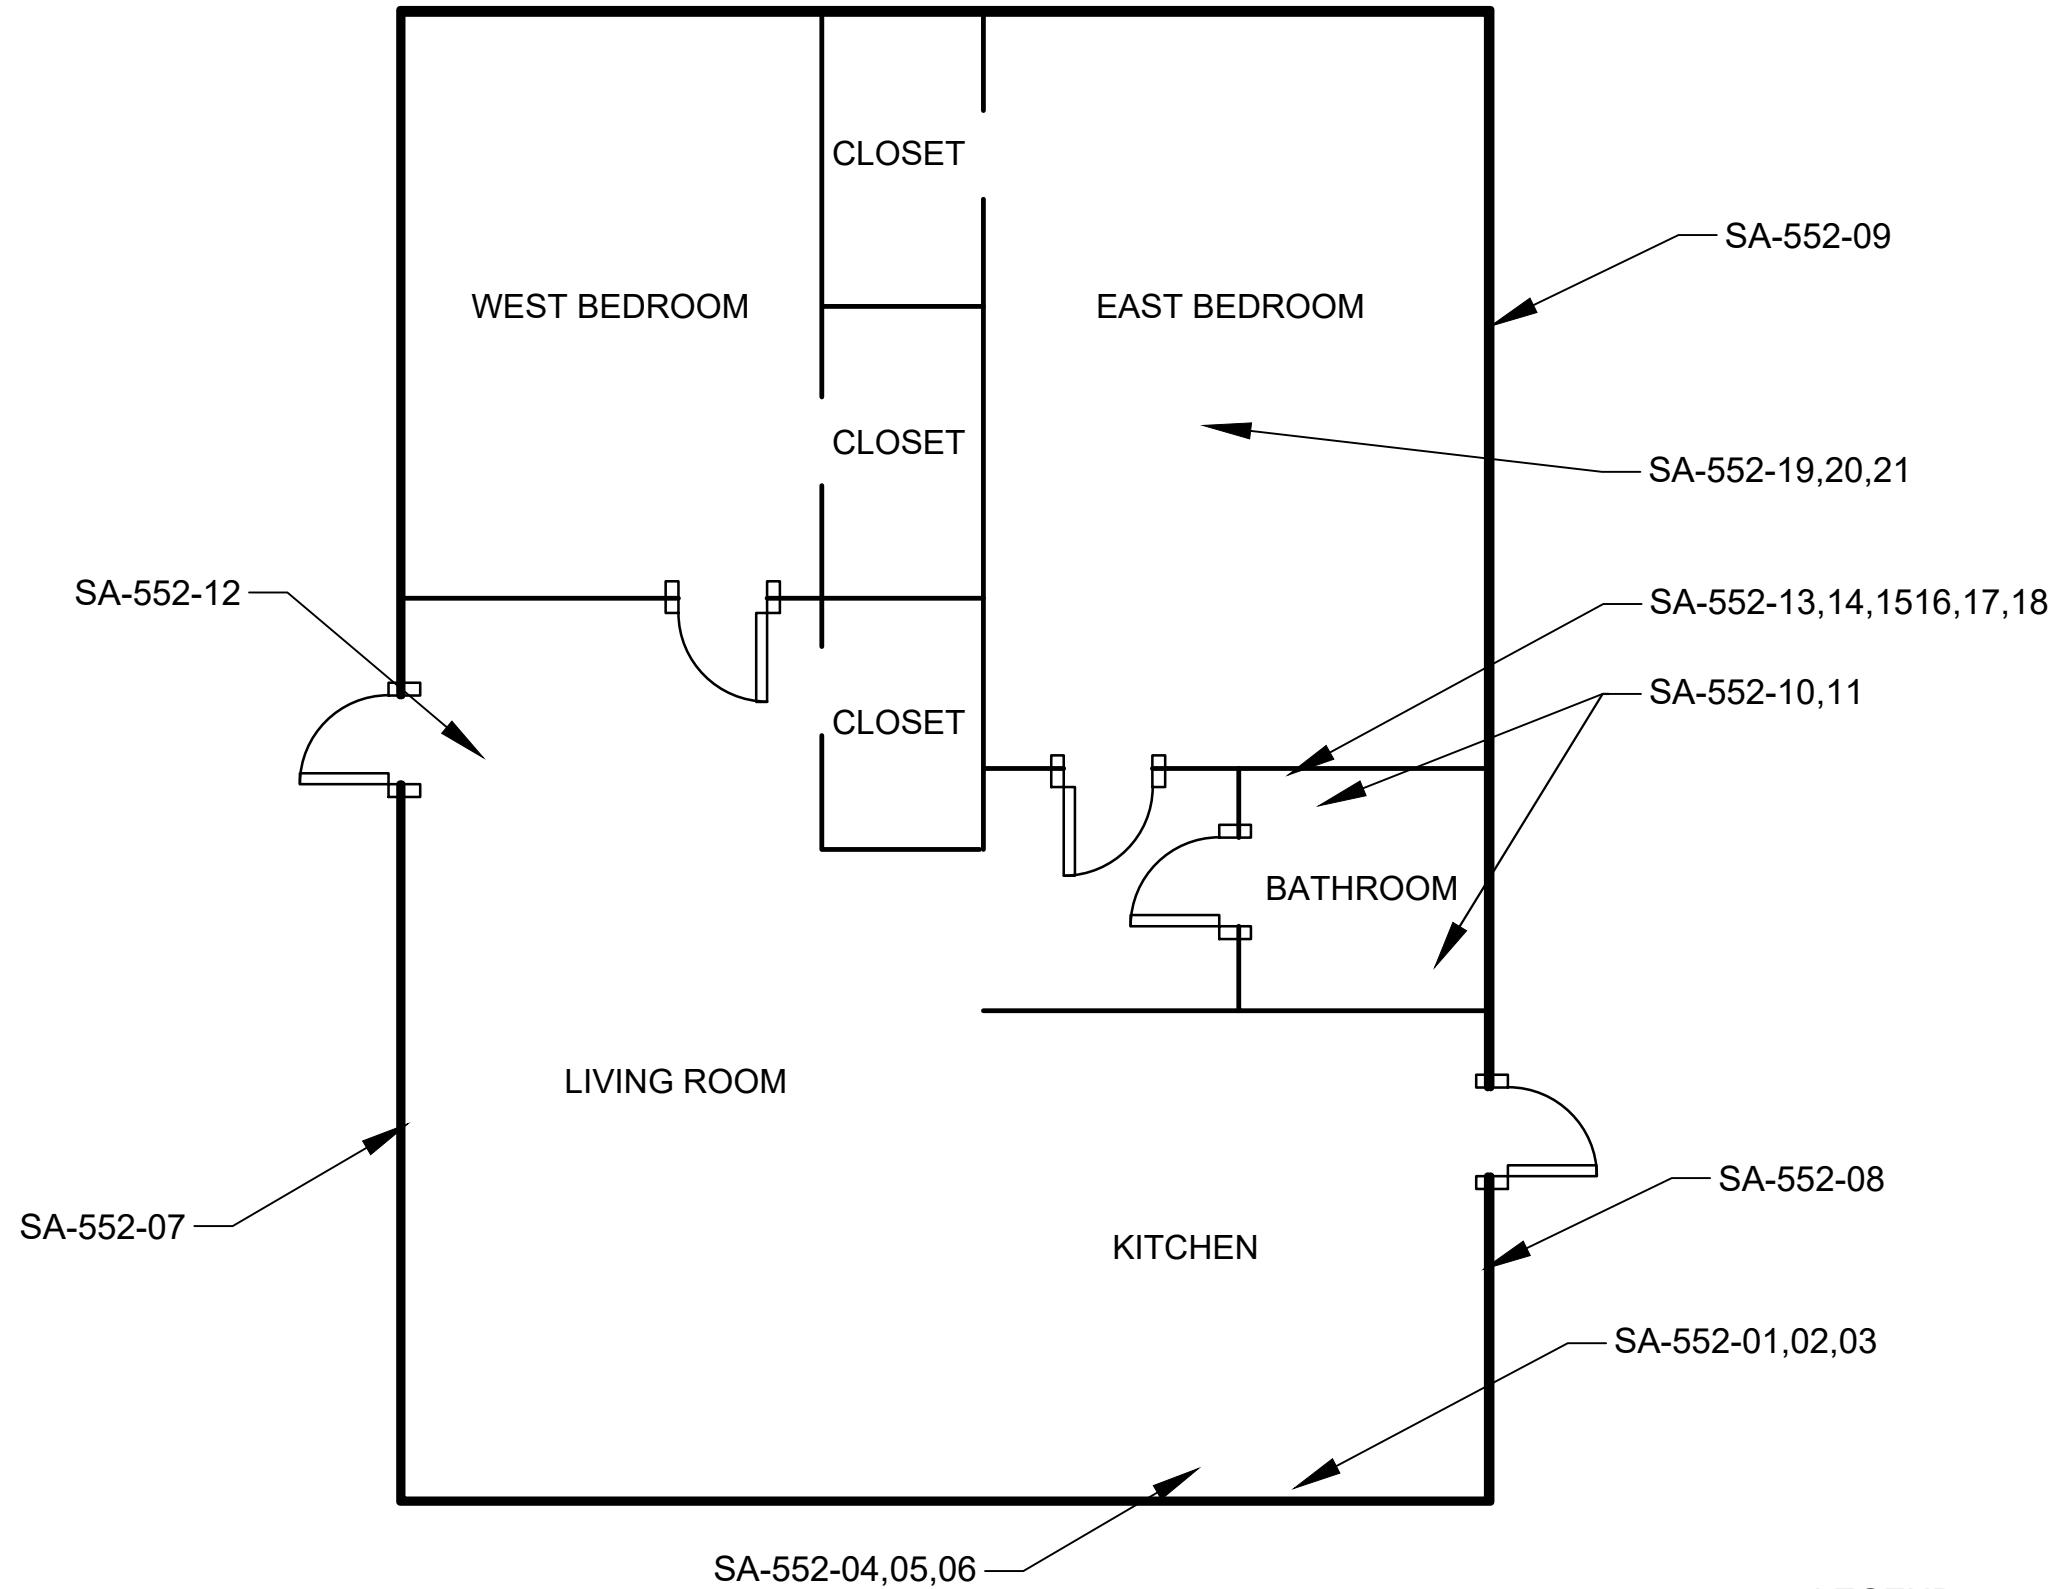

FIRST FLOOR  
SCALE = N.T.S.



LEGEND

SUSPECT ACM SAMPLE LOCATIONS: SA-552-XX  
BATCH NUMBER: 371681

SUSPECT ASBESTOS-CONTAINING MATERIALS SAMPLE LOCATION PLAN

ASBESTOS SURVEY FOR BUILDING DEMOLITION (I-80)  
552 MARKET STREET  
JOLIET, IL, 60433



DRAWN BY:	PROJECT:
EP	21-2007
CHECKED BY:	SCALE:
TC	NTS
DATE:	SHEET #:
7/31/2024	1 OF 2
SHEET NAME:	

**SL-1**



SUSPECT ASBESTOS-CONTAINING MATERIALS SAMPLE LOCATION PLAN

ASBESTOS SURVEY FOR BUILDING DEMOLITION (I-80)  
 552 MARKET STREET  
 JOLIET, IL, 60433



DRAWN BY:	PROJECT:
EP	21-2007
CHECKED BY:	SCALE:
TC	NTS
DATE:	SHEET #:
7/31/2024	2 OF 2

SHEET NAME:  
**SL-2**

**LEGEND**  
 SUSPECT ACM SAMPLE LOCATIONS: SA-552-XX  
 BATCH NUMBER: 371681

## APPENDIX A

---

### Analytical Testing Results

**ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY**

Method: EPA/600/R-93/116

GSG Consultants, Inc.  
 735 Remington Road  
 Schaumburg, IL 60173  
 Phone: (630) 994-2600  
 Fax: (312) 733-5612

Reference:	21-2007	Date Received:	08/02/2024
Location:	IDOT; I-80 Improvement	Date Analyzed:	08/06/2024
Batch No.:	371681	Date Reported:	08/06/2024
Customer No.:	4651	Turn Around Time:	3 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
371681001	SA-552-1	ND	Cellulose 10-15% Binder 85-90%
371681002	SA-552-2	ND	Cellulose 10-15% Binder 85-90%
371681003	SA-552-3	ND	Cellulose 10-15% Binder 85-90%
371681004	SA-552-4	ND	Cellulose 5-10% Binder 90-95%
371681005	SA-552-5	ND	Cellulose 5-10% Binder 90-95%
371681006	SA-552-6	ND	Cellulose 5-10% Binder 90-95%
371681007	SA-552-7	ND	Cellulose 5-10% Binder 90-95%
371681008	SA-552-8	ND	Cellulose 5-10% Binder 90-95%
371681009	SA-552-9	ND	Cellulose 5-10% Binder 90-95%
371681010	SA-552-10	ND	Binder 99-100%
371681011	SA-552-11	ND	Binder 99-100%

ND = Asbestos Not Detected (Not Present)    NA = Not Analyzed    NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

*The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).*

Analyzed by Name : 

**ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY**

Method: EPA/600/R-93/116

GSG Consultants, Inc.  
 735 Remington Road  
 Schaumburg, IL 60173  
 Phone: (630) 994-2600  
 Fax: (312) 733-5612

Reference:	21-2007	Date Received:	08/02/2024
Location:	IDOT; I-80 Improvement	Date Analyzed:	08/06/2024
Batch No.:	371681	Date Reported:	08/06/2024
Customer No.:	4651	Turn Around Time:	3 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
371681012	SA-552-12	ND	Binder 99-100%
371681013	SA-552-13	ND	Binder 99-100%
371681014	SA-552-14	ND	Binder 99-100%
371681015	SA-552-15	ND	Binder 99-100%
371681016	SA-552-16	ND	Binder 99-100%
371681017	SA-552-17	ND	Binder 99-100%
371681018	SA-552-18	ND	Binder 99-100%
371681019	SA-552-19	ND	Binder 1-5% Glass 95-99%
371681020	SA-552-20	ND	Binder 1-5% Glass 95-99%
371681021	SA-552-21	ND	Binder 1-5% Glass 95-99%
371681022	SA-552-22	ND	Binder 1-5% Other 95-99%
371681023	SA-552-23	ND	Binder 1-5% Other 95-99%
371681024	SA-552-24	ND	Binder 1-5% Other 95-99%

ND = Asbestos Not Detected (Not Present)    NA = Not Analyzed    NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

*The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).*

Analyzed by Name :   
 Zineb Nasri / Microscopist

**ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY**

Method: EPA/600/R-93/116

GSG Consultants, Inc.  
 735 Remington Road  
 Schaumburg, IL 60173  
 Phone: (630) 994-2600  
 Fax: (312) 733-5612

Reference:	21-2007	Date Received:	08/02/2024
Location:	IDOT; I-80 Improvement	Date Analyzed:	08/06/2024
Batch No.:	371681	Date Reported:	08/06/2024
Customer No.:	4651	Turn Around Time:	3 Days

Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
371681025	SA-552-25	ND	Cellulose 1-5% Binder 95-99%
371681026	SA-552-26	ND	Cellulose 1-5% Binder 95-99%
371681027	SA-552-27	ND	Cellulose 1-5% Binder 95-99%
371681028	SA-552-28	ND	Cellulose 1-5% Binder 95-99%
371681029	SA-552-29	ND	Cellulose 1-5% Binder 95-99%
371681030	SA-552-30	ND	Cellulose 1-5% Binder 95-99%
371681031	SA-552-31	ND	Binder 85-90% Glass 10-15%
371681032	SA-552-32	ND	Binder 85-90% Glass 10-15%
371681033	SA-552-33	ND	Binder 85-90% Glass 10-15%
371681034	SA-552-34	ND	Binder 85-90% Glass 10-15%

ND = Asbestos Not Detected (Not Present)    NA = Not Analyzed    NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

*The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).*

Analyzed by Name :

  
 Zineb Nasri / Microscopist

**ASBESTOS ANALYSIS BY POLARIZED LIGHT MICROSCOPY**

Method: EPA/600/R-93/116

GSG Consultants, Inc.  
 735 Remington Road  
 Schaumburg, IL 60173  
 Phone: (630) 994-2600  
 Fax: (312) 733-5612

Reference:	21-2007	Date Received:	08/02/2024
Location:	IDOT; I-80 Improvement	Date Analyzed:	08/06/2024
Batch No.:	371681	Date Reported:	08/06/2024
Customer No.:	4651	Turn Around Time:	3 Days


Laboratory Sample	Customer Sample Number	Asbestos Components (%)	Non-Asbestos Components (%)
371681035	SA-552-35	ND	Binder 85-90% Glass 10-15%
371681036	SA-552-36	ND	Binder 85-90% Glass 10-15%
371681037	SA-552-37	ND	Cellulose 80-85% Binder 15-20%
371681038	SA-552-38	ND	Cellulose 80-85% Binder 15-20%
371681039	SA-552-39	ND	Cellulose 80-85% Binder 15-20%

ND = Asbestos Not Detected (Not Present)    NA = Not Analyzed    NS = Not Submitted

Components of inhomogeneous samples are analyzed per our Standard Operating Procedure, or per customer request.

The use of the NVLAP logo does not imply endorsement by NVLAP or any agency of the US Government.

*The information contained in this report and any attachments is confidential information intended only for the use of the individual or entities named above. The results of this report relate only to the samples tested. If you have received this report in error, please notify us immediately by phone. This report shall not be reproduced, except in its entirety, unless written approval has been obtained from the laboratory. This report remains property of STAT Analysis until payment is received in full (see invoice).*

Analyzed by Name :   
 Zineb Nasri / Microscopist





PLM BULK LABORATORY ANALYSIS FORM

<b>Project Name:</b> IDOT ; I-80 IMPROVEMENT	<b>Project Manager:</b> Ted Cagney
<b>Project Number:</b> 21-2007	<b>Building Inspector:</b> Safdar Azeem
<b>Project Address:</b> 552 Market Place	<b>IDPH Number:</b> 100-10351
<b>City/ State:</b> Joliet, Illinois	<b>Work Day:</b> S M T W <b>TH</b> F S
<b>Client:</b> WSP - USA	<b>Analyze by Method:</b>
<b>Date:</b> 08/01/2024	EPA/600/R-93-116

Field Number	HA Number	Type of material, specific sample location (i.e. Room Number, Building Construction Date)
SA-992-1	HA #1	Caulking, white, kitchen counter
2	↓	↓
3	↓	↓
4	2	Sink Under Coating, Gray, kitchen
5	↓	↓
6	↓	↓
7	3	Drywall system, white Living Rm
8	↓	↓ kitchen
9	↓	↓ Bedroom
10	4	1'x1' Ceramic Tile, Beige Grout / Mortar Bedroom
11	↓	↓
12	↓	↓ Front Entrance
13	5	2'x1' Ceramic Tile, Grey - Bathroom wall
14	↓	↓
15	↓	↓

<b>TURN AROUND TIME:</b>	<input type="radio"/> 1 Day <input type="radio"/> 2 Days <input checked="" type="radio"/> 3 Days <input type="radio"/> (5 Day) Other	<b>COMMENTS:</b> E-mail Results to: <a href="mailto:epahomi@gsg-consultants.com">epahomi@gsg-consultants.com</a> <a href="mailto:sazeem@gsg-consultants.com">sazeem@gsg-consultants.com</a> STOP AT FIRST POSITIVE
--------------------------	---	---

CHAIN OF CUSTODY RECORD

Collected By (Signature) <i>Safdar Azeem</i>	Date: 08/01/24	Time: 08:35	Relinquished by (Signature) <i>Safdar Azeem</i>	Date: 08/02	Time: 08:35
Received by: (Signature) <i>G. J.</i>	Date: 8/2/24	Time: 12:36	Relinquished by: (signature) <i>G. J.</i>	Date: 8/2/24	Time: 15:53
Dispatched by: (Signature, if mailed)	Date:	Time:	Received for Laboratory by: <i>EM</i>	Date: 8/2/24	Time: 15:53 CH1

**PLM BULK LABORATORY ANALYSIS FORM**

<b>Project Name:</b> IDOT ; I-80 IMPROVEMENT	<b>Project Manager:</b> Ted Cagney
<b>Project Number:</b> 21-2007	<b>Building Inspector:</b> Safdar Azeem
<b>Project Address:</b> 552 Market Place	<b>IDPH Number:</b> 100-10351
<b>City/ State:</b> Joliet, Illinois	<b>Work Day:</b> S M T W <u>TH</u> F S
<b>Client:</b> WSP - USA	<b>Analyze by Method:</b>
<b>Date:</b> 08/01/2024	EPA/600/R-93-116

Field Number	HA Number	Type of material, specific sample location (i.e. Room Number, Building Construction Date)
SA-552-16	6	caulking, white - Bathroom shower/wall
17	↓	↓
18	↓	↓
19	7	Domelight Insulation - white Bedroom
20	↓	↓
21	↓	↓
22	8	Exterior wall siding paper - Under Al-Siding
23	↓	↓
24	↓	↓
25	9	Exterior Plaster (stack wall - N)
26	↓	Grey ↓
27	↓	↓
28	10	Exterior wall Plaster East Side
29	↓	Grey ↓
30	↓	↓

<b>TURN AROUND TIME:</b>	<input type="radio"/> 1 Day <input type="radio"/> 2 Days <input checked="" type="radio"/> 3 Days <input type="radio"/> (5 Day) Other	<b>COMMENTS:</b> E-mail Results to: <a href="mailto:epahomi@gsg-consultants.com">epahomi@gsg-consultants.com</a>  <a href="mailto:sazeem@gsg-consultants.com">sazeem@gsg-consultants.com</a> STOP AT FIRST POSITIVE
--------------------------	---	---

**CHAIN OF CUSTODY RECORD**

Collected By (Signature) <i>Safdar Azeem</i>	Date: 08/01/24	Time:	Relinquished by (Signature) <i>Safdar Azeem</i>	Date: 08/02/24	Time: 08:35
Received by: (Signature) <i>GA</i>	Date: 8/2/24	Time: 12:56	Relinquished by: (signature) <i>GA</i>	Date: 8/2/24	Time: 15:53
Dispatched by: (Signature, if mailed)	Date:	Time:	Received for Laboratory by: <i>SK</i>	Date: 8/2/24	Time: 1553 CH1

371681

735 Remington Road  
 Schaumburg, IL 60173  
 (630) 994-2600 Fax: (312) 733-5612  
 www.gsg-consultants.com

**PLM BULK LABORATORY ANALYSIS FORM**

<b>Project Name:</b> IDOT ; I-80 IMPROVEMENT	<b>Project Manager:</b> Ted Cagney
<b>Project Number:</b> 21-2007	<b>Building Inspector:</b> Safdar Azeem
<b>Project Address:</b> 552 Market Place	<b>IDPH Number:</b> 100-10351
<b>City/ State:</b> Joliet, Illinois	<b>Work Day:</b> S M T W <u>TH</u> F S
<b>Client:</b> WSP - USA	<b>Analyze by Method:</b>
<b>Date:</b> 08/01/2024	EPA/600/R-93-116

Field Number	HA Number	Type of material, specific sample location (i.e. Room Number, Building Construction Date)
SA-552-31	11	Roof Shingle #1 - Black w/ white spots
32	↓	↓
33	↓	↓
34	12	Roof Shingle #2 - Black
35	↓	↓
36	↓	↓
37	13	Roof Tar Paper - Black
38	↓	↓
39	↓	↓

**TURN AROUND TIME:**

1 Day  
 2 Days  
3 Days  
 (5 Day) Other

**COMMENTS:** E-mail Results to:  
[epahomi@gsg-consultants.com](mailto:epahomi@gsg-consultants.com)  
[sazeem@gsg-consultants.com](mailto:sazeem@gsg-consultants.com)  
 STOP AT FIRST POSITIVE

**CHAIN OF CUSTODY RECORD**

Collected By (Signature) <u>Safdar Azeem</u>	Date: <u>08/01/24</u>	Time:	Relinquished by (Signature) <u>Safdar Azeem</u>	Date: <u>08/02/24</u>	Time: <u>08:35</u>
Received by: (Signature) <u>G B</u>	Date: <u>8/2/24</u>	Time: <u>12:56</u>	Relinquished by: (signature) <u>G B</u>	Date: <u>8/9/24</u>	Time: <u>15:53</u>
Dispatched by: (Signature, if mailed)	Date:	Time:	Received for Laboratory by: <u>EM</u>	Date: <u>8/21/24</u>	Time: <u>15:53</u>

Definitions: BLK-Bulk Sample, PLM-Polarized Light Microscopy, TEM-Transmission Electron Microscope.

## APPENDIX B

---

### Reference Photographs



**Material Description:**  
Suspect ACM White  
Caulking

**Photo Location:**  
Kitchen Counter

**ILLINOIS DEPARTMENT OF  
TRANSPORTATION  
I-80 OVER DES PLAINES RIVER BRIDGE  
IMPROVEMENTS**



GSG Consultants, Inc.  
735 Remington Road  
Schaumburg, Illinois 60173

**Date:** 8/1/24



**Material Description:**  
Suspect ACM Sink  
Undercoating

**Photo Location:**  
Kitchen

**ILLINOIS DEPARTMENT OF  
TRANSPORTATION  
I-80 OVER DES PLAINES RIVER BRIDGE  
IMPROVEMENTS**



GSG Consultants, Inc.  
735 Remington Road  
Schaumburg, Illinois 60173

**Date:** 8/1/2024



**Material Description:**  
Suspect ACM Drywall  
System & Dome light  
Insulation

**Photo Location:**  
Bedroom

**ILLINOIS DEPARTMENT OF  
TRANSPORTATION  
I-80 OVER DES PLAINES RIVER BRIDGE  
IMPROVEMENTS**



GSG Consultants, Inc.  
735 Remington Road  
Schaumburg, Illinois 60173

**Date:** 8/1/2024



**Material Description:**  
Suspect ACM 1'x1' Beige  
Ceramic Tile

**Photo Location:**  
Bathroom

**ILLINOIS DEPARTMENT OF  
TRANSPORTATION  
I-80 OVER DES PLAINES RIVER BRIDGE  
IMPROVEMENTS**



GSG Consultants, Inc.  
735 Remington Road  
Schaumburg, Illinois 60173

**Date:** 8/1/2024



**Material Description:**  
Suspect ACM 2'x1' Grey  
Ceramic Tile & White  
Caulking

**Photo Location:**  
Bathroom

**ILLINOIS DEPARTMENT OF  
TRANSPORTATION  
I-80 OVER DES PLAINES RIVER BRIDGE  
IMPROVEMENTS**



GSG Consultants, Inc.  
735 Remington Road  
Schaumburg, Illinois 60173

**Date:** 8/1/2024



**Material Description:**  
Suspect ACM Grey Plaster

**Photo Location:**  
Exterior

**ILLINOIS DEPARTMENT OF  
TRANSPORTATION  
I-80 OVER DES PLAINES RIVER BRIDGE  
IMPROVEMENTS**



GSG Consultants, Inc.  
735 Remington Road  
Schaumburg, Illinois 60173

**Date:** 8/1/2024



**Material Description:**  
Suspect ACM Roof Shingles

**Photo Location:**  
Roof

**ILLINOIS DEPARTMENT OF  
TRANSPORTATION  
I-80 OVER DES PLAINES RIVER BRIDGE  
IMPROVEMENTS**



GSG Consultants, Inc.  
735 Remington Road  
Schaumburg, Illinois 60173

**Date:** 8/1/2024



## APPENDIX D

---

### Inspector Licenses and Training Certifications



525-535 West Jefferson Street • Springfield, Illinois 62761-0001 • [www.dph.illinois.gov](http://www.dph.illinois.gov)

**SAFDAR AZEEM**  
 1 South 285 Ingersoll Lane  
 Villa Park, IL 60181

4/22/2024



ASBESTOS PROFESSIONAL LICENSE ID NUMBER: 10351

Enclosed is your Asbestos Professional License. Please note the expiration date on the card and in the image depicted below.

**COPY OF THE ASBESTOS PROFESSIONAL LICENSE**

Front of License

Back of License

		<b>ASBESTOS          PROFESSIONAL          LICENSE</b>		<b>ENDORSEMENTS</b>	<b>TC EXPIRES</b>
<b>ID NUMBER</b> 100 - 10351	<b>ISSUED</b> 4/22/2024	<b>EXPIRES</b> 05/15/2025		INSPECTOR	1/27/2025
<b>SAFDAR AZEEM</b> 1 South 285 Ingersoll Lane Villa Park, IL 60181 Environmental Health				PROJECT MANAGER AIR SAMPLING PROFESSIONAL	3/1/2025
				<b>Alteration of this license shall result in legal action</b> This license issued under authority of the State of Illinois Department of Public Health This license is valid only when accompanied by a valid training course certificate.	

If you have any questions or need further assistance, contact the Asbestos Program at (217)782-3517 or fax (217)785-5897.

Our WEB address is: [dph.illinois.gov/topics-services/environmental-health-protection/asbestos](http://dph.illinois.gov/topics-services/environmental-health-protection/asbestos)  
 EMAIL Address: [dph.asbestos@illinois.gov](mailto:dph.asbestos@illinois.gov)

## APPENDIX D

---

### Laboratory Accreditations

United States Department of Commerce  
National Institute of Standards and Technology



---

**Certificate of Accreditation to ISO/IEC 17025:2017**

---

NVLAP LAB CODE: 101202-0

**STAT Analysis Corporation**  
Chicago, IL

*is accredited by the National Voluntary Laboratory Accreditation Program for specific services,  
listed on the Scope of Accreditation, for:*

**Asbestos Fiber Analysis**

*This laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2017.  
This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality  
management system (refer to joint ISO-ILAC-IAF Communique on ISO/IEC 17025).*

---

2024-07-01 through 2025-06-30

*Effective Dates*



A handwritten signature in blue ink, appearing to read "Dana S. Haman".

---

*For the National Voluntary Laboratory Accreditation Program*

**SCOPE OF ACCREDITATION TO ISO/IEC 17025:2017**

**STAT Analysis Corporation**

Sterling Labs

2242 W. Harrison St. Suite 200

Chicago, IL 60612

Carolyn Mazzuca

Phone: 312-733-0551

Email: cmazzuca@statanalysis.com

**ASBESTOS FIBER ANALYSIS**

**NVLAP LAB CODE 101202-0**

**Bulk Asbestos Analysis**

**Code**

**Description**

18/A01

EPA -- 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples

18/A03

EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials


**Airborne Asbestos Analysis**

**Code**

**Description**

18/A02

U.S. EPA's "Interim Transmission Electron Microscopy Analytical Methods-Mandatory and Nonmandatory-and Mandatory Section to Determine Completion of Response Actions" as found in 40 CFR, Part 763, Subpart E, Appendix A.

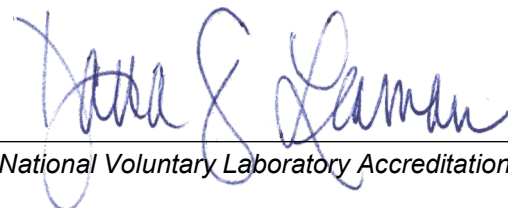

*For the National Voluntary Laboratory Accreditation Program*