

TYPICAL EXCAVATION DETAIL TYPE "A", "E", "G" OR "X" MANHOLE



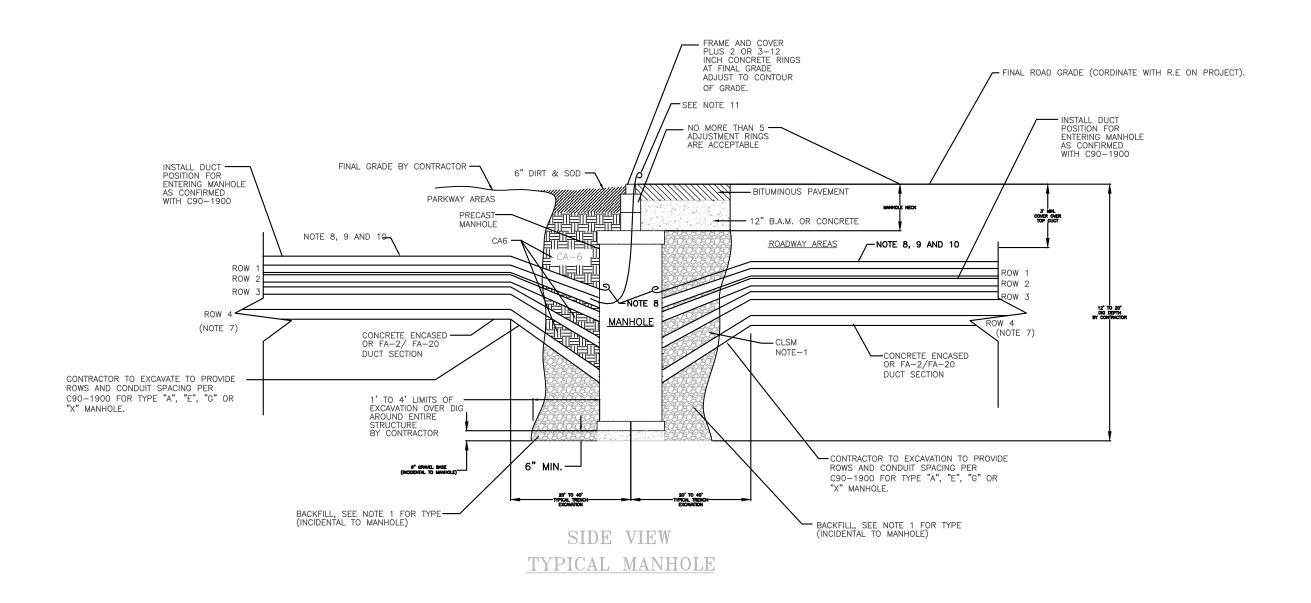

NOTE:

- CA-6 BACKFILL TO BE PLACED 360 DEGREES AROUND MANHOLES TO GRADE. MINUS SURFACE RESTORATION. WHERE MANHOLE IS WITHIN 5' OF CA-6 BACKFILL TO BE PLACED 360 DEGREES AROUND MANHOLES TO GRADE. MINUS SURFACE RESTORATION. WHERE MANHOLE IS WITHIN 5 O ROADWAY, CLSM BACKFILL TO BE USED TO FILL TO POP ROOF OF MANHOLE AND CA-6 BACKFILL TO FILL TO GRADE.

 SEE MANHOLE DETAIL DRAWINGS FOR DIMENSIONS AND WEIGHT.

 CONTRACTOR TO ESTABLISH FINAL ELEVATION, LEVEL AND GRADE FOR MANHOLE.

 MANHOLES DELIVERED TO SITE BY MANUFACTURER. CONTRACTOR TO COORDINATE UNLOAD, STORE AND INSTALL (TAIL GATE DELIVERY BY UCP).

- CONTRACTOR SHALL SUPPORT AND REROUTE UTILITIES AS REQUIRED.
- CONTRACTOR SHALL INSTALL CONDUIT INTO MANHOLES PER C30-1900, AND IS PART OF PRICE TO INSTALL MANHOLE.

- ROWS 5 AND 6 OMITTED FOR CLARITY.

 ABOUT 20 FEET OF 4/0 BARE COPPER CONDUCTOR FOR TAIL (COUNTER POISE).

 INSTALL 250 FEET OF 4/0 BARE COPPER CONDUCTOR ABOVE DUCT BANK, COUNTER POISE, IF NEEDED IN 2 DIRECTIONS.
- CORE DRILL 1 1/2" HOLE THRU WALL OF 6" THICK MANHOLE WALL TO CONNECT COUNTER POISE. IF KNOCK OUTS ARE NOT INSTALLED.
- 11. INSTALL #12 THHN WIRE (25' AND COIL) FROM MIDDLE DUCT TO MANHOLE COVER, LEAVING 12" TAIL (USED FOR LOCATING).

 12. ALL OF THE ABOVE ITEMS AND DETAIL EXCEPT ITEM 9, ARE INCLUDED IN THE COST OF INSTALLING THE MANHOLE.
- 13. INSTALL MANHOLE PER O.S.H.A REGULATIONS OF LATEST ISSUE.

ROUTE 59 ROAD IMPROVEMENTS					
PROJECT DESCRIPTION DETAILS AND STANDARDS					
ENGINEER BCC		DRAFTING DATE 5-11-12	MAP # 4211,4212,4223	N.T.S.	
GIS DESIGN BY	PSM	REVISIONS DATE	AT&T JOINT AGREEMENT #	PROJECT # EU-12	
GIS DESIGN BY DL CHECKED BY				PROJECT # EU-12 SHEET #	