


Cable splices according to Art 1066.06 (b) with compression connectors appropriately taped.

Stainless steel standard grade wire cloth, 6x6 (1/4") mesh or less with #16 gauge (0.062") diameter or heavier wire.

Attach with 1/2" stainless steel banding or tie back on itself with stainless steel wire ties. Finished installation must prevent rodent entry.

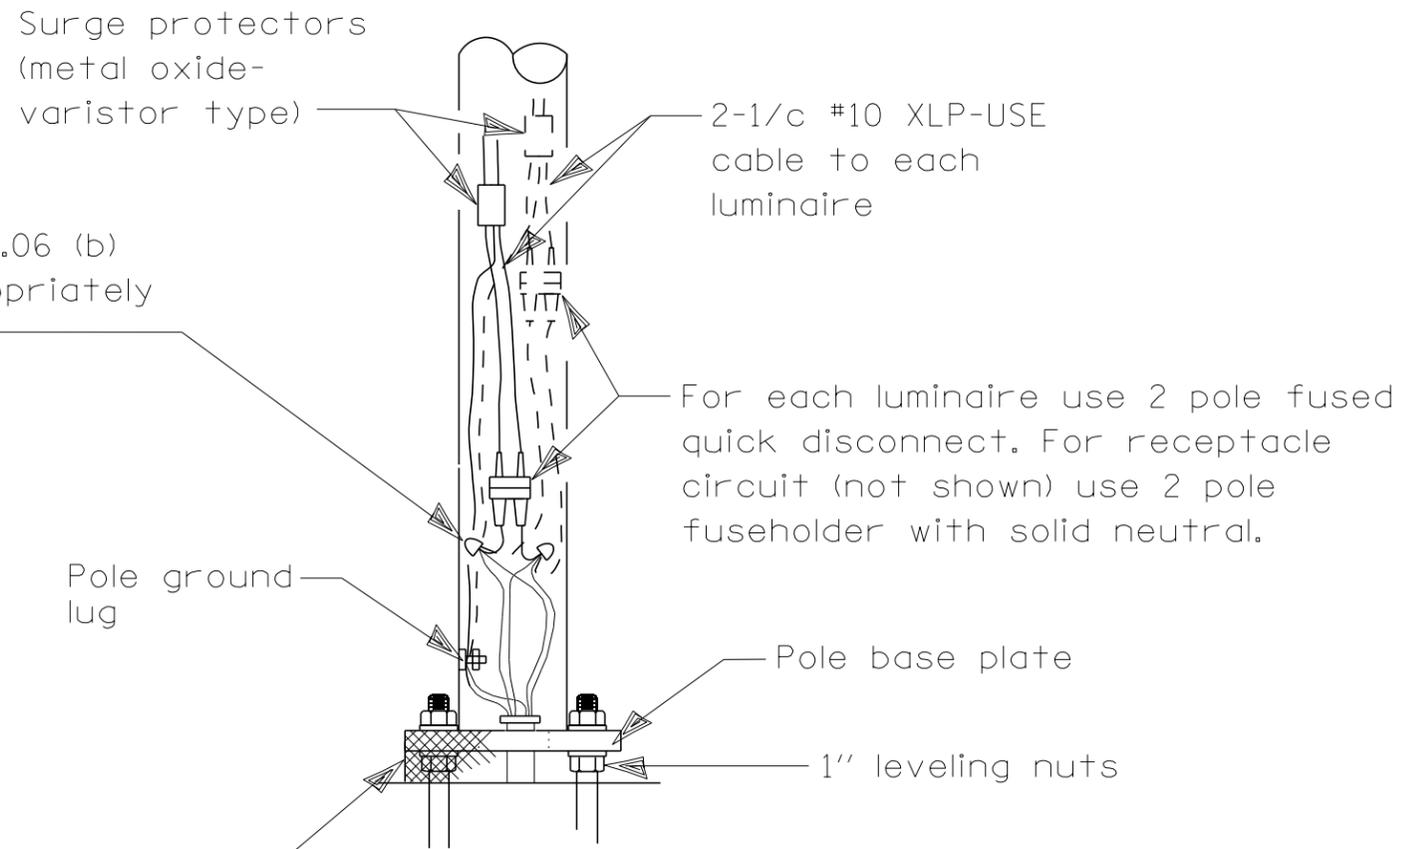

POLE WIRING DETAIL

NO SCALE

GENERAL NOTES

All cable splices shall be shrink tube unless another method has been specifically approved by the Engineer.

For example purposes the pole is shown on an anchor base. If the pole is required to be set on a breakaway base, consult the Standard Specifications.

All dimensions are in millimeters (inches) unless otherwise shown.

FILE NAME =	DESIGNED -	REVISED -		STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	LIGHTING DETAILS POLE WIRING DETAILS		F.A.I. RTÉ.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
...D468620-sh-1-Lighting-Details_PoleHandhold	DRAWN -	REVISED -					90-114R(14HB-4,14,14HVB)BR	TAZEWELL	2433	1825	
USER NAME = tblank	CHECKED -	REVISED -			CONTRACT NO. 68620				ILLINOIS FED. AID PROJECT		
PLOT DATE = 9/5/2012	DATE - JULY 20, 2012	REVISED -			SCALE:	SHEET NO. 110 OF 138 SHEETS	STA.	TO STA.			