


GENERAL NOTES

Stainless steel conduit, couplings, and elbows shall be according to Section 810 of the Standard Specifications, as applicable, shall be Type 304 or Type 316, and shall be manufactured according to UL Standard 6A and ANSI Standard C 80.1.


Conduit fittings shall be the threaded type, shall be Type 304 or Type 316 stainless steel, and shall be manufactured according to UL Standard 514B.

All stainless steel and liquid tight flexible non-metallic conduit, including all fittings, bushings, couplings, and elbows shall be included in the cost of the "Junction Box, Stainless Steel, Attached to Structure, 12" X 12" X 8" pay item.

All dimensions are in millimeters (inches) unless otherwise shown.

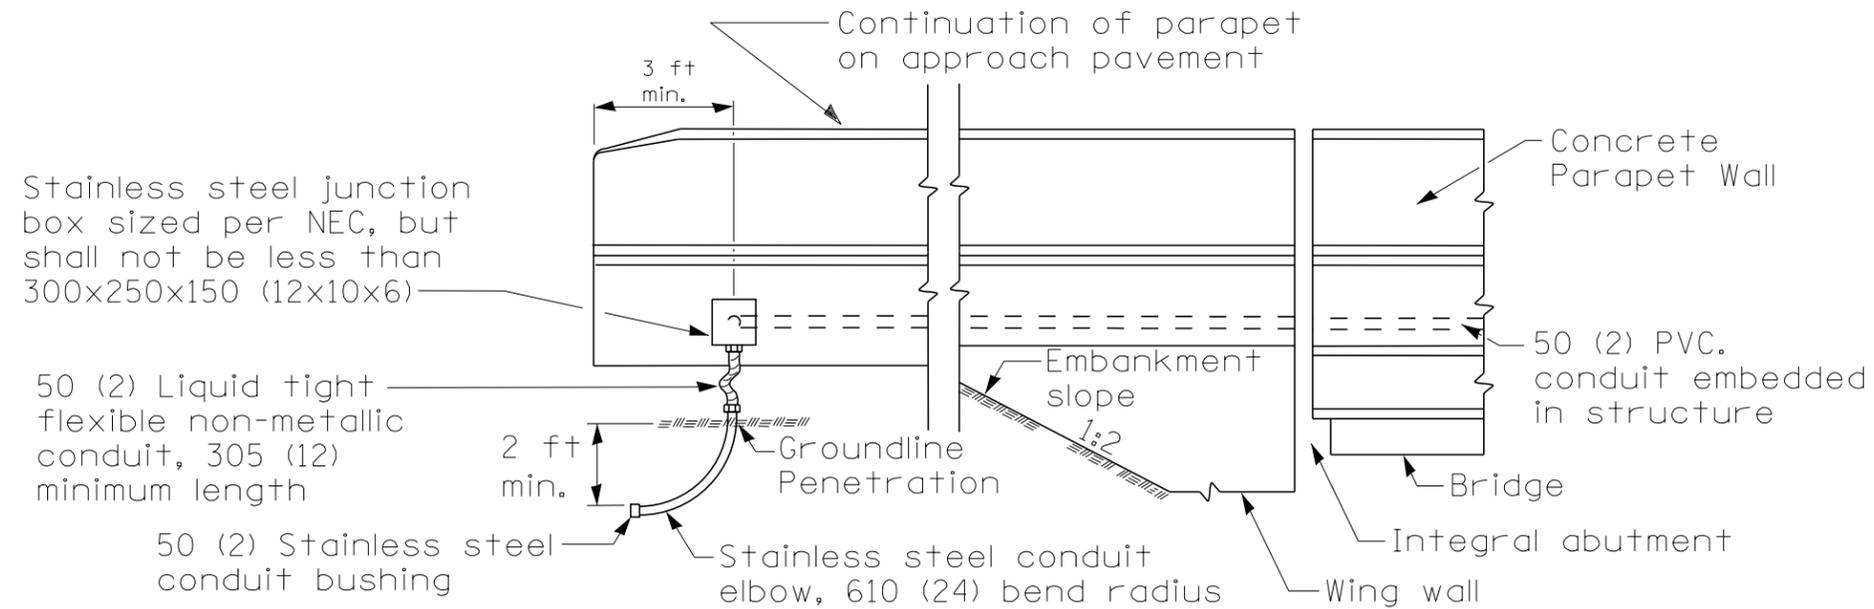

CONDUIT DETAIL
(Integral Abutment)

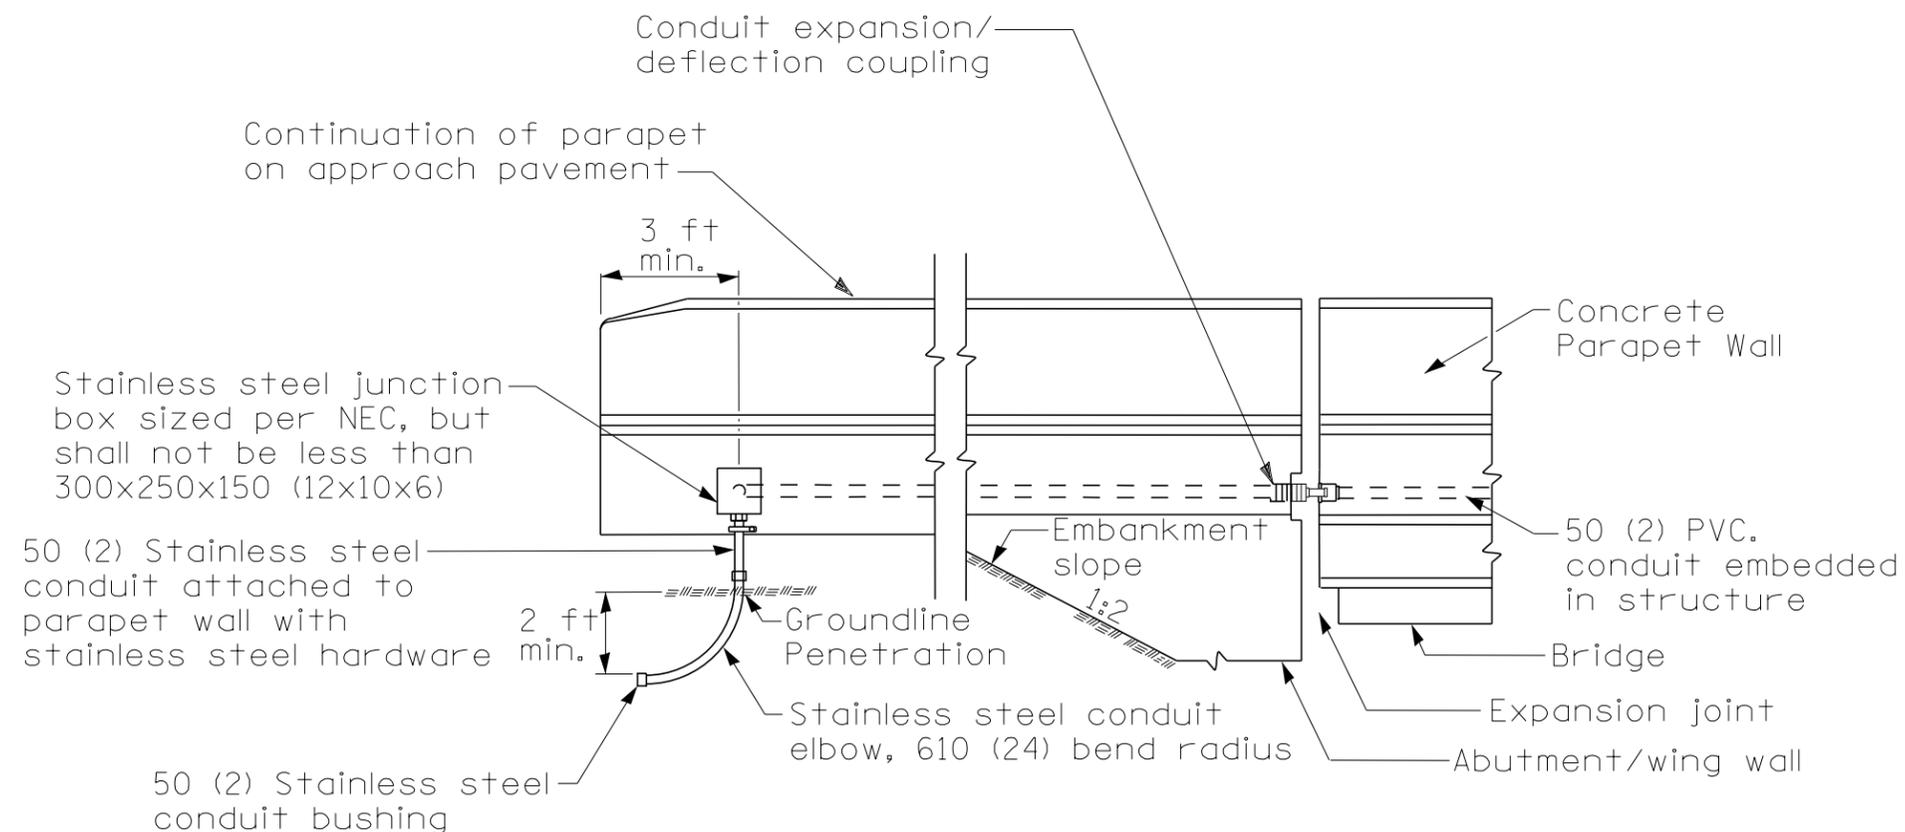

CONDUIT DETAIL
(Open Abutment)

FILE NAME =	DESIGNED -	REVISED -		STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	LIGHTING DETAILS CONDUIT AT BRIDGE APPROACH		F.A.I. RTÉ.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
...D468620-shit-Lighting-Details-ConduitAppP	DRAWN -	REVISED -					90-114R(14HB-4,14,14HVB)BR	TAZEWELL	2433	1827	
USER NAME = tblank	CHECKED -	REVISED -			CONTRACT NO. 68620						
PLOT DATE = 9/5/2012	DATE - JULY 20, 2012	REVISED -			SCALE:	SHEET NO. 112 OF 138 SHEETS	STA.	TO STA.	ILLINOIS FED. AID PROJECT		