




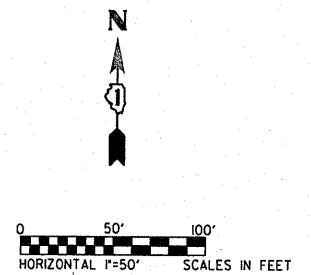
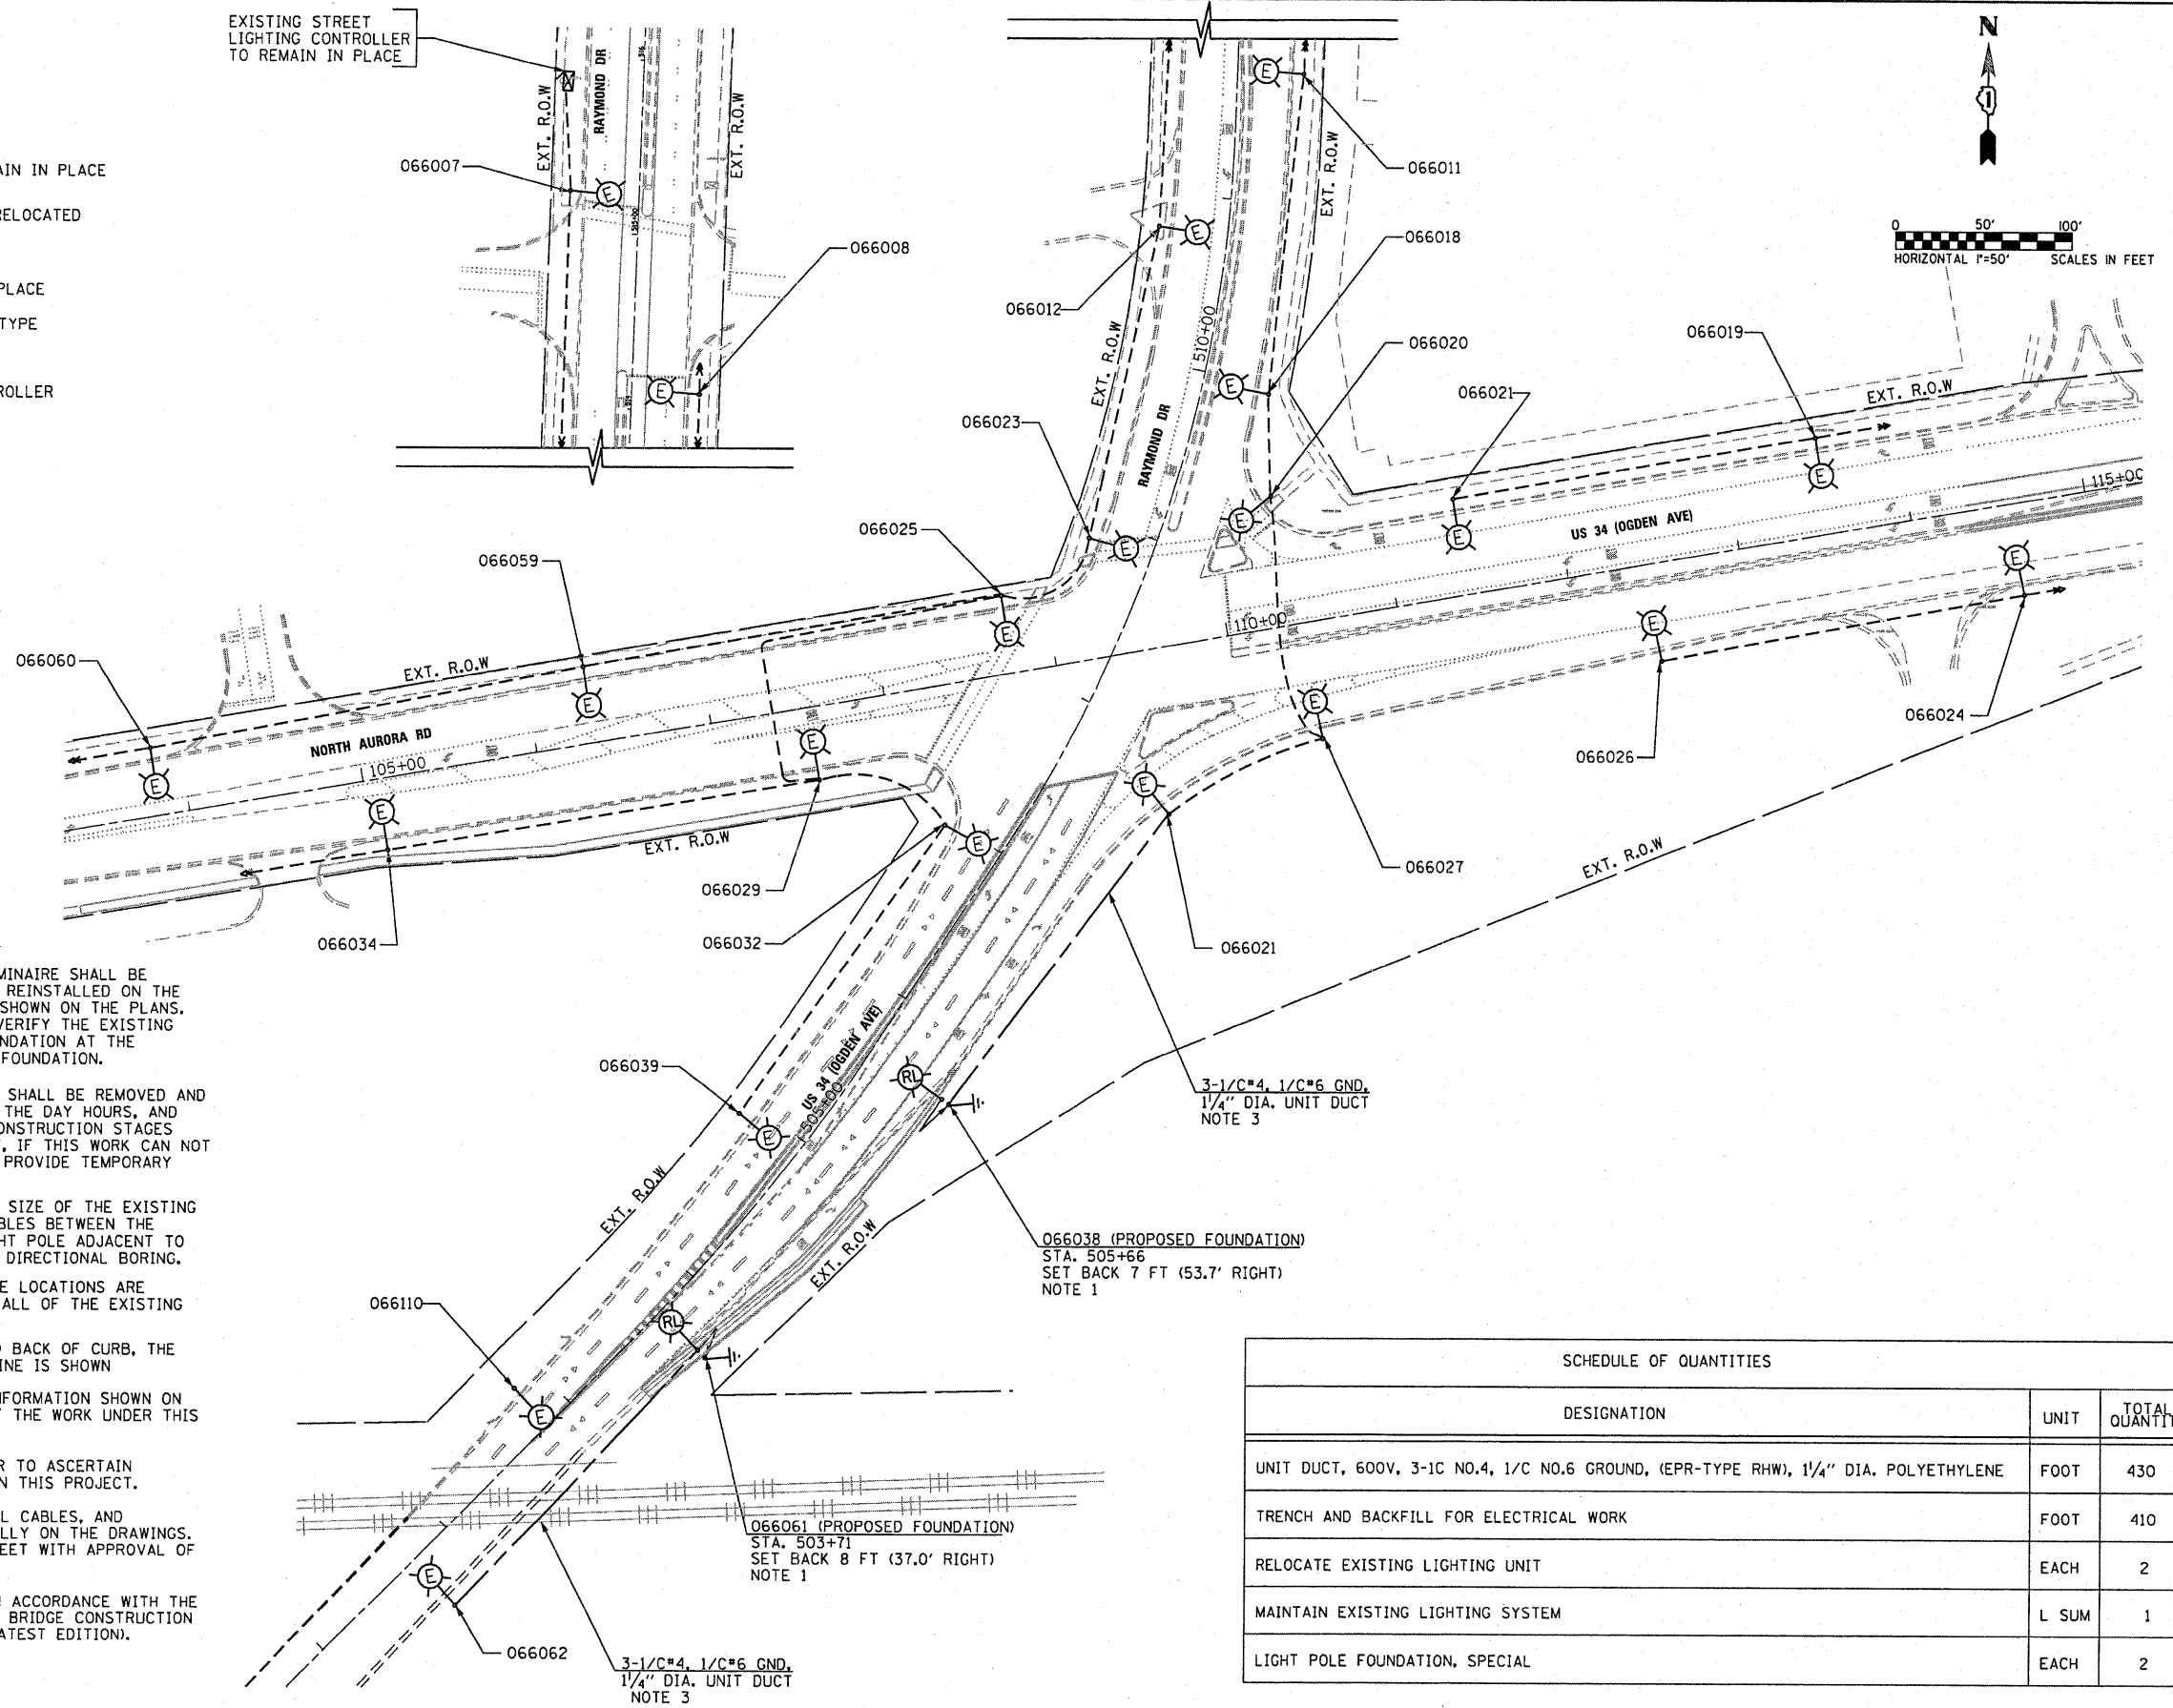


LIGHTING LEGEND

-  EXISTING LIGHTING UNIT TO REMAIN IN PLACE
-  EXISTING LIGHTING UNIT TO BE RELOCATED PRIOR TO CONSTRUCTION
-  EXISTING CABLES TO REMAIN IN PLACE
-  PROPOSED UNIT DUCT, SIZE AND TYPE AS SHOWN ON THE PLANS
-  EXISTING STREET LIGHTING CONTROLLER



NOTES:

1. THE EXISTING LIGHT POLE, MAST ARM, AND LUMINAIRE SHALL BE REMOVED FROM THE EXISTING FOUNDATION AND REINSTALLED ON THE NEW FOUNDATION AT THE PROPOSED LOCATION SHOWN ON THE PLANS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE EXISTING FOUNDATION BEFORE CONSTRUCTING A NEW FOUNDATION AT THE PROPOSED LOCATION, TO MATCH THE EXISTING FOUNDATION.
2. ALL EXISTING LIGHT POLES MARKED WITH "RL" SHALL BE REMOVED AND REINSTALLED ON THE NEW FOUNDATION DURING THE DAY HOURS, AND SHALL BE OPERATIONAL BEFORE ALL OF THE CONSTRUCTION STAGES START. THIS WORK SHALL BE DONE IN ONE DAY, IF THIS WORK CAN NOT BE DONE IN ONE DAY, THE CONTRACTOR SHALL PROVIDE TEMPORARY LIGHTING AT THE EFFECTED AREA.
3. THE CONTRACTOR SHALL VERIFY THE TYPE AND SIZE OF THE EXISTING CABLES TO MATCH THEM, AND INSTALL NEW CABLES BETWEEN THE RELOCATED LIGHT POLE AND THE EXISTING LIGHT POLE ADJACENT TO IT. THE UNIT DUCTS SHALL BE INSTALLED BY DIRECTIONAL BORING.
4. ALL OF THE EXISTING LIGHT POLES AND CABLE LOCATIONS ARE APPROXIMATE, THE CONTRACTOR SHALL VERIFY ALL OF THE EXISTING CABLES AND CONNECTIONS IN THE FIELD.
5. SET BACKS ARE MEASURED FROM THE PROPOSED BACK OF CURB, THE OFFSET OF THE FOUNDATIONS FROM THE BASELINE IS SHOWN
6. THE CONTRACTOR SHALL VERIFY ALL OF THE INFORMATION SHOWN ON THE CONTRACT DRAWINGS, WHICH WOULD AFFECT THE WORK UNDER THIS CONTRACT.
7. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ASCERTAIN EXISTING FIELD CONDITIONS BEFORE BIDDING ON THIS PROJECT.
8. ALL NEW CONDUITS, UNIT DUCTS, DIRECT BURIAL CABLES, AND APPURTENANCES ARE INDICATED DIAGRAMMATICALLY ON THE DRAWINGS. THE ACTUAL LOCATIONS IN THE FIELD SHALL MEET WITH APPROVAL OF THE ENGINEER.
9. THE ELECTRICAL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE IDOT STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION AND ASSOCIATED SUPPLEMENTAL CONDITIONS (LATEST EDITION).

SCHEDULE OF QUANTITIES		
DESIGNATION	UNIT	TOTAL QUANTITY
UNIT DUCT, 600V, 3-1C NO.4, 1/C NO.6 GROUND, (EPR-TYPE RHW), 1/4" DIA. POLYETHYLENE	FOOT	430
TRENCH AND BACKFILL FOR ELECTRICAL WORK	FOOT	410
RELOCATE EXISTING LIGHTING UNIT	EACH	2
MAINTAIN EXISTING LIGHTING SYSTEM	L SUM	1
LIGHT POLE FOUNDATION, SPECIAL	EACH	2

GO GANDHI AND ASSOCIATES, INC.
ENGINEERS AND PLANNERS
6035 N. NORTHWEST HIGHWAY
SUITE 306
CHICAGO, ILLINOIS 60631 TEL: (773) 774-5910

FILE NAME =	USER NAME = .GAL	DESIGNED - PKG	REVISED -
#FILE#		DRAWN - MAA, SHM	REVISED -
		CHECKED - PKG	REVISED -
		DATE - 5/27/2011	REVISED -

**STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION**

PROPOSED LIGHTING PLAN

SCALE: 1" = 50' SHEET NO. OF SHEETS STA. TO STA.

F.A.P. RTE. 311	SECTION 652X-N-3	COUNTY DUPAGE	TOTAL SHEETS 34	SHEET NO. 22
FINAL CONTRACT NO. 60L22			FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT	