

### So-Deep Test Hole Certification Form - Metric

City, County, State: CITY OF YORKVILLE, IL  
 Gen. Loc: S.R. 47 IN FRONT OF HOUSE #701  
 Recorded Size/Material/Type: 51MM UNK TYPE (NICOR) GAS LINE  
 Foreman/Truck#/Form By: J. CLINE / 219 / R. MOONEY

Control # 22  
 Test Hole # 38  
 Plan Scale 1:250  
 Sheet # 36  
 Proposed Date JULY 14, 2009

So-Deep Corporate Office  
 8397 Euclid Avenue  
 Manassas Park, VA 20111  
 (703)361-6005

B.M. 1 Elev = 193.922M  
 is GIVEN  
 Description: CHIS "X" SET TOP RIM SMH, 24M± LT OF CL STA 21+947±, S.R. 47

B.M. 2 Elev = 193.763M  
 is GIVEN  
 Description: CHIS "X" SET TOP RIM CB, 7M± LT OF CL STA 21+937±, S.R. 47



Benchmarks check BY 0.006M  
 Elevations are referenced to B.M.#1

Recorded Size/Type of utility WAS FOUND  
 Existing Grade of GRASS RW  
 Survey Mark PEG (set by SO-DEEP) Elev. 193.163M

There WERE NOT additional utilities in the test hole  
 The utility WAS in good condition.  
 Paving Thickness and type NO PAVING  
 Color of ribbon installed YELLOW  
 Soil Type MOIST BROWN  
 Field Condition IN GRASS RW  
 T.H. tied to PEG

4MM PLASTIC COATED STL. GAS LINE  
 Size/Material/Type  
 Portion of pipe exposed for O.D. measurement  
 FULL

Remarks: NONE

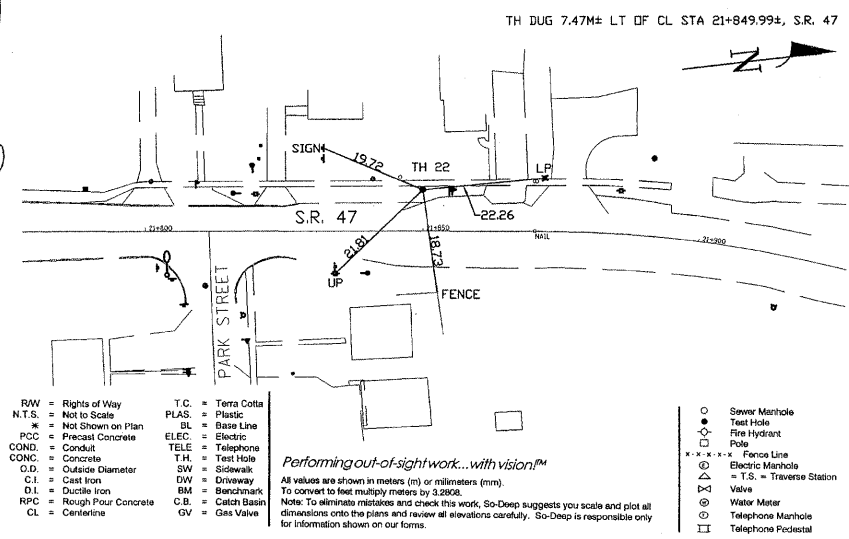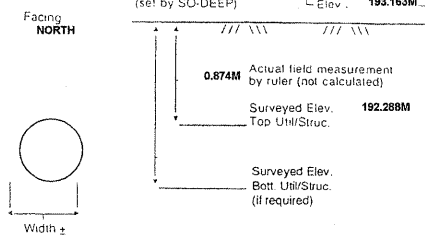

- R/W = Rights of Way
- N.T.S. = Not to Scale
- PCC = Precast Concrete
- COND. = Conduit
- CONC. = Concrete
- O.D. = Outside Diameter
- C.I. = Cast Iron
- D.I. = Ductile Iron
- RPC = Rough Pour Concrete
- CL = Centerline
- T.C. = Terra Cotta
- PLAS. = Plastic
- BL = Base Line
- ELEC. = Electric
- TELE = Telephone
- T.H. = Test Hole
- SW = Sidewalk
- DW = Driveway
- BM = Benchmark
- C.B. = Catch Basin
- GV = Gas Valve
- Sewer Manhole
- Test Hole
- Fire Hydrant
- Pole
- Fence Line
- Electric Manhole
- T.S. = Traverse Station
- Water Meter
- Telephone Manhole
- Telephone Pedestal

Performing out-of-sight work...with vision™  
 All values are shown in meters (m) or millimeters (mm).  
 To convert to feet multiply meters by 3.2808.  
 Note: To eliminate mistakes and check this work, So-Deep suggests you scale and plot all dimensions onto the plans and review all elevations carefully. So-Deep is responsible only for information shown on our forms.

### So-Deep Test Hole Certification Form - Metric

City, County, State: CITY OF YORKVILLE, IL  
 Gen. Loc: S.R. 47 IN FRONT OF HOUSE #701  
 Recorded Size/Material/Type: UNK. SIZE & TYPE (AT&T) TELE. LINE  
 Foreman/Truck#/Form By: J. CLINE / 219 / R. MOONEY

Control # 23  
 Test Hole # 1:250  
 Plan Scale 36  
 Sheet # 36  
 Proposed Date JULY 14, 2009

So-Deep Corporate Office  
 8397 Euclid Avenue  
 Manassas Park, VA 20111  
 (703)361-6005

B.M. 1 Elev = 193.962M  
 is GIVEN  
 Description: CHIS "X" SET TOP RIM SMH, 24M± LT OF CL STA 21+947±, S.R. 47

B.M. 2 Elev = 193.763M  
 is GIVEN  
 Description: CHIS "X" SET TOP RIM CB, 7M± LT OF CL STA 21+937±, S.R. 47



Benchmarks check BY 0.006M  
 Elevations are referenced to B.M.#1

Recorded Size/Type of utility WAS FOUND  
 Existing Grade of CONC. SW  
 Survey Mark CHIS "X" (set by SO-DEEP) Elev. 193.181M

There WERE NOT additional utilities in the test hole  
 The utility WAS in good condition.  
 Paving Thickness and type NO PAVING  
 Color of ribbon installed YELLOW  
 Soil Type MOIST BROWN  
 Field Condition IN GRASS RW  
 T.H. tied to CHIS "X"

0.33M H. PRE CAST CONC. TELE. DUCT  
 Size/Material/Type  
 Portion of pipe exposed for O.D. measurement  
 N/A

Remarks: NONE

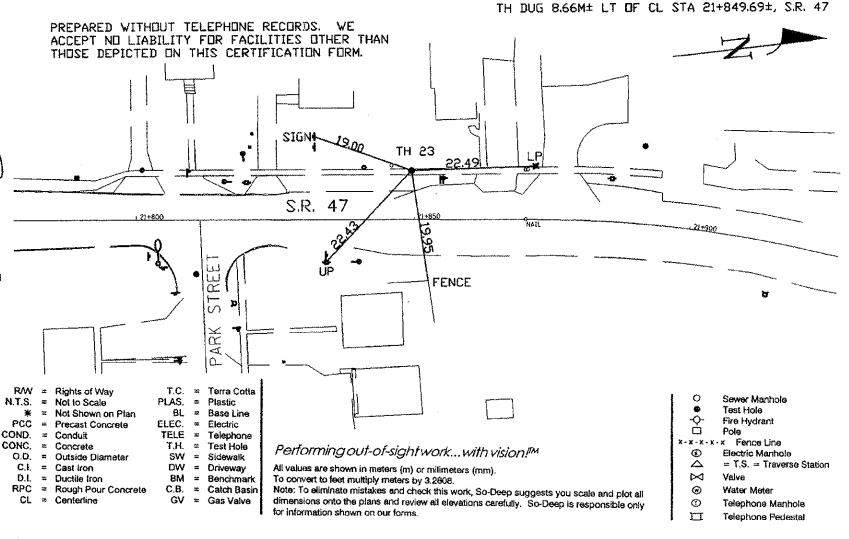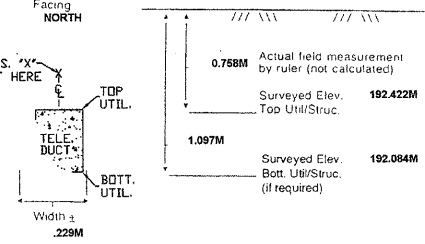

- R/W = Rights of Way
- N.T.S. = Not to Scale
- PCC = Precast Concrete
- COND. = Conduit
- CONC. = Concrete
- O.D. = Outside Diameter
- C.I. = Cast Iron
- D.I. = Ductile Iron
- RPC = Rough Pour Concrete
- CL = Centerline
- T.C. = Terra Cotta
- PLAS. = Plastic
- BL = Base Line
- ELEC. = Electric
- TELE = Telephone
- T.H. = Test Hole
- SW = Sidewalk
- DW = Driveway
- BM = Benchmark
- C.B. = Catch Basin
- GV = Gas Valve
- Sewer Manhole
- Test Hole
- Fire Hydrant
- Pole
- Fence Line
- Electric Manhole
- T.S. = Traverse Station
- Water Meter
- Telephone Manhole
- Telephone Pedestal

Performing out-of-sight work...with vision™  
 All values are shown in meters (m) or millimeters (mm).  
 To convert to feet multiply meters by 3.2808.  
 Note: To eliminate mistakes and check this work, So-Deep suggests you scale and plot all dimensions onto the plans and review all elevations carefully. So-Deep is responsible only for information shown on our forms.

### So-Deep Test Hole Certification Form - Metric

City, County, State: CITY OF YORKVILLE, IL  
 Gen. Loc: S.R. 47, JUST N OF APPLE TREE COURT  
 Recorded Size/Material/Type: UNK. SIZE & TYPE (NICOR) GAS LINE  
 Foreman/Truck#/Form By: J. CLINE / 219 / R. MOONEY

Control # 24  
 Test Hole # 1:250  
 Plan Scale 37  
 Sheet # 36  
 Proposed Date JULY 13, 2009

So-Deep Corporate Office  
 8397 Euclid Avenue  
 Manassas Park, VA 20111  
 (703)361-6005

B.M. 1 Elev = 193.962M  
 is GIVEN  
 Description: CHIS "X" SET TOP RIM SMH, 24M± LT OF CL STA 21+947±, S.R. 47

B.M. 2 Elev = 193.763M  
 is GIVEN  
 Description: CHIS "X" SET TOP RIM CB, 7M± LT OF CL STA 21+937±, S.R. 47



Benchmarks check BY 0.006M  
 Elevations are referenced to B.M.#1

Recorded Size/Type of utility WAS FOUND  
 Existing Grade of GRASS RW  
 Survey Mark PEG (set by SO-DEEP) Elev. 193.638M

There WERE NOT additional utilities in the test hole  
 The utility WAS in good condition.  
 Paving Thickness and type NO PAVING  
 Color of ribbon installed YELLOW  
 Soil Type MOIST BROWN  
 Field Condition IN GRASS RW  
 T.H. tied to PEG

41MM PLASTIC GAS LINE  
 Size/Material/Type  
 Portion of pipe exposed for O.D. measurement  
 FULL

Remarks: NONE

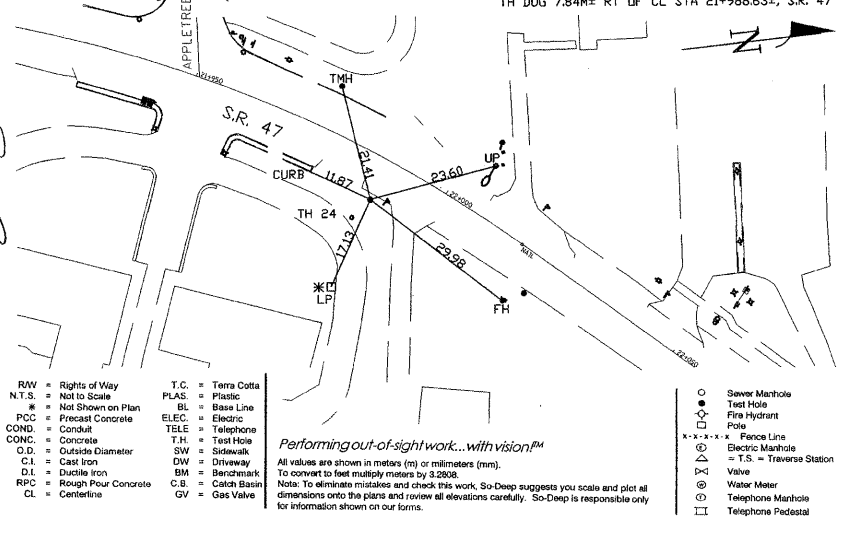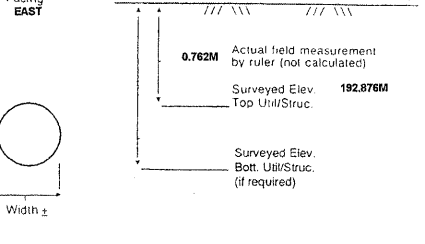

- R/W = Rights of Way
- N.T.S. = Not to Scale
- PCC = Precast Concrete
- COND. = Conduit
- CONC. = Concrete
- O.D. = Outside Diameter
- C.I. = Cast Iron
- D.I. = Ductile Iron
- RPC = Rough Pour Concrete
- CL = Centerline
- T.C. = Terra Cotta
- PLAS. = Plastic
- BL = Base Line
- ELEC. = Electric
- TELE = Telephone
- T.H. = Test Hole
- SW = Sidewalk
- DW = Driveway
- BM = Benchmark
- C.B. = Catch Basin
- GV = Gas Valve
- Sewer Manhole
- Test Hole
- Fire Hydrant
- Pole
- Fence Line
- Electric Manhole
- T.S. = Traverse Station
- Water Meter
- Telephone Manhole
- Telephone Pedestal

Performing out-of-sight work...with vision™  
 All values are shown in meters (m) or millimeters (mm).  
 To convert to feet multiply meters by 3.2808.  
 Note: To eliminate mistakes and check this work, So-Deep suggests you scale and plot all dimensions onto the plans and review all elevations carefully. So-Deep is responsible only for information shown on our forms.

REVISIONS		ILLINOIS DEPARTMENT OF TRANSPORTATION
NAME	DATE	
		UTILITY TEST HOLE RECORD
DATE		DRAWN BY
		CHECKED BY