


F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
326	(5CS,13C,108,109)R	KENDALL	931	404
STA.	TO STA.			
FED. ROAD DIST. NO.	ILLINOIS	FED. AID PROJECT		



So-Deep Test Hole Certification Form - Metric

The Subsurface Utility Engineering Company
449 Munroe Falls Road
Tallmadge, OH 44278
(330) 794-4455

So-Deep Corporate Office
8397 Euclid Avenue
Manassas Park, VA 20111
(703)361-6005

City, County, State: CITY OF YORKVILLE, IL
Gen. Loc. S.R. 47 JUST N OF COLONIAL PARKWAY
Recorded Size/Material/Type: 102MM UNK. TYPE (NICOR) GAS LINE
Foreman/Truck/Form By: J. CLINE / 219 / R. MOONEY

B.M. 1 Elev. = 201.400M
is GIVEN
Description: CHIS "X" SET TOP RIM SMH, 7M± RT OF CL STA 20+000±, S.R. 47

B.M. 2 Elev. = 201.021M
is GIVEN
Description: CHIS "X" SET TOP RIM STM MH, 8M± RT OF CL STA 20+080±, S.R. 47

Benchmarks check BY 0.010M
Elevations are referenced to B.M.#1

Recorded Size/Type of utility WAS FOUND
There WERE NOT additional utilities in the test hole


The utility WAS in good condition.
Paving Thickness and type NO PAVING

Color of ribbon installed YELLOW
Soil Type MOIST BROWN

Field Condition CONC. DITCH
T.H. tied to CHIS "X"

121MM COATED STL. GAS LINE
Size/Material/Type
Portion of pipe exposed for O.D. measurement: FULL

Remarks: NONE



So-Deep Test Hole Certification Form - Metric

The Subsurface Utility Engineering Company
449 Munroe Falls Road
Tallmadge, OH 44278
(330) 794-4455

So-Deep Corporate Office
8397 Euclid Avenue
Manassas Park, VA 20111
(703)361-6005

City, County, State: CITY OF YORKVILLE, IL
Gen. Loc. S.R. 47 JUST N OF WASHINGTON ST.
Recorded Size/Material/Type: 64MM UNK. TYPE (NICOR) GAS LINE
Foreman/Truck/Form By: J. CLINE / 219 / R. MOONEY

B.M. 1 Elev. = 195.129M
is GIVEN
Description: CHIS "X" SET TOP RIM CB, 6M± RT OF CL STA 20+503±, S.R. 47

B.M. 2 Elev. = 195.222M
is GIVEN
Description: CHIS "X" SET TOP RIM CB, 6M± LT OF CL STA 20+501±, S.R. 47

Benchmarks check BY 0.001M
Elevations are referenced to B.M.#2

Recorded Size/Type of utility WAS FOUND
There WERE NOT additional utilities in the test hole

The utility WAS in good condition.
Paving Thickness and type NO PAVING

Color of ribbon installed YELLOW
Soil Type MOIST BROWN

Field Condition IN GRASS RW
T.H. tied to PEG

64MM PLASTIC COATED STL. GAS LINE
Size/Material/Type
Portion of pipe exposed for O.D. measurement: FULL

Remarks: NONE



So-Deep Test Hole Certification Form - Metric

The Subsurface Utility Engineering Company
449 Munroe Falls Road
Tallmadge, OH 44278
(330) 794-4455

So-Deep Corporate Office
8397 Euclid Avenue
Manassas Park, VA 20111
(703)361-6005

City, County, State: CITY OF YORKVILLE, IL
Gen. Loc. S.R. 47 JUST N OF SPRING ST.
Recorded Size/Material/Type: 64MM UNK. TYPE (NICOR) GAS LINE
Foreman/Truck/Form By: J. CLINE / 219 / R. MOONEY

B.M. 1 Elev. = 190.533M
is GIVEN
Description: CHIS "X" SET TOP RIM STM MH, 11M± LT OF CL STA 21+600±, S.R. 47

B.M. 2 Elev. = 190.734M
is GIVEN
Description: CHIS "X" SET TOP RIM STM MH, 12M± RT OF CL STA 21+684±, S.R. 47

Benchmarks check BY 0.009M
Elevations are referenced to B.M.#2

Recorded Size/Type of utility WAS FOUND
There WERE NOT additional utilities in the test hole

The utility WAS in good condition.
Paving Thickness and type NO PAVING

Color of ribbon installed YELLOW
Soil Type MOIST BROWN

Field Condition IN GRASS RW
T.H. tied to PEG

64MM COATED STL. GAS LINE
Size/Material/Type
Portion of pipe exposed for O.D. measurement: FULL

Remarks: NONE



So-Deep Test Hole Certification Form - Metric

The Subsurface Utility Engineering Company
449 Munroe Falls Road
Tallmadge, OH 44278
(330) 794-4455

So-Deep Corporate Office
8397 Euclid Avenue
Manassas Park, VA 20111
(703)361-6005

City, County, State: CITY OF YORKVILLE, IL
Gen. Loc. S.R. 47 JUST N OF WASHINGTON ST.
Recorded Size/Material/Type: 64MM UNK. TYPE (NICOR) GAS LINE
Foreman/Truck/Form By: J. CLINE / 219 / R. MOONEY

B.M. 1 Elev. = 195.129M
is GIVEN
Description: CHIS "X" SET TOP RIM CB, 6M± RT OF CL STA 20+503±, S.R. 47

B.M. 2 Elev. = 195.222M
is GIVEN
Description: CHIS "X" SET TOP RIM CB, 6M± LT OF CL STA 20+501±, S.R. 47

Benchmarks check BY 0.001M
Elevations are referenced to B.M.#2

Recorded Size/Type of utility WAS FOUND
There WERE NOT additional utilities in the test hole

The utility WAS in good condition.
Paving Thickness and type NO PAVING

Color of ribbon installed YELLOW
Soil Type MOIST BROWN

Field Condition IN GRASS RW
T.H. tied to PEG

64MM PLASTIC COATED STL. GAS LINE
Size/Material/Type
Portion of pipe exposed for O.D. measurement: FULL

Remarks: NONE



So-Deep Test Hole Certification Form - Metric

The Subsurface Utility Engineering Company
449 Munroe Falls Road
Tallmadge, OH 44278
(330) 794-4455

So-Deep Corporate Office
8397 Euclid Avenue
Manassas Park, VA 20111
(703)361-6005

City, County, State: CITY OF YORKVILLE, IL
Gen. Loc. S.R. 47 JUST N OF SPRING ST.
Recorded Size/Material/Type: 64MM UNK. TYPE (NICOR) GAS LINE
Foreman/Truck/Form By: J. CLINE / 219 / R. MOONEY

B.M. 1 Elev. = 190.533M
is GIVEN
Description: CHIS "X" SET TOP RIM STM MH, 11M± LT OF CL STA 21+600±, S.R. 47

B.M. 2 Elev. = 190.734M
is GIVEN
Description: CHIS "X" SET TOP RIM STM MH, 12M± RT OF CL STA 21+684±, S.R. 47

Benchmarks check BY 0.009M
Elevations are referenced to B.M.#2

Recorded Size/Type of utility WAS FOUND
There WERE NOT additional utilities in the test hole




The utility WAS in good condition.
Paving Thickness and type NO PAVING

Color of ribbon installed YELLOW
Soil Type MOIST BROWN

Field Condition IN GRASS RW
T.H. tied to PEG

64MM COATED STL. GAS LINE
Size/Material/Type
Portion of pipe exposed for O.D. measurement: FULL

Remarks: NONE

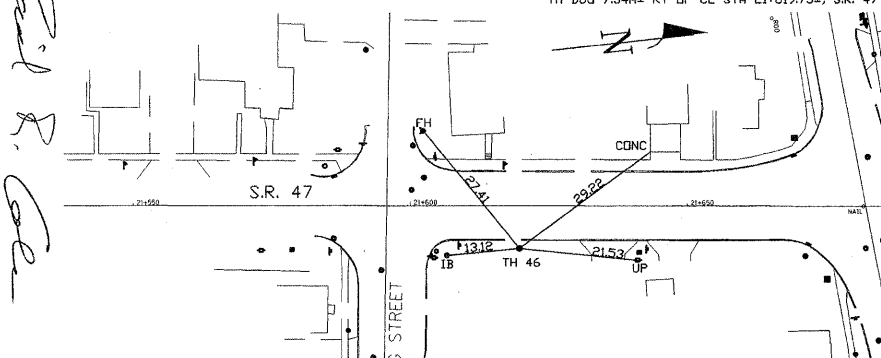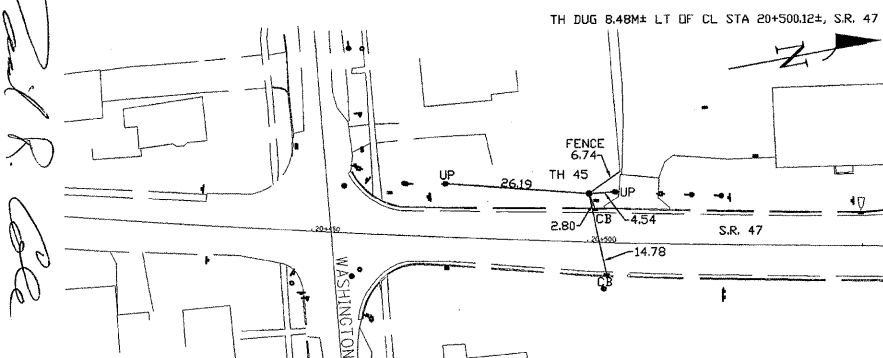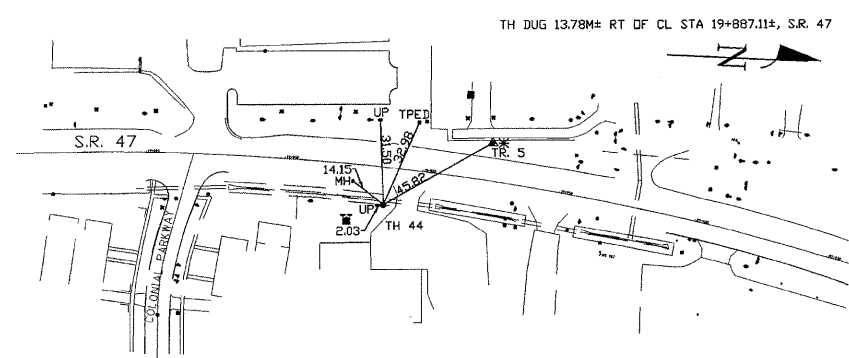

- RW = Rights of Way
- N.T.S. = Not to Scale
- PCC = Precast Concrete
- CONC. = Concrete
- D.I. = Ductile Iron
- C.I. = Cast Iron
- RPC = Rough Pour Concrete
- CL = Centerline
- T.C. = Terra Cotta
- PLAS. = Plastic
- BL. = Base Line
- ELEC. = Electric
- TELE. = Telephone
- T.H. = Test Hole
- SW. = Sidewalk
- DW. = Driveway
- BM. = Benchmark
- C.B. = Catch Basin
- GV. = Gas Valve
- Sewer Manhole
- Test Hole
- Fire Hydrant
- Pole
- Fence Line
- Electric Manhole
- T.S. = Travers Station
- Valve
- Water Meter
- Telephone Manhole
- Telephone Pedestal

- RW = Rights of Way
- N.T.S. = Not to Scale
- PCC = Precast Concrete
- CONC. = Concrete
- D.I. = Ductile Iron
- C.I. = Cast Iron
- RPC = Rough Pour Concrete
- CL = Centerline
- T.C. = Terra Cotta
- PLAS. = Plastic
- BL. = Base Line
- ELEC. = Electric
- TELE. = Telephone
- T.H. = Test Hole
- SW. = Sidewalk
- DW. = Driveway
- BM. = Benchmark
- C.B. = Catch Basin
- GV. = Gas Valve
- Sewer Manhole
- Test Hole
- Fire Hydrant
- Pole
- Fence Line
- Electric Manhole
- T.S. = Travers Station
- Valve
- Water Meter
- Telephone Manhole
- Telephone Pedestal

- RW = Rights of Way
- N.T.S. = Not to Scale
- PCC = Precast Concrete
- CONC. = Concrete
- D.I. = Ductile Iron
- C.I. = Cast Iron
- RPC = Rough Pour Concrete
- CL = Centerline
- T.C. = Terra Cotta
- PLAS. = Plastic
- BL. = Base Line
- ELEC. = Electric
- TELE. = Telephone
- T.H. = Test Hole
- SW. = Sidewalk
- DW. = Driveway
- BM. = Benchmark
- C.B. = Catch Basin
- GV. = Gas Valve
- Sewer Manhole
- Test Hole
- Fire Hydrant
- Pole
- Fence Line
- Electric Manhole
- T.S. = Travers Station
- Valve
- Water Meter
- Telephone Manhole
- Telephone Pedestal

Performing out-of-sight work...with vision™
All values are shown in meters (m) or millimeters (mm).
To convert to feet multiply meters by 3.2808.
Note: To eliminate mistakes and check this work, So-Deep suggests you scale and plot all dimensions onto the plans and review all elevations carefully. So-Deep is responsible only for information shown on our forms.

Performing out-of-sight work...with vision™
All values are shown in meters (m) or millimeters (mm).
To convert to feet multiply meters by 3.2808.
Note: To eliminate mistakes and check this work, So-Deep suggests you scale and plot all dimensions onto the plans and review all elevations carefully. So-Deep is responsible only for information shown on our forms.

Performing out-of-sight work...with vision™
All values are shown in meters (m) or millimeters (mm).
To convert to feet multiply meters by 3.2808.
Note: To eliminate mistakes and check this work, So-Deep suggests you scale and plot all dimensions onto the plans and review all elevations carefully. So-Deep is responsible only for information shown on our forms.

REVISIONS		ILLINOIS DEPARTMENT OF TRANSPORTATION
NAME	DATE	
		<p style="text-align: center;">UTILITY TEST HOLE RECORD</p> <p style="text-align: right;">DRAWN BY _____</p> <p style="text-align: right;">CHECKED BY _____</p> <p style="text-align: right;">DATE _____</p>