


## DETAIL WITH VARIABLE HEIGHT GRATE

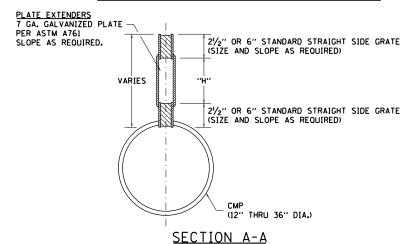

#### GENERAL

Class SI Concrete shall be used throughout. This specification covers Slottted Drain used for the removal of water as shown on the plans.

This specification covers slotted prain used for the removal of water as shown of the plans.

The Slotted Drains.

Before placing the concrete adjacent to the pipe, the slot shall be covered by either thin, flat metal sheeting or by a board notched to fit over the grate bars. This covering must fit closely in the slot to prevent entry of concrete into the pipe. Paving over the slotted drain will then be one continuous operation over the protected drain. The protection for the drain slot shall then be removed. The pipe shall drain into the side of the inlet. The opening where the slot is removed shall be covered to prevent concrete from entering the pipe.

The Corrugated Steel Pipe used in the Slotted Drain shall meet the requirements of AASHTO M36/ASTM A760.

The CMP shall be ALUMINIZED STEEL Type 2. The diameter shall be as shown on the plans.

Steel grating shall meet the galvanizing requirements of AASHTO MIII.
This work will be paid for at the contract unit price per foot for SLOTTED DRAIN of the pipe diameter specified WITH VARIABLE SLOT, or SLOTTED DRAIN, of the pipe diameter specified, WITH 6" SLOT,

and shall include concrete and grating for depth specified on plans.
Use approved end cap to prevent concrete entry into the pipe during gutter construction on the upstream end of the pipe.

#### CONNECTIONS

The Corrugated Steel Pipe shall have a minimum of two rerolled annular ends. The Slotted Drain bands shall be modified HUGGER Bands to secure the pipe and prevent

When the Slotted Drain is banded together, the adjacent grates shall have a maximum 3" gap.

## **GRATES**

The grates shall be manufactured from ASTM A670, Grade 36 steel. The spacers and bearing bars (sides) shall be 3/16 " material  $\pm 0.008$ ".

Dur's (sides) shall be 3716 indirer all 10.000.

The spacers shall be on 6" centers and welded on both sides to each bearing bar (sides) with four (4) 1- 1/4" long 3/16" fillet welds on each side of the bearing bar.

The plate extender shall be 7 gage steel meeting ASTM A761.

The engineer may call for tensile strength tests on the grate if the grate is not in compliance with the above spacer specifications. If tensile strength tests are called for, minimum results for an in-place spacer pulled perpendicular to the bearing bar shall be: T= 12,000 pounds for 2- 1/2 " grate

T= 15,000 pounds for 6" grate

#### **GALVANIZING**

The grate and plate extenders shall be galvanized in accordance with ASTM A123 except with a 2 oz. galvanized coating.


#### GRATE ATTACHED TO CSP


The grate shall be fillet welded with a minimum weld 1" long to the CSP on each side of the grate at every other corrugation.

## TOLERANCES - FINISHED SLOTTED DRAIN - 20' LENGTHS


Vertical Bow= ± 3/8 ' Horizontal Bow= ± 5/8 ' Twist= ± 1/2

# SLOTTED DRAIN PIPE

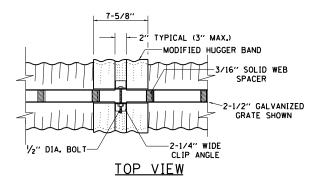




## SIDE VIEW



SECTION A-A STANDARD DETAIL



## SECTION A-A DETAIL WITH MESH


(TRAPEZOIDAL GALVANIZED GRATE SHOWN)

5	STA	NDA	ZES			
GAGE	GAGE DIAMETER OF PIPE					
PIPE	12"	15"	18"	24"	30"	36"
16	Х	Х	Х	Х	Х	Х
14	Х	Х	Х	Х	Х	Х
12	N.A.	N.A.	N.A.	N.A.	Х	Х


	RATE TYPE	"A"				
VERT	2-1/2"	1-3/4"				
VERT	6"	1-3/4"				
TRAP	2-1/2"	2-1/4"				
TRAP	6"	3"				
VERT = VERTICAL TRAP = TRAPIZOIDAL						


### SLOTTED DRAIN NOTES

- GRATING IS AVAILABLE IN DEPTHS OF 2-1/2" AND 6".
- VERTICAL GRATING (STRAIGHT SIDES) WITH VERTICAL SPACERS IS ALSO AVAILABLE.
- FOR 6" VERTICAL & TRAPIZOIDAL REQUIREMENTS, THE SLOTTED DRAIN BAND MAY BE FURNISHED WITH THE 4"
- 4. DIMENSIONS ARE SUBJECT TO MANUFACTURING TOLERANCES.
- DIMENSIONS FOR H1 AND H2 AS REQUIRED.
- 6. H1 AND H2 MEASURED FROM TOP OF GRATE TO BOTTOM OF GRATE.




END VIEW




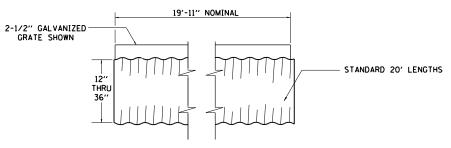


TYPICAL PIPE SECTION




GRATE WELDING DETAIL



SECTION B-B

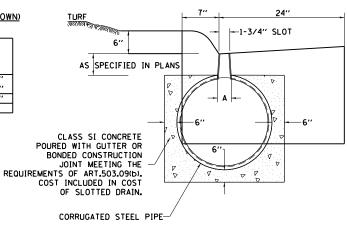

**DETAIL FOR CURB & GUTTER** 

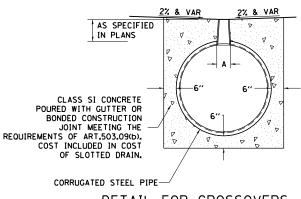

## DETAIL FOR CROSSOVERS. DRIVEWAYS, OR PARKING LOTS

ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED. \* 5789 & 5861

USER NAME = cushmanbw DESIGNED REVISED - 6-27-14 :\pw\_work\pwidot\cushmanbw\d0333009\P201709-sht-details.dgr DRAWN REVISED 10-18-11 CHECKED REVISED PLOT DATE = Fr: Aug 01 09:55:37 2014 DATE REVISED

STATE OF ILLINOIS **DEPARTMENT OF TRANSPORTATION** 

**REGION 2 / DISTRICT 2 STANDARD** SCALE: SHEET NO. OF SHEETS STA.

COUNTY HENRY 235 109 CONTRACT NO. 64J43 FED. ROAD DIST, NO. | ILLINOIS FED. AID PROJECT