


| | | | | |
|---|-----------|--------|--------------|-----------|
| F.A.I. RTE. | SECTION | COUNTY | TOTAL SHEETS | SHEET NO. |
| 90/94 | 2003-0311 | COOK | 976 | 57 |
| STA. | TO STA. | | | |
| FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT | | | | |

62583

NOTES:


- SEE DRAWINGS ME-01 AND ME-02 FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS.
- SEE ROADWAY PLAN DRAWINGS FOR CONSTRUCTION LIMITS.
- INTERCEPT EXISTING 4 INCH PVCC RGC STUBOUT AND PROVIDE NEW CONDUIT TO ELECTRIC METER SOCKET AS SHOWN.
- ALL WORK ASSOCIATED WITH THE INSTALLATION OF THE LIGHTING CONTROLLER UTILITY SERVICE FEED MUST BE COORDINATED WITH AND APPROVED BY COMED.
- ALL MATERIALS AND LABOR FOR THE INSTALLATION OF THE CONCRETE ENCASED DUCTBANK MUST MEET WITH ALL COMED REQUIREMENTS AND STANDARDS.
- THE CONTRACTOR MUST PROVIDE SUFFICIENT SLACK CABLES FOR TERMINATION BY COMED.
- FOR IDOT LIGHTING CONTROLLER 'T' ONLY; EQUIPMENT WILL BE FURNISHED AND INSTALLED BY OTHERS.
- FOR IDOT LIGHTING CONTROLLER 'T' ONLY; INTERCEPT EXISTING UNDERGROUND REINFORCED CONCRETE ENCASED DUCTBANK AND PROVIDE NEW DUCTBANK TO THE UTILITY POLE AS SHOWN.

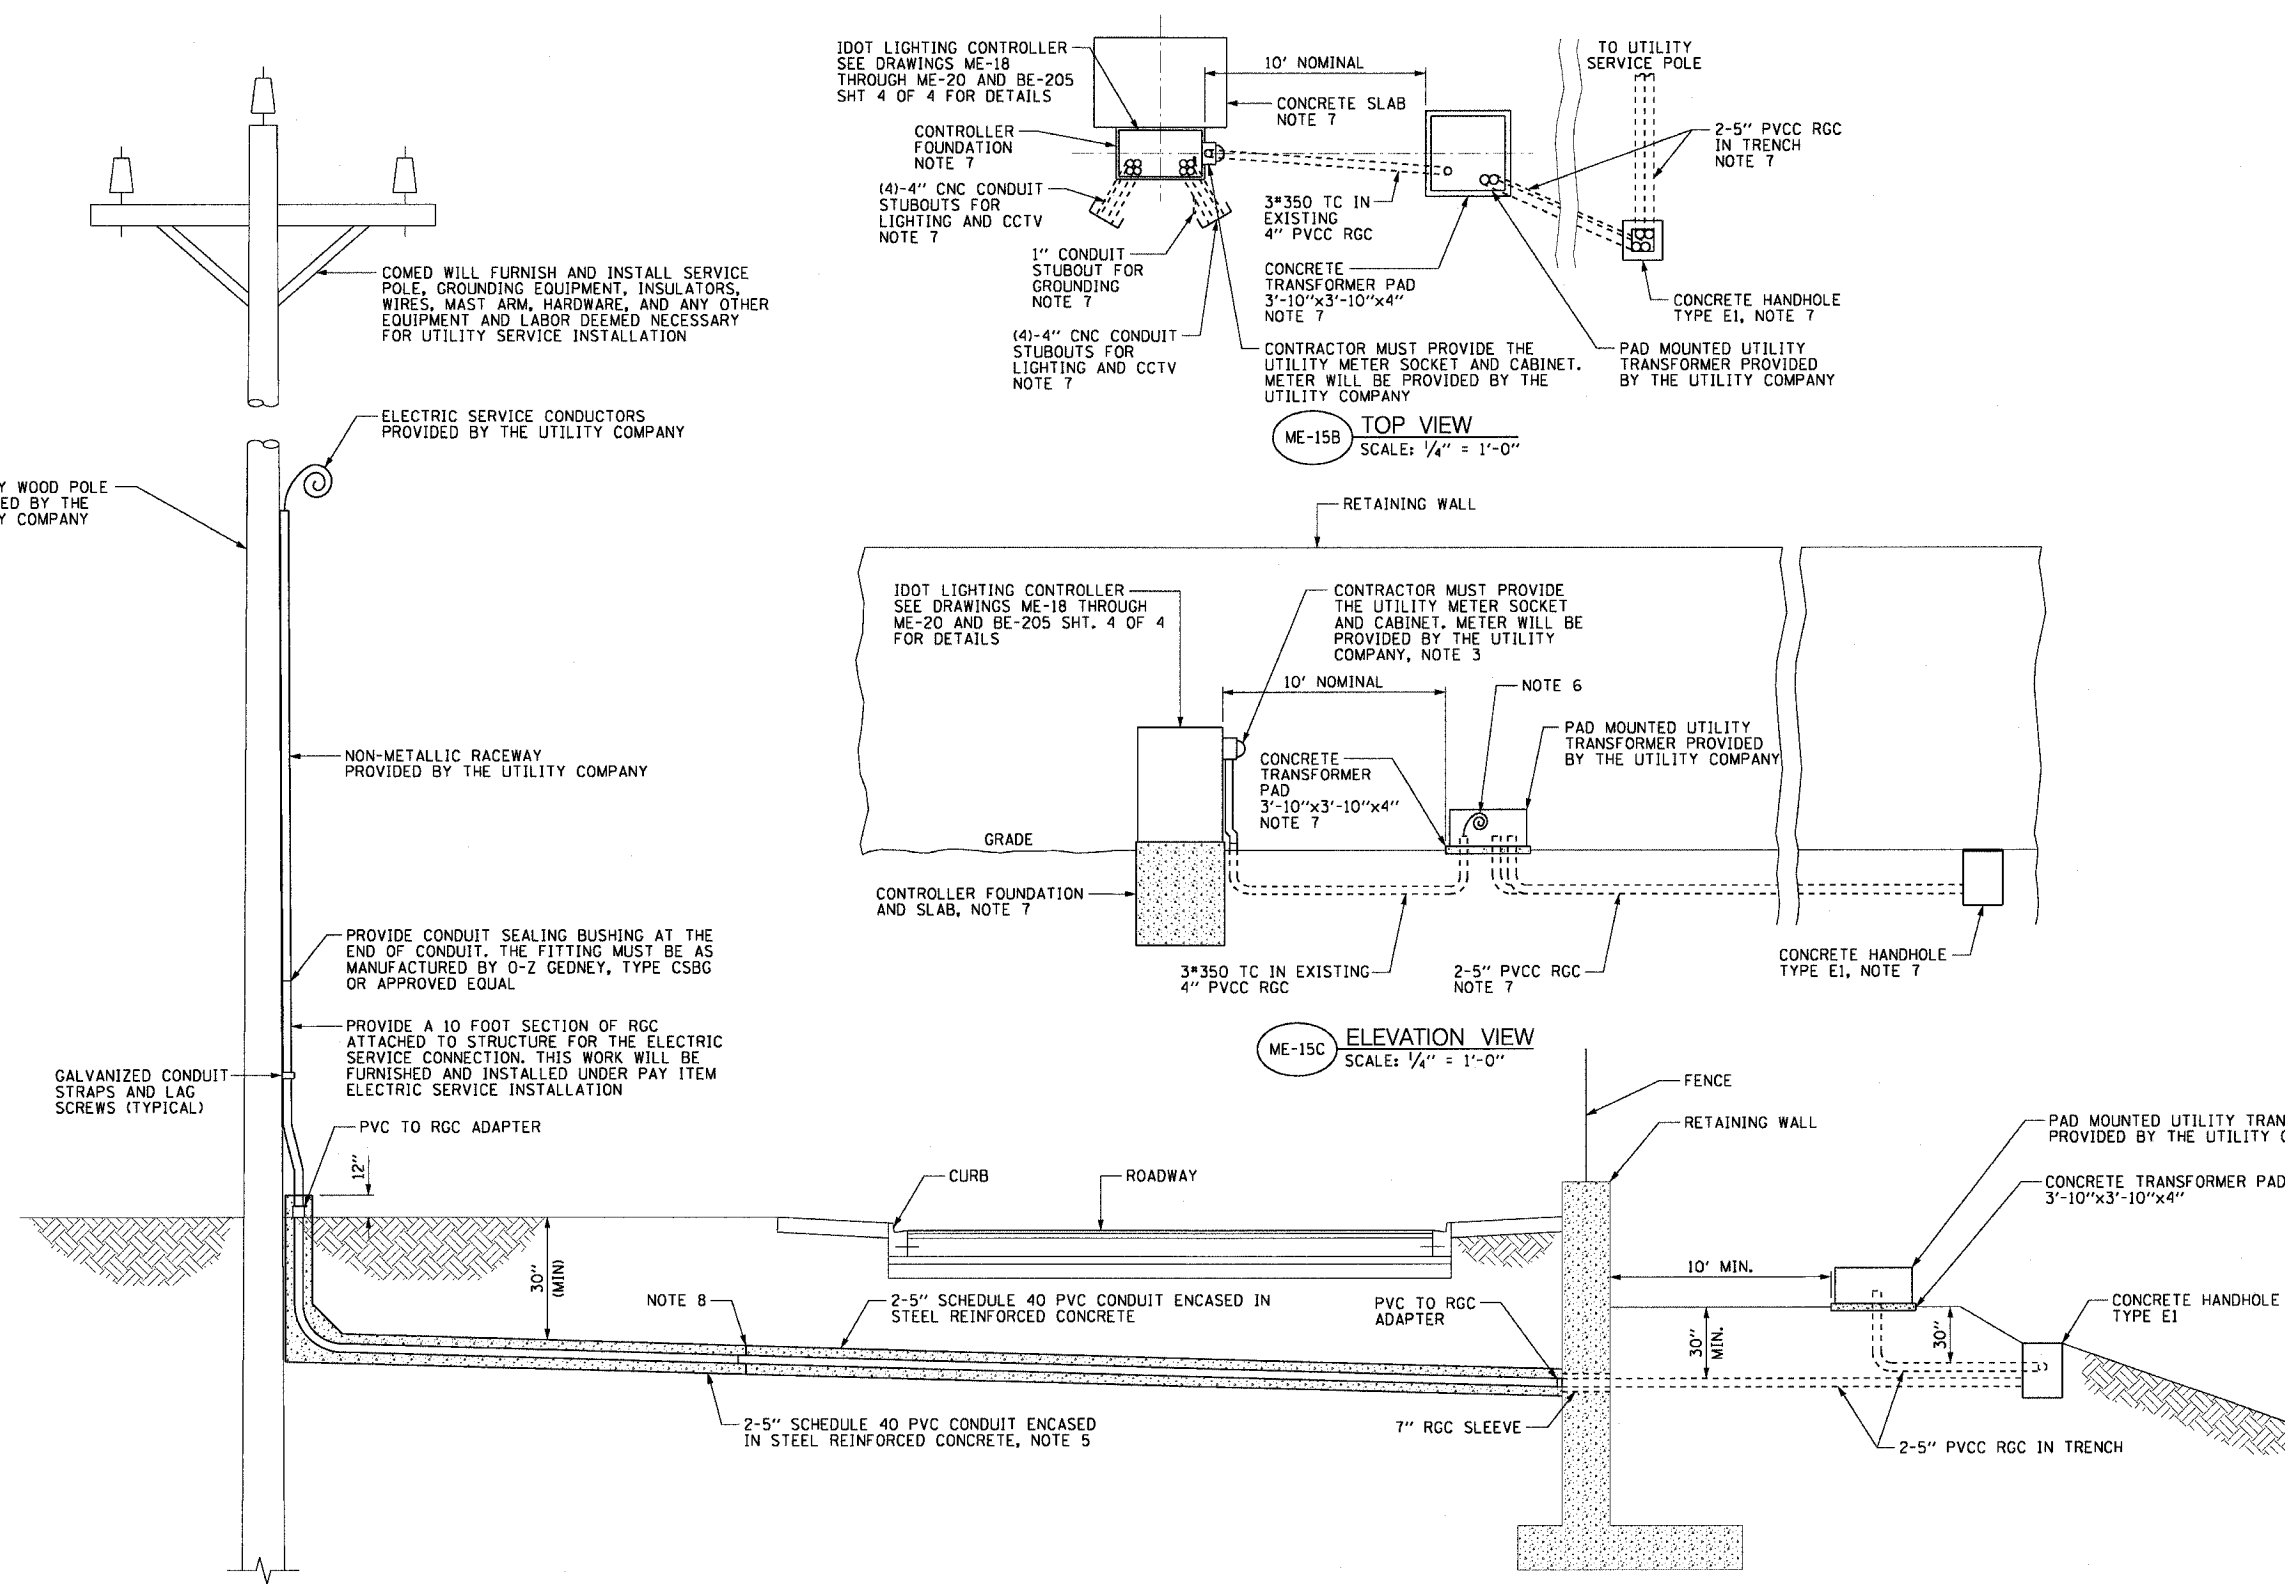

ME-15A CONDUIT INSTALLATION DETAIL FOR LIGHTING CONTROLLER ELECTRIC SERVICE
SCALE: 1/4" = 1'-0" NOTE 4

ME-15C ELEVATION VIEW
SCALE: 1/4" = 1'-0"

ME-15B TOP VIEW
SCALE: 1/4" = 1'-0"



ME-15

| REVISIONS | |
|-----------|------|
| NAME | DATE |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |

ILLINOIS DEPARTMENT OF TRANSPORTATION
F.A.I. 90/94 (DAN RYAN EXPRESSWAY)
31st STREET TO I-57

CONDUIT INSTALLATION DETAILS FOR
LIGHTING CONTROLLER ELECTRIC
SERVICE THROUGH RETAINING WALL

SCALE: AS SHOWN DRAWN BY: CJM/HR
DATE: October 29, 2004 CHECKED BY: WDS

11/22/2004 03:06:53 PM