


SLOPE STEPS DETAIL


TYPICAL CROSS-SECTION EMBANKMENT CONSTRUCTION ON SIDEHILL

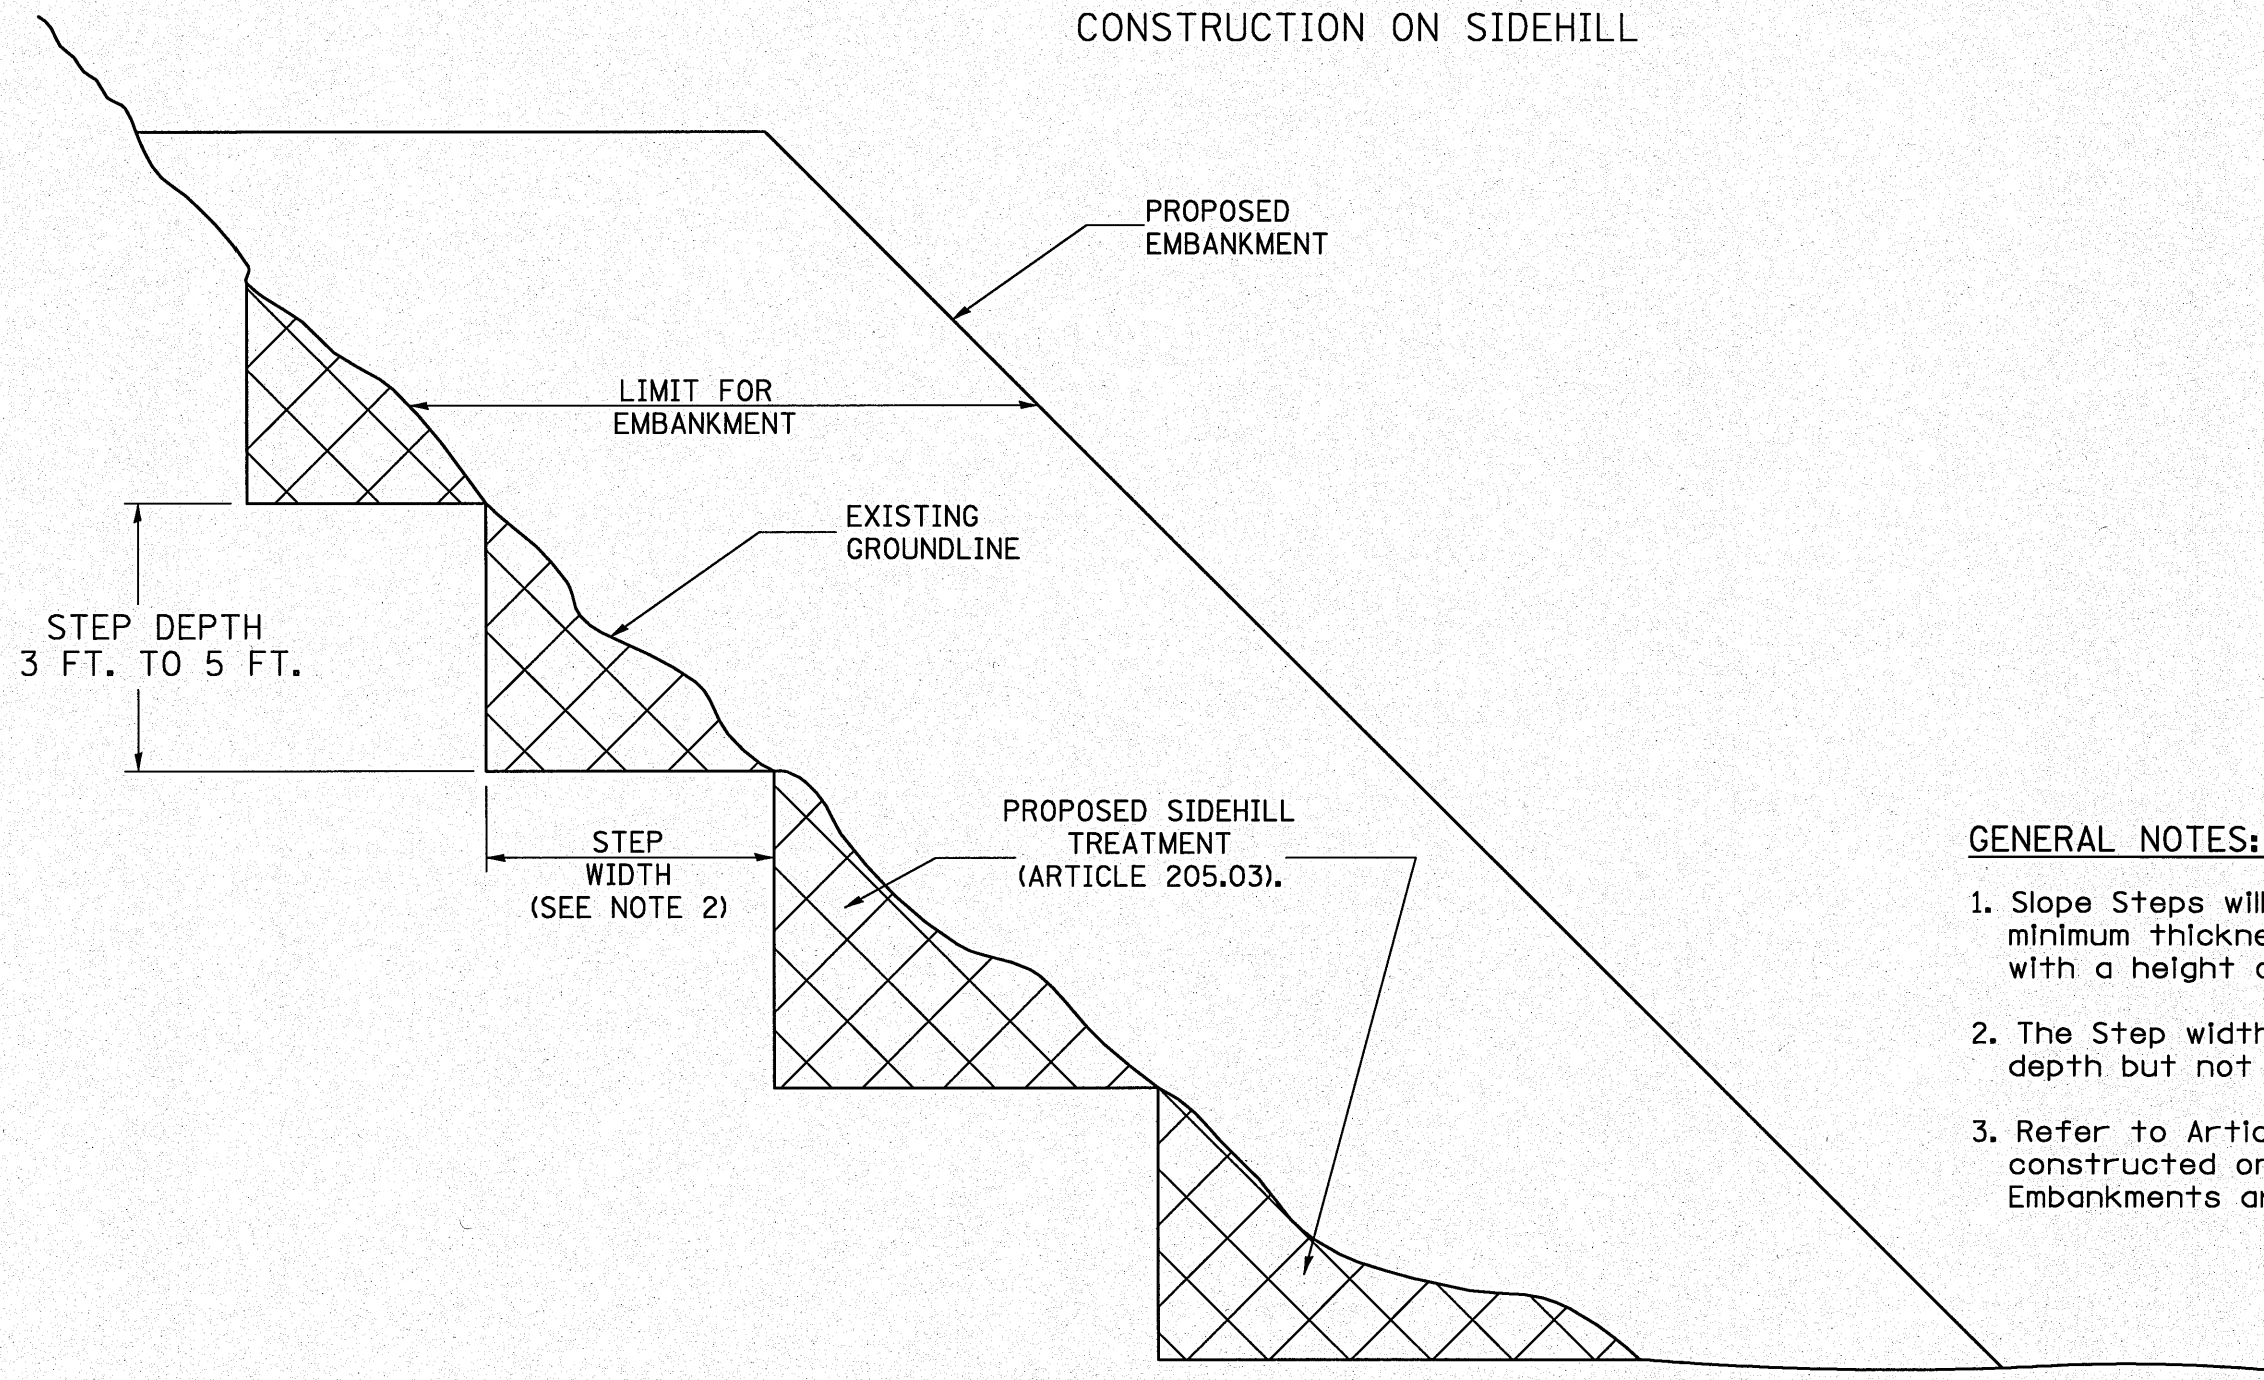

GENERAL NOTES:

1. Slope Steps will be required for all 12(300) minimum thickness "silver fills" and on a fills with a height of 10'(3.0m).
2. The Step width shall be twice the Step depth but not less than 6 feet.
3. Refer to Article 205.03 for Embankment to be constructed on Hillside or Slopes, or If existing Embankments are to be widened.

REPLACEMENT MATERIAL:



STANDARD EMBANKMENT
(IN ACCORDANCE WITH
205 OF THE STANDARD SPECIFACATION).

SIDE SLOPE DETAILS

All dimensions are in inches (millimeters) unless otherwise noted.

DATE	
BY	
STARTED	
PLotted	
FILED	
NOTE BOOK	
NO. OF PAGES	
FILE NAME	

DATE	
BY	
STARTED	
PLotted	
FILED	
NOTE BOOK	
NO. OF PAGES	
FILE NAME	

FILE NAME = #FILE#	USER NAME = #USER#	DESIGNED ST	REVISED -	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	DISTRICT 4 STANDARDS US-24 OVER LAMARSH CREEK			F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
		DRAWN ST	REVISIONS -			317	45BR-2	PEORIA	122	88		
	PLOT SCALE = #SCALE#	CHECKED FML	REVISIONS -		SCALE: N.T.S.	SHEET NO. 1 OF 19 SHEETS	STA.	TO STA.	CONTRACT NO. 68719			
	PLOT DATE = #DATE#	DATE 10-15-2010	REVISIONS -		FED. ROAD DIST. NO. ILLINOIS FED. AID PROJECT							