A MINIMUM OF 3 FEET OF SLACK SHALL BE PROVIDED IN THE CABLES AT EACH TRANSFORMER, CONNECTOR, OR SPLICE POINT. ALL CABLE SPLICES SHALL OCCUR IN MANHOLES, LIGHT WELLS OR SPLICE CANS, UNLESS NOTED OTHERWISE.

3. THE ELECTRICAL INSTALLATION, AS A MINIMUM, SHALL MEET THE NATIONAL ELECTRICAL CODE AND LOCAL

4. ALL MANUFACTURERS FOR SUPPLYING AIRPORT LIGHTING EQUIPMENT SHALL APPEAR ON THE CURRENT FAA "APPROVED AIRPORT EQUIPMENT" LIST FOUND IN AC 150/5345-538. THE EQUIPMENT SHALL COMPLY WITH THE APPLICABLE CURRENT FAA ADVISORY CIRCULAR LISTED IN THE FAA "APPROVED AIRPORT EQUIPMENT" LIST FOUND IN AC 150/5345-2 (AIRPORTS ELECTRONIC BULLETIN BOARD NUMBER 14).

5. THE CONTRACTOR SHALL ASCERTAIN THAT ALL LIGHTING SYSTEM COMPONENTS FURNISHED BY HIM (INCLUDING FAA APPROVED EQUIPMENT) ARE COMPATIBLE IN ALL RESPECTS WITH EACH OTHER AND THE REMAINDER OF THE NEW/EXISTING SYSTEM. ANY NONCOMPATIBLE COMPONENTS FURNISHED BY THIS CONTRACTOR SHALL BE REPLACED BY HIM AT NO ADDITIONAL COST TO THE AIRPORT SPONSOR WITH A SIMILAR UNIT, APPROVED BY THE ENGINEER (DIFFERENT MODEL OR DIFFERENT MANUFACTURER) THAT IS COMPATIBLE WITH THE REMAINDER OF THE AIRPORT LIGHTING SYSTEM.

6. IF THE CONTRACTOR SELECTS TO FURNISH AND INSTALL AIRPORT LIGHTING EQUIPMENT WHICH REQUIRES ADDITIONAL WRING, TRANSFORMERS, ADAPTERS, MOUNTINGS, ETC., BEYOND THAT SHOWN ON THE DRAWINGS AND/OR LISTED IN THE SPECIFICATIONS, THEN THE COST FOR THE ADDITIONAL ITEMS SHALL BE INCLUDED TO THE CONTRACT UNIT PRICES.

7. THE CONTRACTOR INSTALLED EQUIPMENT (INCLUDING FAA APPROVED) SHALL NOT GENERATE ANY ELECTROMAGNETIC INTERFERENCE IN THE EXISTING AND/OR NEW COMMUNICATIONS, WEATHER, AIR NAVIGATION, AND AIR TRAFFIC CONTROL EQUIPMENT. ANY EQUIPMENT GENERATING SUCH INTERFERENCE SHALL BE REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST WITH THE EQUIPMENT MEETING THE APPLICABLE SPECIFICATIONS AND NOT GENERATING ANY INTERFERENCE.

WHEN A SPECIFIC TYPE, STYLE, CLASS, ETC. OF FAA APPROVED EQUIPMENT IS SPECIFIED ONLY THAT TYPE, STYLE, CLASS, WILL BE ACCEPTABLE, EVEN THOUGH EQUIPMENT OF OTHER TYPES, STYLES, CLASSES, ETC. MAY BE FAA APPROVED.

ALL CONCRETE FOR ELECTRICAL EQUIPMENT SHALL COMPLY WITH SPECIFICATION 610-STRUCTURAL PC CONCRETE 3500 PSI AT 28 DAYS, AIR ENTRAINED CONCRETE MIX SHALL BE USED.

10. BASE MOUNTED BREAKABLE COUPLINGS SHALL NOT HAVE WEEP HOLES TO THE OUTSIDE. PLUGGED UP HOLES SHALL NOT BE ACCEPTABLE. IT SHALL HAVE A 1/4" DIAMETER OR EQUIVALENT OPENING FOR DRAINAGE FROM THE SPACE AROUND THE CONNECTOR INTO THE BASE.

11. THE ELEVATION OF THE BREAKABLE COUPLING GROOVE SHALL NOT EXCEED 1 1/2" ABOVE THE EDGE OF THE COVER IN THE CASE OF A BASE MOUNTED COUPLING.

ALL PERMANENT CABLE SPLICES SHALL OCCUR IN MANHOLES, LIGHT WELLS, OR SPLICE CANS, UNLESS NOTED OTHERWISE.

13. MIMIC PANEL COLORS: TAXIWAY R5-23 CIRCUIT = WHITE, TAXIWAY D CIRCUIT = ORANGE, TAXIWAY E CIRCUIT = YELLOW, TAXIWAY F-2 CIRCUIT = LIME, TAXIWAY T-K-1 CIRCUIT = RED AND SIGN CIRCUIT = WHITE.

PLASTIC BODY MOLD-CABLE JACKET REMOVED, "PENCIL" INSULATION POURING SPOUT —SEAL ENDS OF MOLD WITH TAPE PROVIDED IN SPLICE KIT COMPRESSION TYPE SLEEVE -RESIN-CONNECTORS, CRIMP WITH TOOL RECOMMENDED BY MANUFACTURER COVER WITH HEAT SHRINKABLE TUBING WITH INTERNAL ADHESIVE FOR SPLICES IN HOMERUNS FOR EXTENSIONS TO EXISTING CABLES ONLY

HEAT SHRINKABLE TUBING WITH INTERNAL ADHESIVE ADDITIONAL ADHESIVE COMPOUND FILLER 2"TYP. UNDERGROUND CABLE -∠PLUG END RECEPTACLE END-SPEC. L-824, TYPICAL FOR SPLICES FOR USE AT JUNCTION OF

HOMERUN WITH LOOP CIRCUIT

HEAT SHRINKARI E TURING HEAT SHRINKABLE TUBING WITH INTERNAL ADHESIVE WITH INTERNAL ADHESIVE RECEPTACLE END-2"TYP. AFTER SHRINKING === \_ADDITIONAL ADHESIVE COMPOUND FILLER -Plug end FACTORY MOLDED TRANSFORMER LEADS AFTER SHRINKING ADDITIONAL ADHESIVE L-823 PLUG END RECEPTACLE END COMPOUND FILLER


FOR SPLICES AT RUNWAY LIGHTS

SEE LIGHTING LAYOUT SHEET(S) FOR SPLICE TYPE
 INSIDE DIAMETER OF CONNECTOR SHALL PROPERLY MATCH THE OUTSIDE DIAMETER OF CABLE

CABLE SPLICES (NOT TO SCALE)


PRE STAMPED OR CHISELED ON THE JOB "ELECTRICAL DUCT 2" WAY" 3"

1, 2, OR 4 AS APPROPRIATE FOR PROPOSED / EXISTING DUCT BANK



IN-PAVEMENT BRASS DUCT MARKER DETAIL

PAVING CONTRACTOR SHALL INSTALL NEW BRASS DUCT MARKERS IN THE PROPOSED PAVEMENT AT ALL LOCATIONS WHERE THE PROPOSED PAVEMENT CROSSES EXISTING OR PROPOSED ELECTRICAL DUCTS.
COST OF DUCT MARKERS SHALL BE INCLUDED IN
THE 401 AND / OR 501 CONTRACT UNIT PRICES.



PLOWED CABLE

RUNWAY 5-23 OVERLAY, PHASE II ILL. MLI-3530, QU096 SHEET 30 OF 54 MEDIUM INTENSITY TAXIWAY LIGHT L-861T/30 WATT, 6.6 AMP 10' TO EDGE OF PAVEMENT FIXTURE W/ BLUE LENS. LAMPS ARE NUMBERING TAG (IF RORD.) 12" DIA, BASE PLATE W/ 1/8" NEOPRENE GASKET BREAKABLE COUPLING AND DISCONNECT PLUG 12" DIA. BASE PLATE WITH 1/8" NEOPRENE GASKET PROVIDE 3' SLACK FOR CONNECTIONS AND COLOR

G:\AIRPORT\A05T026\LIGHTING.DWG\ 1=1 11-01-05 QUAD CITY INTERNATIONAL AIRPORT

CODE EACH CABLE -L-867 BASE, SIZE B, 12" 12424"D COMPACTED SAND -- L-823 CONNECTORS APPROX. 4" -- 6" CONCRETE L-830-1 TRANSFORMER (30/45 WATT, 6.6/6.6 AMP) 2" RG. STL. NIPPLE AND 2" TO 1" RG. STL. → PVC FITTING, TYPICAL 1/C #8, 5KV, EPR CABLE IN PRICKS 6" COMPACTED SAND

L-861T EDGE LIGHT INSTALLATION / RELOCATION DETAILS MEDIUM INTENSITY TAXIWAY LIGHT (MITL) BASE MOUNTED, 6.6 AMP SERIES CIRCUIT


NOT TO SCALE

NOTES: 1.

BREAKING GROOVE OF BREAKABLE COUPLING SHALL BE 3" TO 3 1/2" ABOVE FINISHED GRADE.

2. \* ORDER L-867 BASE WITH ADDITIONAL 2" CONDUIT HUB APPROXIMATELY 90' FROM MAIN ENTRANCE HUB WHERE INDICATED ON PLAN SHEETS.

IF THE CONDITION OF THE EXISTING LIGHTING EQUIPMENT TO BE REMOVED IS ACCEPTABLE TO THE RESIDENT ENGINEER, THE CONTRACTOR MAY REUSE THE REMOVED LIGHT FIXTURES, BASE PLATES, CANS, AND TRANSFORMERS AT THE PROPOSED LIGHT LOCATIONS. IF THE EXISTING EDGE LIGHT EQUIPMENT IS REUSED, THEN THE CONTRACTOR SHALL SUPPLY AND INSTALL 6° COMPACTED SAND LEVELING CUSHION, EXTEND THE EXISTING STEEL CONDUIT TO A POINT OUTSIDE OF THE PROPOSED CONCRETE BACKFILL, ADDITIONAL P.C. CONCRETE BACKFILL AROUND (MIN. 4° THICKNESS), COMPACTED SAND BACKFILL, NEW 1/8° NEOFRENE GASKETS, RETAP BASE HOLES AS REQU., NEW STAINLESS STEEL BOLTS, NUTS, & WASHERS, AND NEW LENS & LAMPS AS REQUIRED. CONTRACTOR SHALL REPLACE ANY DAMAGED EQUIPMENT AS DIRECTED BY THE RESIDENT ENGINEER. CONTRACTOR SHALL SUPPLY AND INSTALL NEW EDGE LIGHT EQUIPMENT AS REQUIRED.

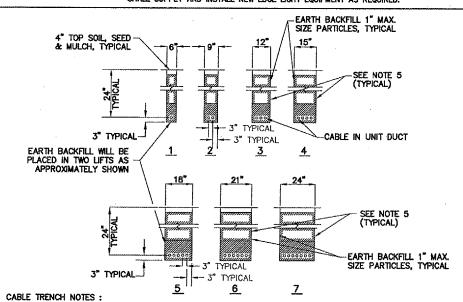

- 1. DETAIL NUMBERS INDICATE NO. OF CABLES.
- 2. TRENCHES WITH MORE THAN 7 CABLES SHALL BE INCREASED 3" IN WIDTH FOR EACH ADDITIONAL CABLE; IF SPECIFIED ON PLANS, TWO PARALLEL TRENCHES MAY BE CONSTRUCTED.
  - AND RATES MAY BE SHOWN ON THE PLANS.

4. ALL DISTURBED SURFACES SHALL BE RESTORED TO THEIR ORIGINAL CONDITION. COST IS INCIDENTAL TO TRENCH. RETURFING MATERIALS

 INSTALL YELLOW PLASTIC WARNING RIBBON IN TRENCH 9" ABOVE CABLES (TYPICAL ALL TRENCHES). 3. DEPTH OF TRENCHES SHALL BE AS SHOWN ABOVE UNLESS OTHERWISE SPECIFIED ON THE PLANS.

> CABLE TRENCHES (NOT TO SCALE)