

## STANDARD BAR SPLICER ASSEMBLY

Minimum Lap Lengths							
Bar size to be spliced	Table 1	Table 2	Table 3	Table 4	Table 5		
<i>3, 4</i>	1′-5′′	1'-11''	2'-1''	2'-4''	2'-3"		
5	1'-9''	2'-5"	2'-7"	2'-11''	2'-10''		
6	2'-1"	2'-11"	3'-1''	3'-6"	3'-4"		
7	2'-9"	3'-10''	4'-2"	4'-8''	4'-6"		
8	3′-8′′	5′-1′′	5′-5″	6'-2''	5′-10′′		
9	4'-7"	6'-5''	6'-10''	7′-9′′	7'-5"		

Table 1: Black bar, 0.8 Class C

Table 2: Black bar, Top bar lap, 0.8 Class C

Table 3: Epoxy bar, 0.8 Class C

Table 4: Epoxy bar, Top bar lap, 0.8 Class C

Table 5: Epoxy bar, Top bar lap, Class B

Bridge Deck

4'-0"

Reinforcement

Bars

Threaded

couplers (E)

BAR SPLICER ASSEMBLY FOR #5 BAR ON


INTEGRAL OR SEMI-INTEGRAL ABUTMENTS

No. required = 0

Threaded splicer bar length = min. lap length +  $1_2^{l}$ " + thread length


\* Epoxy not required on Bar Splicer Assembly components used in conjunction with black bars.


Location	Bar size	No. assemblies required	Table for minimum lap length
Deck	#6	14	Table 3

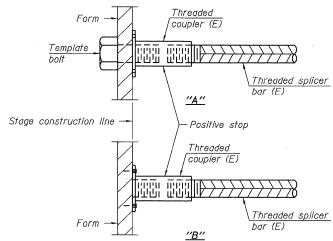

## INSTALLATION AND SETTING METHODS

"A": Set bar splicer assembly by means of a template bolt. "B" : Set bar splicer assembly by nailing to wood forms or cementing to steel forms. (E): Indicates epoxy coating.

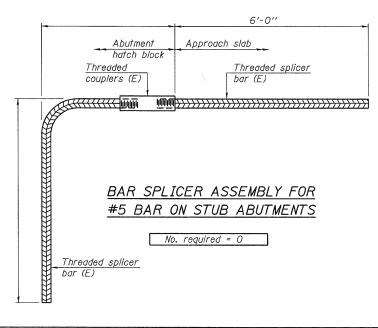



## STANDARD MECHANICAL SPLICER

Location	Bar size	No. assemblies required			

Approach Slab

6'-0"

T<u>hreaded splicer</u>

bar (E)

BSD-1

7-1-10

Threaded splicer

	DESIGNED - PCA	REVISED -	
USER NAME = Isupencheck	DRAWN - LK	REVISED -	
PLOT SCALE = 1:1	CHECKED - ACF	REVISED -	
PLOT DATE = 20-JAN-2011	DATE - 01/21/2011	REVISED -	
FILE NAME = IP_PWP:dms34575\0990	Ø6Ø-6ØM64-Ø13-SPLICE.DGN		***************************************



STATE OF ILLINOIS **DEPARTMENT OF TRANSPORTATION** 

## BAR SPLICER ASSEMBLY & MECHANICAL SPLICER DETAILS EASTBOUND FAI-80 OVER RAILROAD/GARDNER STREET STRUCTURE NO. 099-0060 SHEET NO. S-13 OF 15 SHEETS

 F.A.I. SECTION				Τ	COUNTY	L SHEE				
80		99 (2&3) RS-3					WILL	200	161	
								CONTRACT	NO.	60M64
FED.	ROAD	DIST.	NO.	1	ILLINOIS	FED.	AID	PROJECT		

Splicer bars shall be deformed with threaded ends and have a minimum 60 ksi yield strength.

All reinforcement shall be lapped and tied to the splicer bars.

Bar splicer assemblies shall be epoxy coated according to the requirements for reinforcement bars. See Section 508 of the Standard Specifications. See special provision for Mechanical Splicers.

See approved list of bar splicer assemblies and mechanical splicers for alternatives.