TOTAL SHEETS	SHEET NO.
57	51

SHEET NO. 18 OF 24 SHEETS

F.A.S. 1939	37 Q.	MACON	66	33
Job Code Part No.	Highway	Project B-1658-(10)		

FOR INFORMATION ONLY

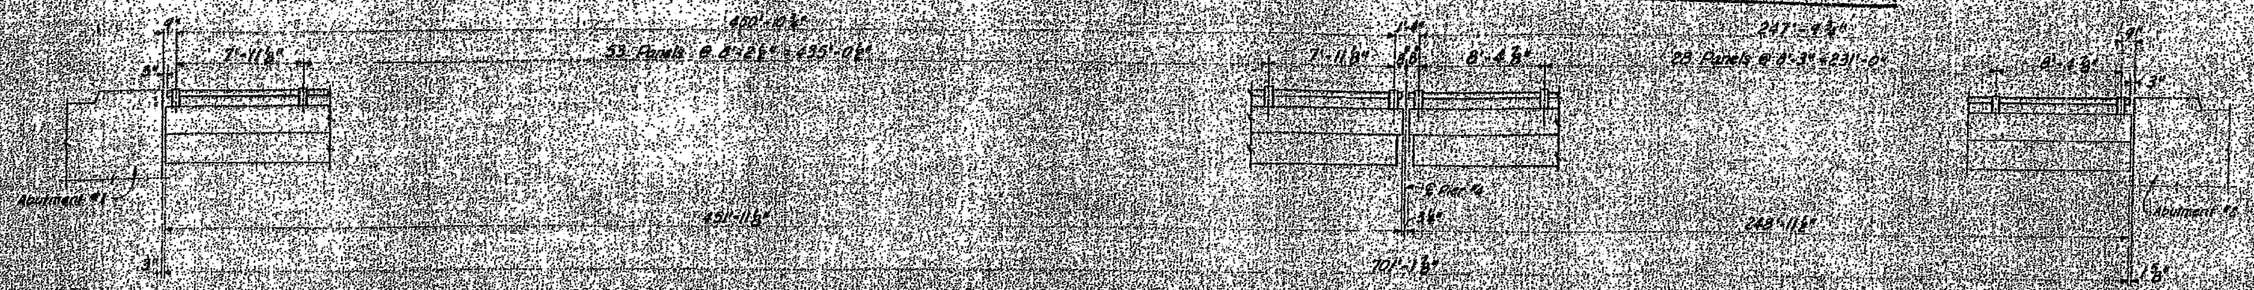

VIEW B-B

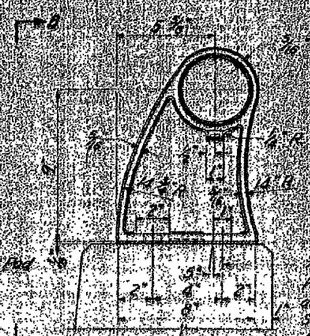

SECTION A-A

½"ø Threaded Inserts. Provide 1 Stainless Steel Washer and 1 - ⅜"ø x 2½" Stainless Steel Bolt with each Insert. 4 Required each post.

CAST END CAP
DRIVE FIT TYPE

8 Required
Incidental to Item
Aluminum Handrail Type D

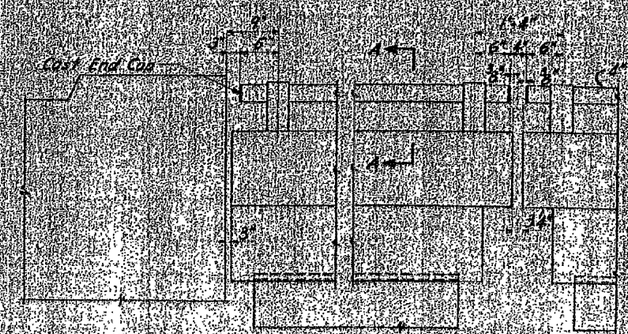

ELEVATION - END POST

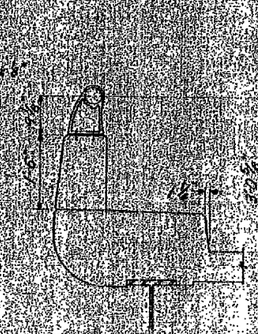

SECTION THRU CURB

NOTES

All Posts shall be placed normal to parapet.

All Posts shall be of Aluminum conforming to ASTM Specification B-108 alloy 56-108-T6.

All Rail Tubing shall be of Aluminum conforming to ASTM Specification B-235 alloy 6061-T6.

Rail Tubing shall be cut to a maximum length of three panels.

For material composition of Prefabricated Pad, See Art. 64.4(F), (Bearings and Anchorage) of the Std. Specs.

Set Screws shall be of Aluminum conforming to ASTM Specification B-211 alloy 2024-T4.

Aluminum handrail shall be measured in linear feet. The length paid for shall be the overall length along the top longitudinal railing member through all posts and gaps.

The contract unit price for Aluminum Handrail Type D shall include furnishing, fabrication, transportation and erection of all material.

FOR INFORMATION ONLY

ALUMINUM HANDRAIL TYPE D

REVISIONS	MACON COUNTY	
	F.A.S. RT. 1939 SECTION 37 Q.	

HOMER L. CHASTAIN & ASSOCIATES
CONSULTING ENGINEERS