


**STAGE 2 NOTES:**

1. SEE SAFETY PLAN FOR ADDITIONAL DETAILS.
2. T-D CRT (SOUTH OF T-E) = OFF.
3. T-D CRT (NORTH OF T-E) = ON.
4. T-E CRT = ON.

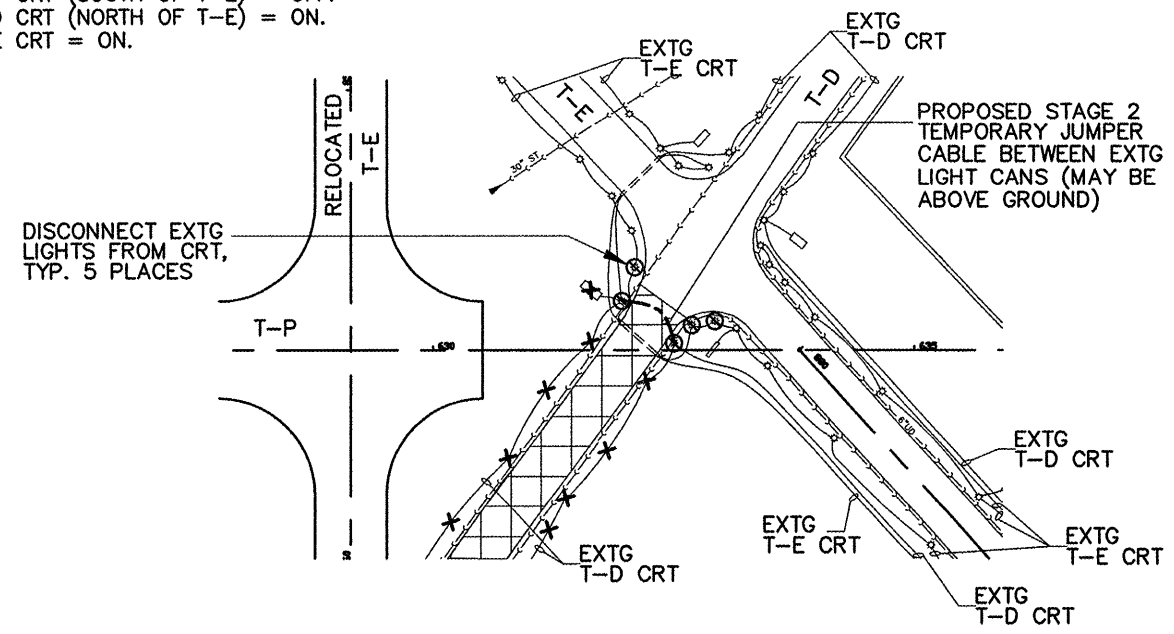

STAGE 2 TEMPORARY JUMPER CABLE

**SYMBOL LEGEND**

- ☉ EXISTING EDGE LIGHT
- EXISTING L-867 SPLICE OR TRANSFORMER CAN
- EXISTING GUIDANCE SIGN
- Ⓧ EXISTING STORM OR SANITARY MANHOLE
- EXISTING UNDERDRAINS/STORM OR SANITARY SEWERS
- === EXISTING CONDUIT OR DUCT BANK
- EXISTING ELECTRICAL CIRCUIT, CABLE IN UNIT DUCT
- PROPOSED LOCATION FOR RELOCATED OR NEW L-861T MITL (BLUE)
- PROPOSED CONDUIT OR DUCT BANK
- - - PROPOSED ELECTRICAL CIRCUIT, 1/C, #8, EPR CABLE IN 1" HDPE UNIT DUCT
- - - PROPOSED TEMPORARY ELECTRICAL JUMPER CABLE, 1/C, #8
- ✕ OR ✕ NO POWER TO LIGHT, SIGN, AND / OR CABLE
- ⊗ DISCONNECT EDGE LIGHT FROM CIRCUIT



**NOTES FOR ALL STAGES:**

1. REMOVE TEMPORARY JUMPER CABLES WHEN NO LONGER NEEDED.
2. ADDITIONAL TEMPORARY JUMPER CABLES MAY BE REQUIRED DEPENDING ON THE PROPOSED CONSTRUCTION SEQUENCING.
3. COST FOR ITEMS SHOWN ON THIS SHEET SHALL BE INCLUDED IN THE LIGHTING CONTRACT UNIT PRICES. THESE ITEMS SHALL NOT BE MEASURED FOR PAYMENT AND / OR PAYED FOR UNLESS NOTED OTHERWISE.


**STAGE 3 NOTES:**

1. SEE SAFETY PLAN FOR ADDITIONAL DETAILS.
2. T-D CRT (SOUTH OF T-E) = OFF.
3. T-D CRT (NORTH OF T-E) = ON.
4. T-E CRT (SOUTH OF T-D) TO BE ADDED TO T-D CRT = ON.
5. T-E EDGE LIGHTS (SOUTH OF R 9-27 & NORTH OF T-D) = OFF.
6. T-E CRT (NORTH OF R 9-27 & SOUTH OF T-D) = ON.

DISCONNECT EXTG LIGHTS FROM CRT, TYP. ALL T-E LIGHTS BETWEEN R9-27 AND TEMPORARY JUMPER (8 LOCATIONS)

PROPOSED STAGE 3 TEMPORARY JUMPER CABLE BETWEEN EXTG LIGHT CANS (BURIED & THROUGH EXTG DUCT, PAID FOR UNDER ITEM AR108158)

DISCONNECT EXTG LIGHTS FROM CRT, TYP. 5 PLACES

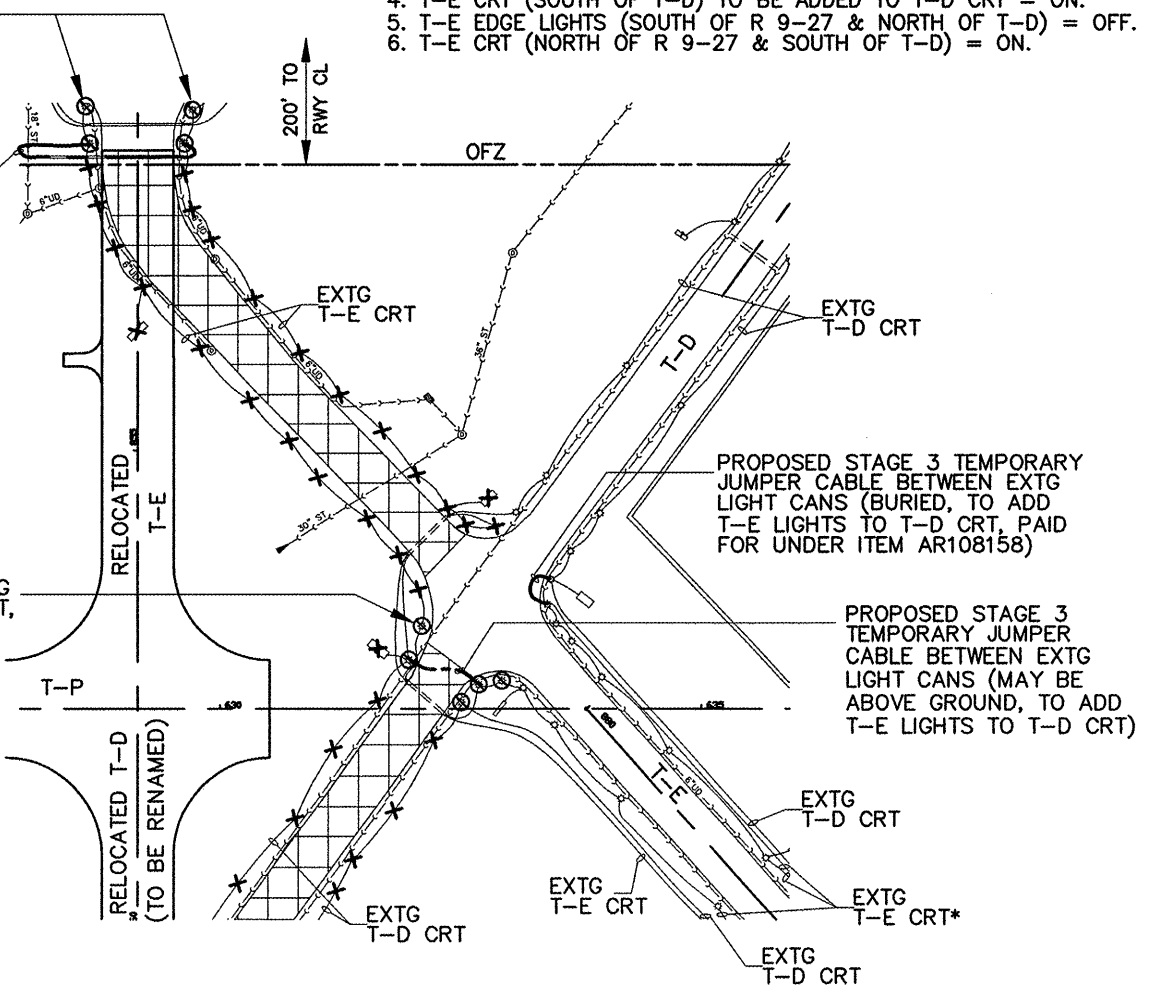


STAGE 3 TEMPORARY JUMPER CABLES

\* = ADD TO EXTG T-D CRT

**STAGE 4 NOTES:**

1. SEE SAFETY PLAN FOR ADDITIONAL DETAILS.
2. RELOCATED T-D CRT (SOUTH OF T-P) = ON.
3. OLD T-D CRT (SOUTH OF R9-27 & NORTH OF T-P) = OFF.
4. T-E CRT WITH RELOCATED T-E (NORTH OF T-P) = ON.
5. OLD T-E CRT (SOUTH OF T-P & NORTH OF R5-23) = OFF.

PROPOSED STAGE 4 TEMPORARY JUMPER CABLE BETWEEN EXTG LIGHT CANS (BURIED & THROUGH PROP. DUCT, PAID FOR UNDER ITEM AR108158)

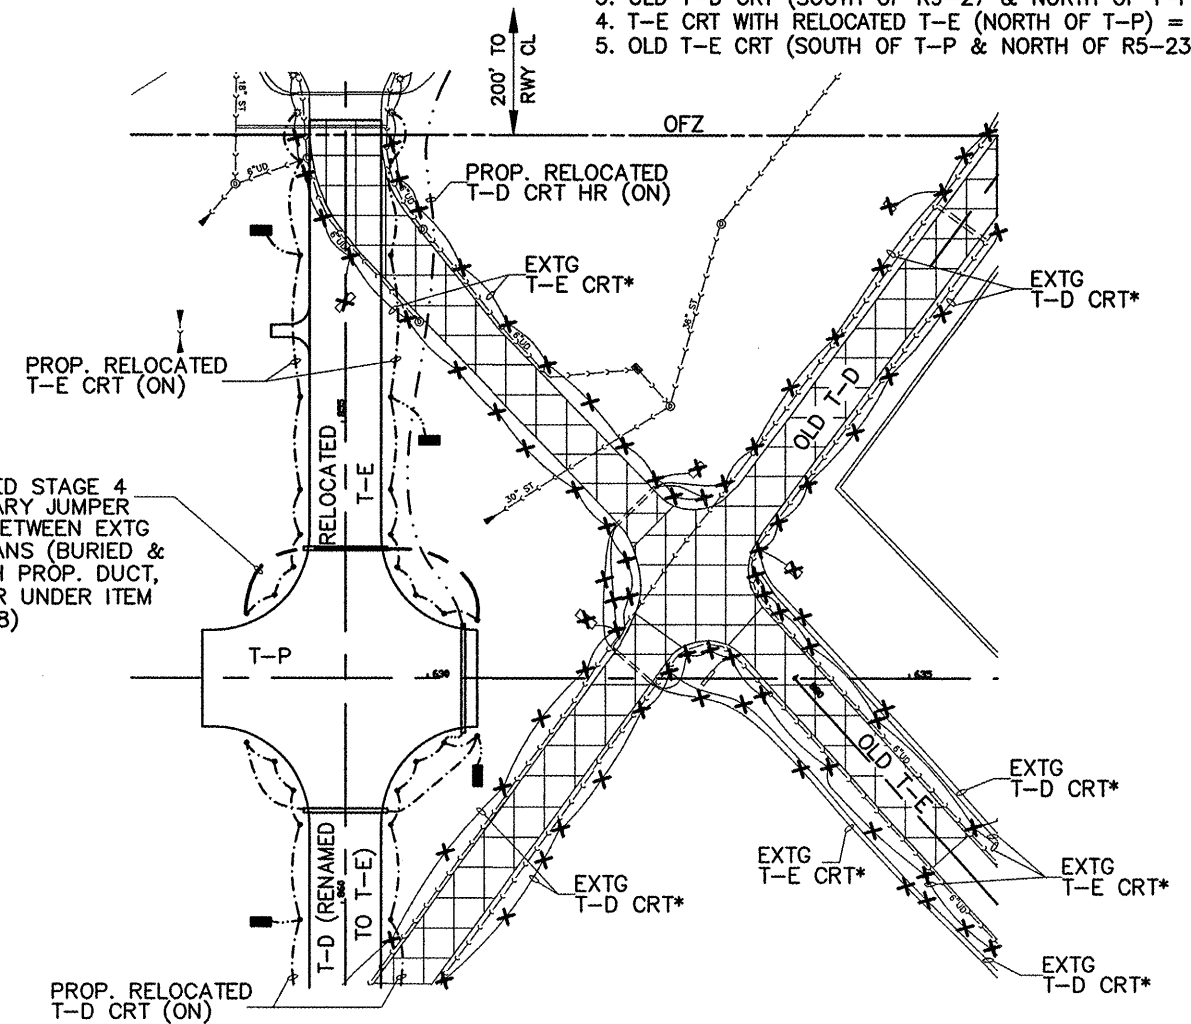

STAGE 4 TEMPORARY JUMPER CABLES

\* = OFF

**TEMPORARY JUMPER CABLES FOR PROJECT STAGING**

G:\airport\A08T032 TP MID P\MT\LIGHTING2.dwg, 4/1/2009 8:25:28 AM, jefim