


F. A. S. NO.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
	05-00113-00-PK	COOK	012	007
STA. 3+54		TO STA. 7+89		
FED. ROAD DIST. NO.	ILLINOIS	FED. AID PROJECT		

CONTRACT NO. 63006

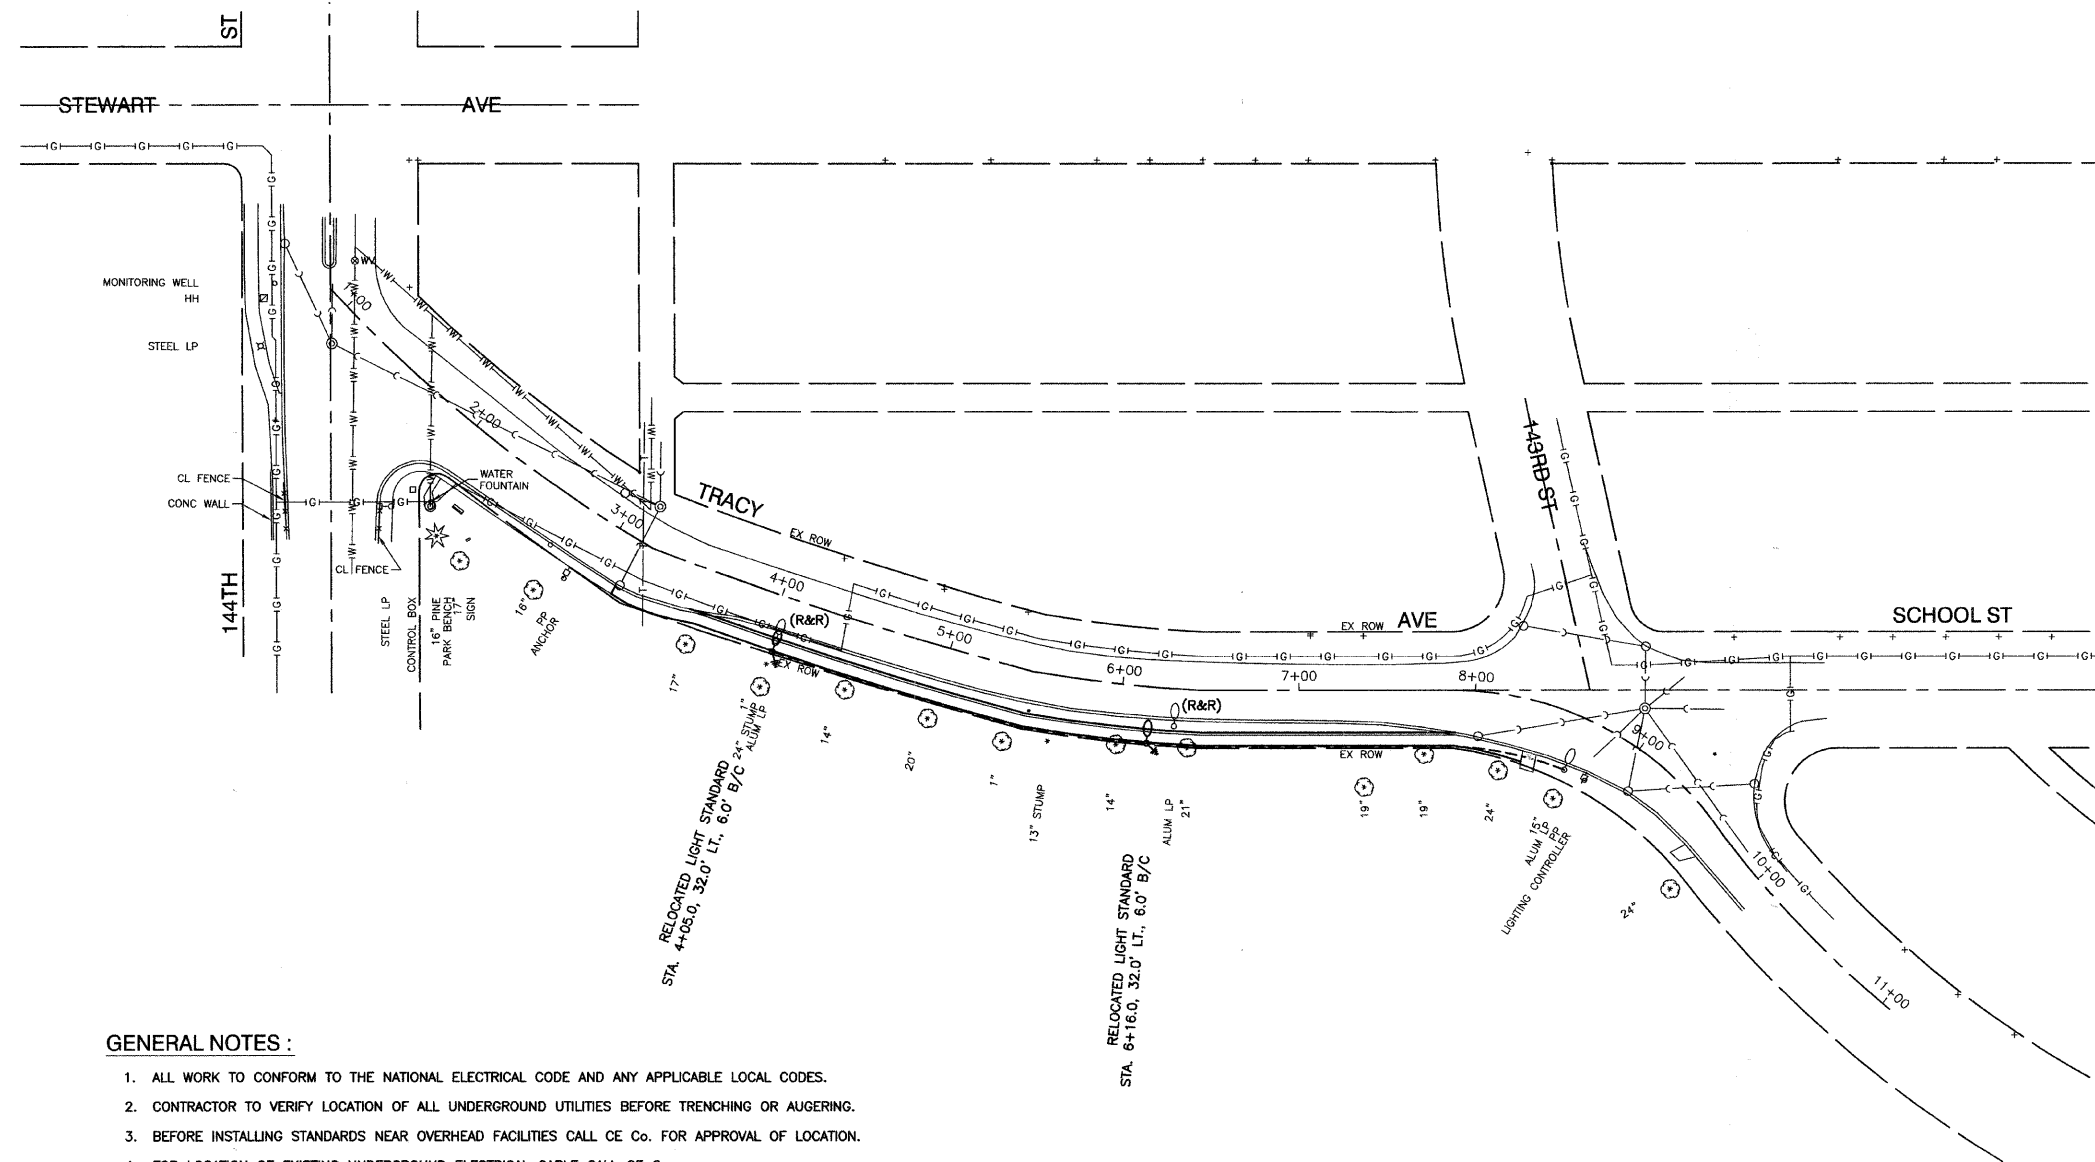

GENERAL NOTES :

1. ALL WORK TO CONFORM TO THE NATIONAL ELECTRICAL CODE AND ANY APPLICABLE LOCAL CODES.
2. CONTRACTOR TO VERIFY LOCATION OF ALL UNDERGROUND UTILITIES BEFORE TRENCHING OR AUGERING.
3. BEFORE INSTALLING STANDARDS NEAR OVERHEAD FACILITIES CALL CE Co. FOR APPROVAL OF LOCATION.
4. FOR LOCATION OF EXISTING UNDERGROUND ELECTRICAL CABLE CALL CE Co.
5. ALL PUSHED CONDUIT TO BE 2" DIAMETER UNLESS OTHERWISE SPECIFIED.
6. ANY TREE TRIMMING REQUIRED AS DIRECTED BY THE ENGINEER SHALL BE PERFORMED BY THE CONTRACTOR, AND THE COST OF THIS WORK SHALL BE CONSIDERED INCIDENTAL TO THE CONTRACT.
7. CONTRACTOR SHALL TAKE ALL NECESSARY MEASURES TO RESTORE ANY SPECIALIZED LANDSCAPING, (i.e. DECORATIVE ROCKS, SHRUBS, PLANTS, ECT.) OR SHALL REPLACE IT, THE COST OF WHICH SHALL BE CONSIDERED INCIDENTAL TO THE CONTRACT.
8. CONNECTION TO EXISTING STREET LIGHT SYSTEM SHALL BE CONSIDERED INCIDENTAL TO THE UNIT PRICE FOR UNIT DUCT.
9. STATION AND OFFSET CALLOUTS FOR PROPOSED FOUNDATIONS ARE TO THE CENTER OF FOUNDATION.

LEGEND:

- EXISTING STREET LIGHT
- RELOCATED STREET LIGHT
- EXISTING CONTROLLER
- P CONDUIT, PUSHED, GALVANIZED STEEL
- T CONDUIT, TRENCHED, GALVANIZED STEEL
- UNIT DUCT, 2-1/2", NO.6 AWG AND NO.8 GROUND, 600V IN 1" DUCT
- SERVICE WIRE, 3-1/2", NO. 1/0 AWG. (SEE LIGHTING CONTROLLER PLAN)
- GR GROUND ROD, 5/8" DIA. x 10'
- (R&R) RELOCATE EXISTING STREET LIGHT
- LT LEFT
- RT RIGHT
- MH MOUNTING HEIGHT
- MA MAST ARM
- B/C BACK OF CURB
- BDTB BREAKAWAY DEVICE, TRANSFORMER BASE, 15" BOLT CIRCLE
- R&R REMOVE AND REPLACE EXISTING STREET LIGHT

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION
IVANHOE METRA COMMUTER KISS 'N RIDE
STREET LIGHTING

SCALE: VERT. 1"=50'
 DATE 11-1-07

DRAWN BY PS/EDG
 CHECKED BY PKB