


PLAN	SURVEYED	DATE
	PLOTTED	
	NOTED	
	BY	
	NO.	

PROFILE	SURVEYED	DATE
	PLOTTED	
	NOTED	
	BY	
	NO.	

- 0 STA. 101+50, 38.0' RT VALVE VAULTS, TYPE A, 5'-DIAMETER, TYPE 1 FRAME, CLOSED LID GATE VALVES, 12"
- 1 STA. 101+73, 26.3' RT FIRE HYDRANT W/AUXILIARY VALVE AND VALVE BOX
- 2 STA. 104+50, 22.5' RT FIRE HYDRANT W/AUXILIARY VALVE AND VALVE BOX


- LEGEND**
- X PROP VALVE VAULT
 - Y PROP VALVE BOX
 - W PROP DOMESTIC WATER SERVICE BOX
 - F PROP FIRE HYDRANT
 - W-W WATER MAIN, DUCTILE IRON PIPE, CLASS 52, (SIZE AND OPEN CUT OR DIRECTIONALL DRILLED AS NOTED)
 - W-W PROP WATER SERVICE CONNECTION - SHORT OR LONG (AS NOTED)

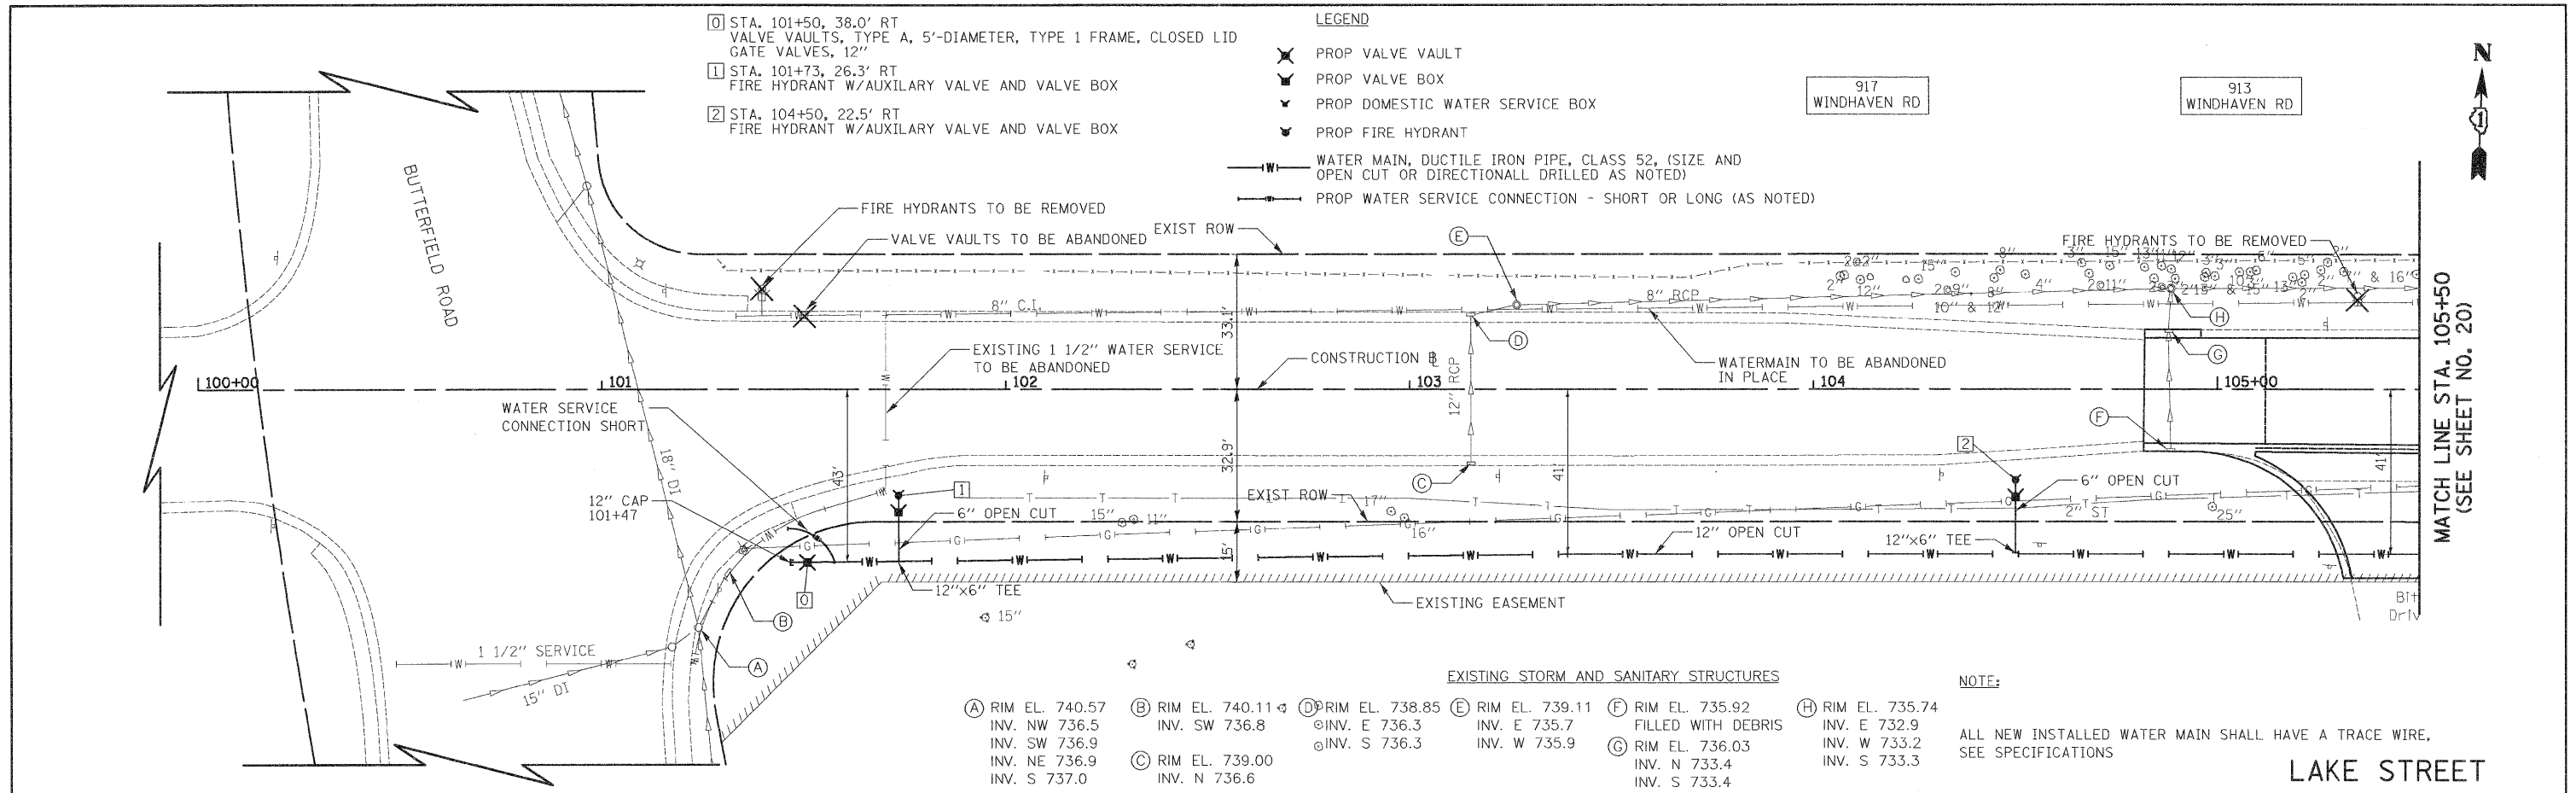

EXISTING STORM AND SANITARY STRUCTURES

(A) RIM EL. 740.57 INV. NW 736.5 INV. SW 736.9 INV. NE 736.9 INV. S 737.0	(B) RIM EL. 740.11 INV. SW 736.8	(D) RIM EL. 738.85 INV. E 736.3 INV. S 736.3	(E) RIM EL. 739.11 INV. E 735.7 INV. W 735.9	(F) RIM EL. 735.92 FILLED WITH DEBRIS RIM EL. 736.03 INV. N 733.4 INV. S 733.4	(H) RIM EL. 735.74 INV. E 732.9 INV. W 733.2 INV. S 733.3
---	-------------------------------------	--	--	--	--

NOTE:
ALL NEW INSTALLED WATER MAIN SHALL HAVE A TRACE WIRE, SEE SPECIFICATIONS

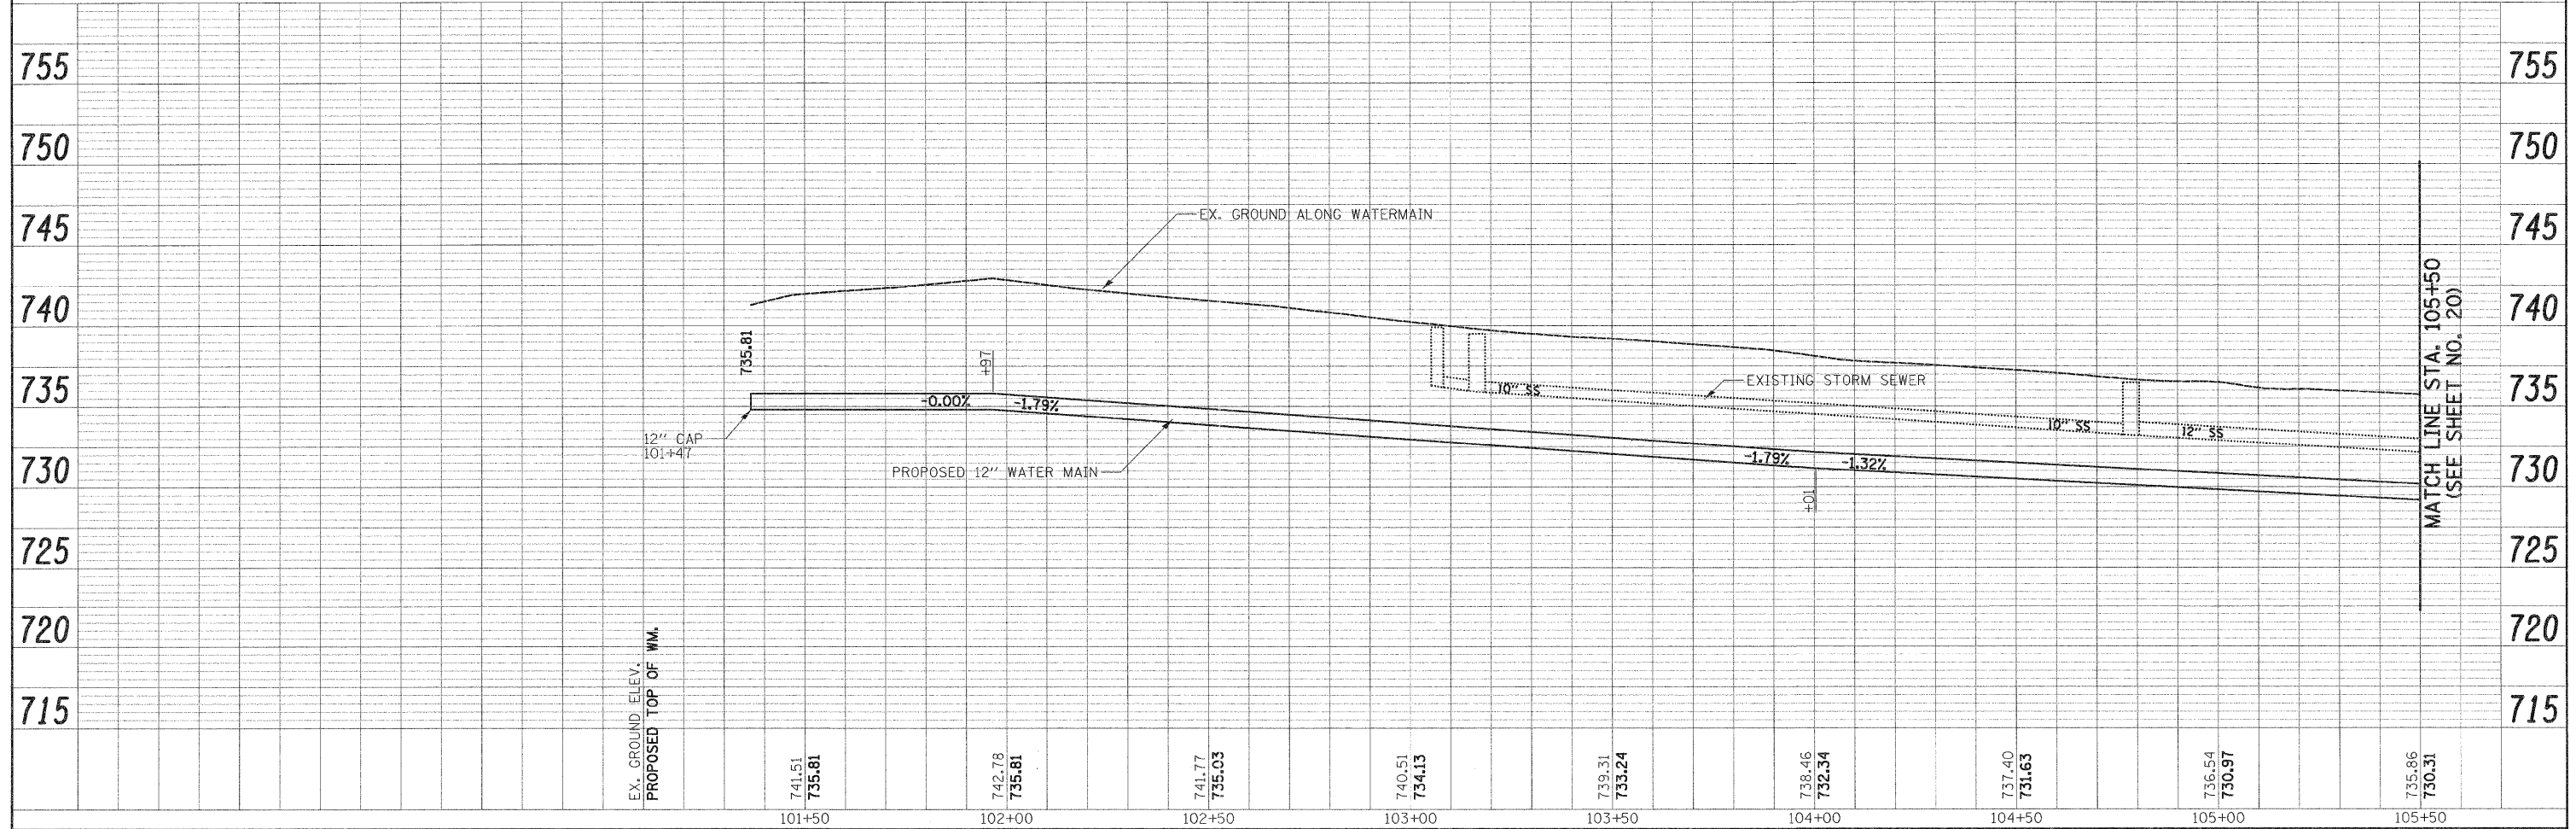

FILE NAME = ...sheet\2253_sht_WM.plt	USER NAME = ead	DESIGNED - EDS	REVISED -	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	WATERMAIN PLAN & PROFILE - LAKE STREET			F.A.U. RTE. 1236	SECTION 08-00100-00-PV	COUNTY LAKE	TOTAL SHEETS 35	SHEET NO. 20
	PLLOT SCALE = 20.0000' / 1in.	DRAWN - EDS	REVISED -		SCALE: 1" = 20'	SHEET NO. 1 OF 5 SHEETS	STA. 100+00 TO STA. 105+50	CONTRACT NO. 63697				
	PLLOT DATE = 3/6/2012	CHECKED - DNM	REVISED -		FED. ROAD DIST. NO. 7 ILLINOIS FED. AID PROJECT							
		DATE - 02/06/12	REVISED -									