


**GENERAL NOTES:**

- At locations where sidewalk is subjected to wheel traffic and/or constructed across access drive entrances, the New P.C.C. Sidewalk Section shall be thickened to 6" across the width of the driveway. This work shall be considered as incidental, and no additional compensation will be allowed.
- Placing, finishing and curing of P.C.C. Sidewalk shall meet the requirements of Sections 424 of the Standard Specifications for Road and Bridge Construction. Use 6 1/2 bag mix with 4% air entrainment.
- Slab or panel contraction (control) joints shall be as follows:  
 For 4' Sidewalk width = 5' O.C. Joint Spacing  
 5' Sidewalk width = 5' O.C. Joint Spacing  
 6' Sidewalk width = 6' O.C. Joint Spacing  
 8' Sidewalk width = 8' O.C. Joint Spacing
- Transverse expansion joints shall consist of preformed joint filler of thickness as follows:  
 1/2" between sidewalk and structures, standards, poles  
 3/4" at sidewalk intervals of not more than 50 feet & abutting concrete curbing or pavement.
- If excavation or undercutting of subgrade has been made deeper than necessary, the base shall be brought to proper grade by the addition of well compacted bedding material without any extra compensation due the Contractor.

**TYPICAL SECTION - P.C.C. SIDEWALK**

ENGINEERING DIVISION CELL LIBRARY DTLS.CEL CELL NAME DTLO01  
 VILLAGE OF LIBERTYVILLE STANDARD NO. 001

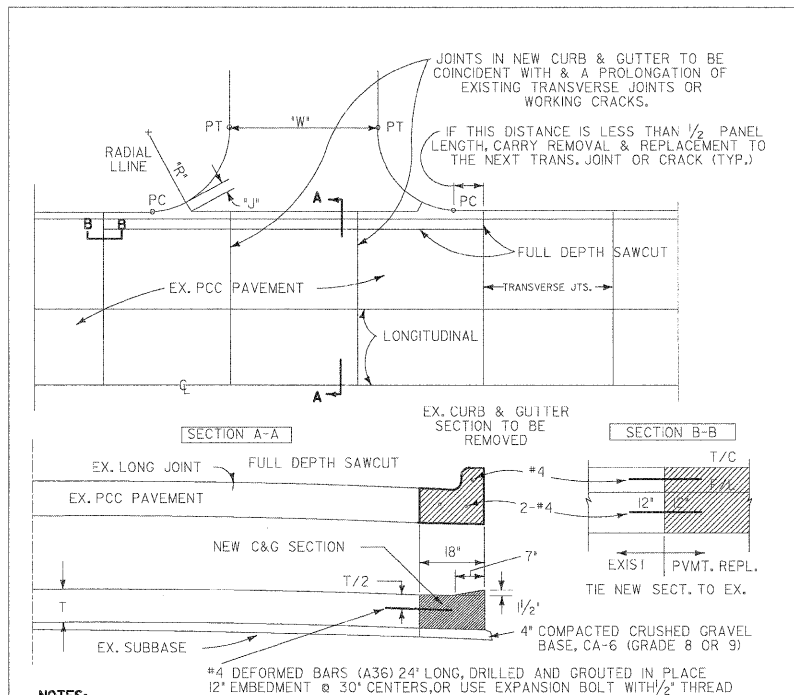


**NOTES:**

- DIMENSIONS 'W', 'R', & 'T' ARE VARIABLE - SEE PLANS  
 DIMENSION 'J' SHALL BE:  
 12" WHEN DRIVEWAY APPROACH PAVEMENT IS BITUMINOUS W/ NO EDGE CURBING  
 18" WHEN DRIVEWAY APPROACH PVMT IS PCC W/NO EDGE CURBING, OR BITUMINOUS W/6" TY. B EDGE CURBING  
 30" WHEN BITUMINOUS PCC APPROACH PVMT WILL HAVE A B-6.12 COMB. CURB AND GUTTER

**INTEGRAL CURB & GUTTER REPLACEMENT FOR NEW OR REPLACEMENT DRIVEWAY**

ENGINEERING DIVISION CELL LIBRARY DTLS.CEL CELL NAME DTLO03  
 VILLAGE OF LIBERTYVILLE STANDARD NO. 003

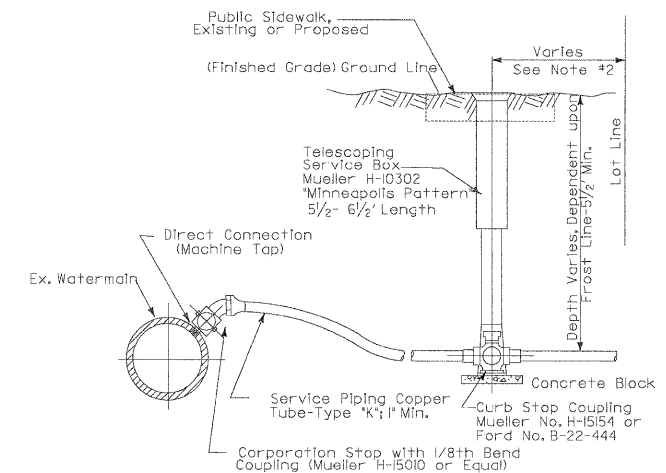

**Notes:**

- Compacted Granular Trench Backfill is Required where any Portion of Excavation Activity is Within Three (3) Feet Horizontally of Existing or Proposed Pavements, Driveways, or Sidewalks.
- Where Public Sidewalk is Present or Proposed, B-Box Shall Be Centered Within Width of Sidewalk
- When Water Services are Installed as Replacements for an Existing Service, Village Water Maintenance Personnel Shall Make the Tap for Services 2" in Diameter or Smaller.

**WATER SERVICE INSTALLATION**

ENGINEERING DIVISION CELL LIBRARY DTLS.CEL CELL NAME DTLO07  
 VILLAGE OF LIBERTYVILLE STANDARD NO. 007