


NOTES

1. FOR SYMBOL LIST AND ABBREVIATIONS, SEE SHEET LT-01.
2. ALL WIRING SHALL BE UNIT DUCT, 600V, 3/16" NO.6, 1/C NO.6 GROUND, (XLP-TYPE USE), 1 1/4" DIA. POLYETHYLENE.
3. POLE SET-BACK SHALL BE MEASURED FROM FACE OF THE CURB TO CENTER OF THE POLE/BASE.
4. POLE SHALL BE WIRED TO CITY OF NAPERVILLE CONTROLLER #019A.
5. BOLT CIRCLE AND ANCHOR NOLTS NUMBER AND LAYOUT OF THE FOUNDATION SHALL MATCH THE RE-INSTALLED POLE.

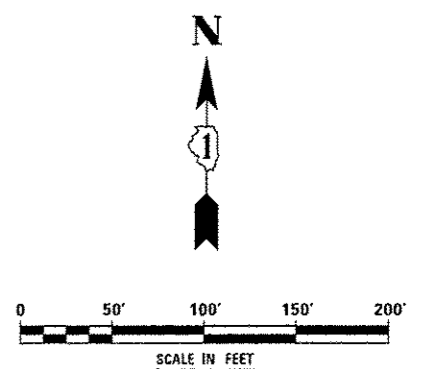

DESIGNED MCP	REVISED - ADDENDUM A 02/22/2013	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	LIGHTING PLANS - DIEHL ROAD		F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.		
DRAWN MLE	REVISED -		SCALE: AS SHOWN	SHEET NO. 8 OF 8 SHEETS	STA.	TO STA.	338	(112 & 113) WRS-6	DUPAGE	734	484
CHECKED MCP	REVISED -						CONTRACT NO. 60R31				
DATE 09/07/2012	REVISED -						ILLINOIS FED. AID PROJECT				