

DIMENSION 'E'

GRADE	<i>'D'</i> = 15°		<i>'D'</i> = 20°	
	UPGRADE END	DOWNGRADE END	UPGRADE END	DOWNGRADE END
0%	2 3/8"	2 3/8"	2 3/8"	2 3/8"
Over 0% to 1%	2 1/4"	2 5/8"	2 1/8"	2 5/8"
Over 1% to 2%	1 3/4"	3"	1 1/2"	3 1/8"
Over 2% to 3%	1 3/8"	3 1/2"	1 1/4"	3 3/4"
Over 3% to 4%	1"	3 7/8"	3/8"	4 1/4"

NOTES




- The Backwall and the portion of the Wingwalls above the bonded construction joint shall be cast against the in-place beam.
- Reinforcement bars shall conform to the requirements of A.A.S.H.T.O. M-31 or M-322, Grade 60.
- Space reinforcement in cap to miss anchor bolts.

MAXIMUM PILE LOADS

SPAN	TONS
40'	34
50'	38
60'	43

DESIGN STRESSES

f'c = 3,500 psi
*f*y = 60,000 psi

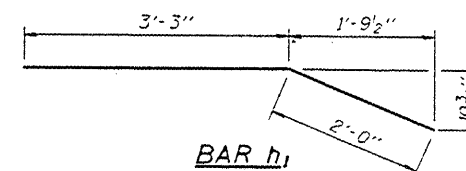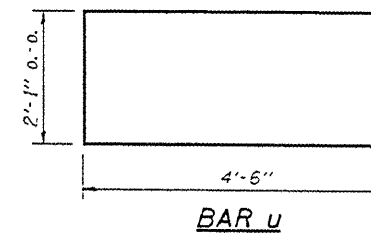

BILL OF MATERIAL FOR ONE ABUTMENT

Bar	No.	Size	Length	Shape
h	16	#4	5'-0"	—
h1	4	#4	5'-3"	—
h2	6	#4	26'-5"	—
p	10	#7	26'-5"	—
s	30	#4	9'-5"	□
u	8	#6	11'-1"	□
v	8	#4	3'-2"	—
v1	8	#4	4'-2"	—
v2	54	#4	3'-11"	—
Concrete Structures			9.7 Cu. Yds.	
Reinforcement Bars			1220 Lb.	

**P.P.C. DECK BEAMS
PILE BENT ABUTMENT**

24' RDWY. | 27" BMS. | *'D'* = 15° OR 20°