



- NOTES:**
- ONE (1) JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 12" X 12" X 6". ONE (1) JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 18" X 18" X 8". SEE ELEVATION DETAIL THIS SHEET.
 - FOR SYMBOL LIST AND GENERAL ELECTRICAL NOTES, SEE SHEET LT-01.
 - UNIT DUCT, 600V, 3-1C NO. 4, 1/C NO. 6 GROUND, (XLP-TYPE USE), 1/4" DIA. POLYETHYLENE.
 - ELECTRIC CABLE IN CONDUIT, 600V (XLP-TYPE USE) (3) 1/C NO. 3/0, 1/C NO. 6 GROUND IN UNDERGROUND CONDUIT, GALVANIZED STEEL, 2" DIA..
 - (2) UNIT DUCTS; ONE UNIT DUCT, 600V, 3-1C NO. 4, 1/C NO. 6 GROUND, (XLP-TYPE USE), 1/4" DIA. POLYETHYLENE AND ONE UNIT DUCT, 600V, 5-1C NO. 4, 1/C NO. 6 GROUND (XLP-TYPE USE), 1/2" DIA. POLYETHYLENE
 - UNIT DUCT, 600V, 5-1C NO. 4, 1/C NO. 6 GROUND, (XLP-TYPE USE), 1/2" DIA. POLYETHYLENE.
 - ELECTRIC CABLE, 600V, (3) 1/C NO. 4, 1/C NO. 6 (XLP-TYPE USE), IN CONDUIT ATTACHED TO STRUCTURE, 2" DIA.. PVC COATED GALVANIZED STEEL AND ELECTRIC CABLE, 600V, (5) 1/C NO. 4, 1/C NO. 6 (XLP-TYPE USE), IN CONDUIT ATTACHED TO STRUCTURE, 2" DIA., PVC COATED GALVANIZED STEEL.
 - UNIT DUCT, 600V, 2-1C NO. 4, 1/C NO. 6 GROUND, (XLP-TYPE USE), 1/4" DIA. POLYETHYLENE.
 - POLE SETBACK SHALL BE MEASURED FROM THE BACK OF CURB TO THE CENTER OF THE POLE.
 - CONDUIT ATTACHED TO STRUCTURE, 3" DIA., PVC COATED GALVANIZED STEEL FOR FUTURE USE BY NAPERVILLE ELECTRIC. PROVIDE 5' OF CONDUIT BEHIND NORTH AND SOUTH RETAINING WALLS. CONDUIT SHALL BE CAPPED. THIS WORK SHALL BE COORDINATED WITH NAPERVILLE ELECTRIC.

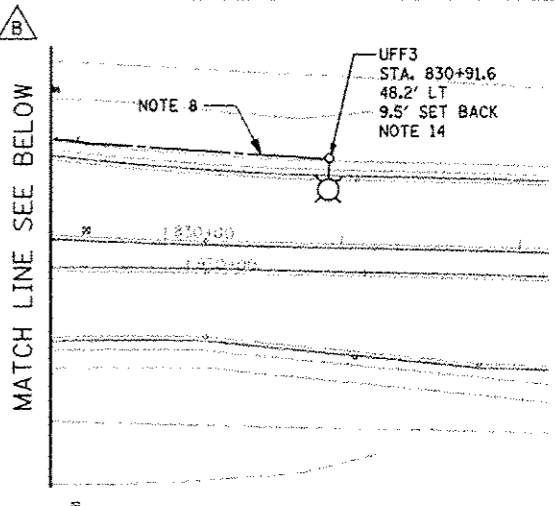

- REPLACE STANDARD HIGH MAST TOWER LUMINAIRE CABLE WITH SPECIAL CABLE AS SPECIFIED IN SPECIAL PROVISIONS FOR "CCTV CAMERA HIGH MAST TOWER INSTALLATION" PAY ITEM. CCTV EQUIPMENT CABINET WITH CCTV VIDEO DECODER SHALL BE INSTALLED INSTEAD OF FUTURE JUNCTION BOX FOR CCTV AS SHOWN ON IDOT D1 STANDARD DRAWING BES00A.
- INSTALL FIBER OPTIC CABLE 6 FIBERS, SINGLE MODE UNSPLICED IN 2" RGS CONDUIT W/CABLE TRACER FROM VIDEO SIGNAL PROCESSOR AT SOUTH TOWER TO THE FIRST TRAFFIC SIGNAL DOUBLE HANDHOLE AND FROM THERE, IN CONDUIT INSTALLED FOR TRAFFIC SIGNALS TO THE SOUTH RAMP SIGNAL CABINET. FROM THERE, CONNECT FIBER OPTIC TO THE SIGNAL INTERCONNECT FIBER OPTIC CABLE TO THE NORTH RAMP SIGNAL CONTROLLER.
- INSTALL FIBER OPTIC CABLE 6 FIBERS, SINGLE MODE UNSPLICED IN 2" RGS CONDUIT W/CABLE TRACER FROM VIDEO SIGNAL PROCESSOR AT NORTH TOWER TO THE FIRST TRAFFIC SIGNAL DOUBLE HANDHOLE AND FROM THERE, IN CONDUIT INSTALLED FOR TRAFFIC SIGNALS TO THE NORTH RAMP SIGNAL CABINET.
- CONNECT BOTH CCTV CAMERAS LOCATED ON HIGH MAST TOWERS AND NORTH AURORA RD. CCTV CAMERA VIA FIBER OPTIC CABLE, NO. 62.5/125, MM12F SM24F UNSPLICED IN INNERDUCT W/CABLE TRACER FROM THE NORTH RAMP SIGNAL CABINET TO THE NEW COMMUNICATIONS VAULT FIBER OPTIC G45 NETWORK LOCATED ON THE NORTH SIDE OF I-88 (EXTRA FIBER OPTIC IN INNERDUCT FOR FUTURE USE).
- PROPOSED STORM SEWER IN CONFLICT WITH LIGHT POLE LOCATIONS. LIGHT POLE FOUNDATION 24" DIA. OFFSET. FOUNDATION CENTER IS 5'-6" EAST OF LIGHT POLE CENTER.

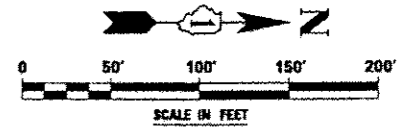

FILE NAME	USER NAME	DESIGNED	REVISED	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	IDOT LIGHTING PLAN - ILLINOIS ROUTE 59 AT INTERSTATE 88	F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
#FILES		DRAWN	REVISED			338	(112 & 113) WRS-5	DUPAGE	963	559
PLOT SCALE		CHECKED	REVISED			LT-04		CONTRACT NO. 60131		
PLOT DATE		DATE	REVISED			SCALE: AS SHOWN SHEET NO. 2 OF 2 SHEETS STA. 4051+75 TO STA. 4067+00		ILLINOIS FED. AID PROJECT		