

NOTES:


1. FOR SYMBOL LIST AND GENERAL ELECTRICAL NOTES, SEE SHEET LT-06.
2. JUNCTION BOX, STAINLESS STEEL, EMBEDDED IN STRUCTURE, 20" X 12" X 8".
3. JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 12" X 10" X 6".
4. JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 6" X 6" X 4".
5. UNDERPASS LIGHTING UNDER SB IL-59 BRIDGE SHALL BE TEMPORARILY FED AS SHOWN. AERIAL CABLE, JUNCTION BOX, CONDUIT AND CONDUCTORS USED FOR TEMPORARY FEED SHALL BE REMOVED WHEN FINAL LIGHTING CONDITIONS WILL BE MET WEST OF THE RESPECTIVE BRIDGE. SEAL THE TEMPORARY OPENINGS IN JUNCTION BOXES NO. 13 AND NO. 14. SEE SHEET LT-19 FOR AERIAL CABLE ATTACHED TO STRUCTURE DETAIL.
6. FOR UNDERPASS LIGHTING INSTALLATION DETAILS, SEE SHEET LT-20.

JUNCTION BOX LOCATIONS

NO.	STATION	OFFSET
1	6526+82	0'
2	6526+86	0'
3	6527+01	2' LT
4	6527+02	2' RT
5	6527+26	2' LT
6	6527+27	2' RT
7	6527+43	0'
8	6527+47	0'
9	6527+46	0'
10	6527+90	0'
11	6528+03	2' LT
12	6528+02.5	2' RT
13	6528+28	2' LT
14	6528+28.5	2' RT

UNDERPASS LUMINAIRE LOCATIONS

NO.	STATION	OFFSET
15	6526+99.6	2' RT
16	6526+98.8	2' LT
17	6527+29.6	2' RT
18	6527+28.8	2' LT
19	6528+0.8	2' RT
20	6528+0.3	2' LT
21	6527+30.8	2' RT
22	6528+30.3	2' LT

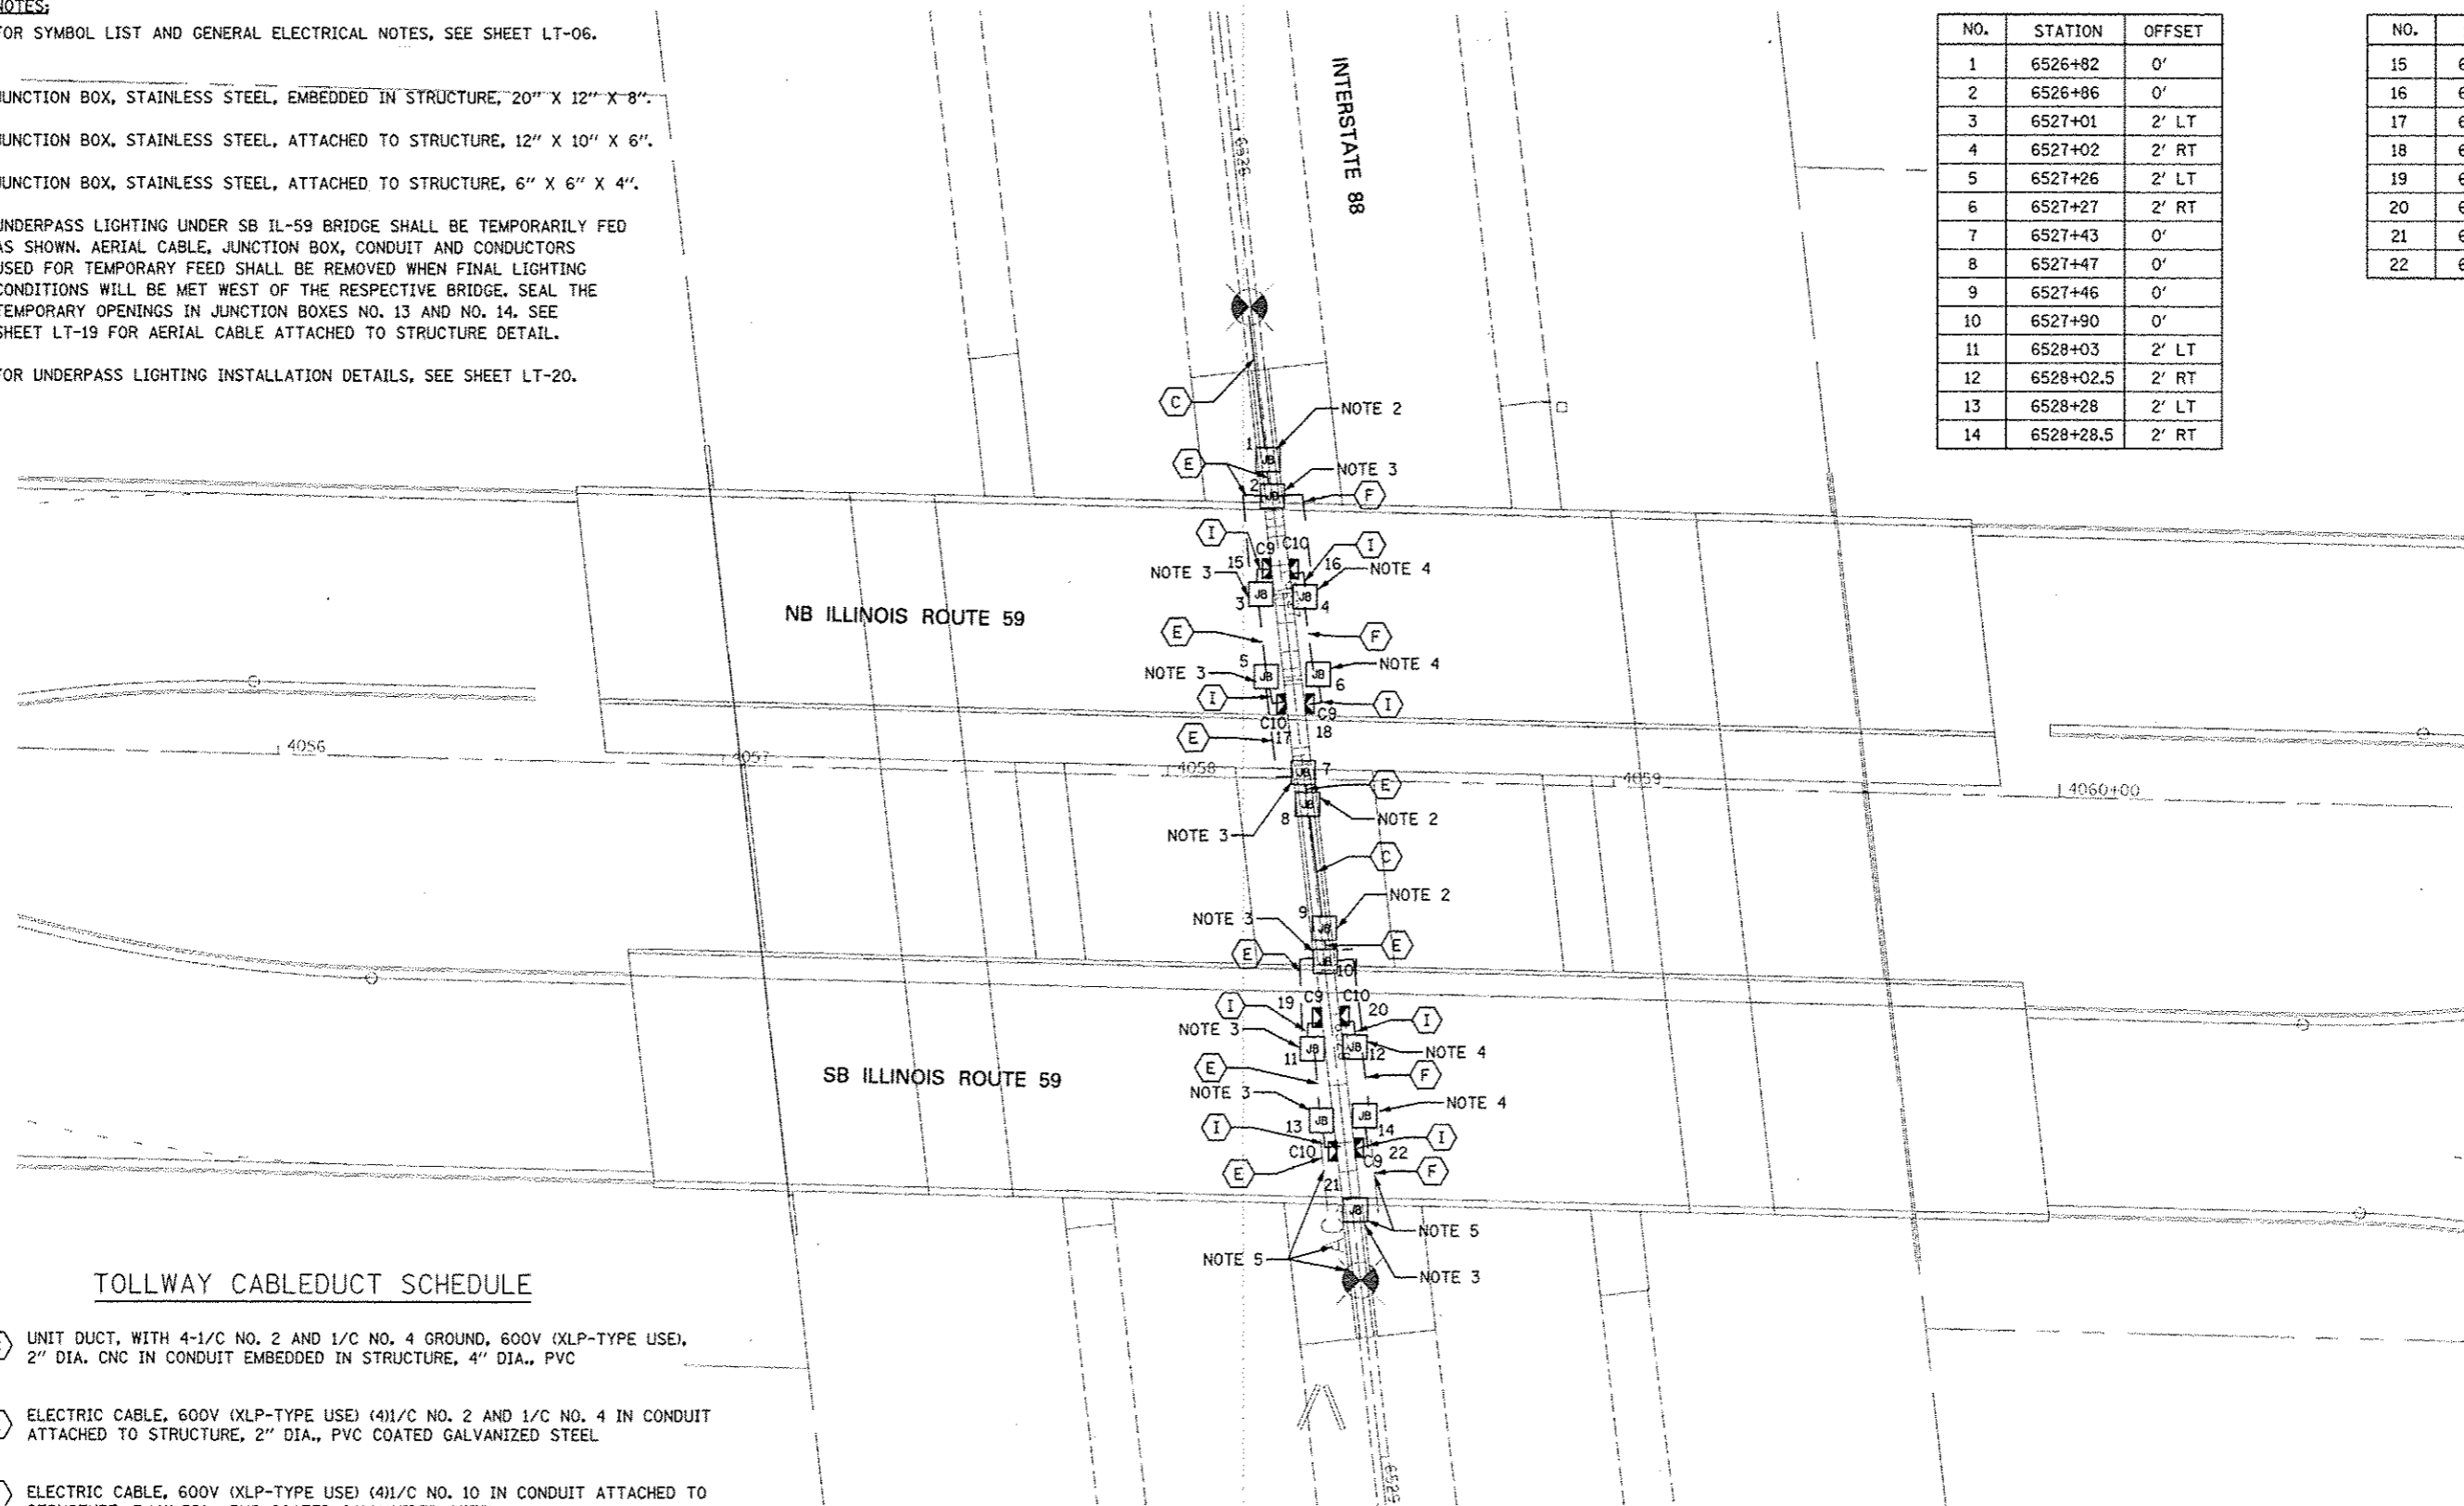

TOLLWAY CABLEDUCT SCHEDULE

- (C)** UNIT DUCT, WITH 4-1/C NO. 2 AND 1/C NO. 4 GROUND, 600V (XLP-TYPE USE), 2" DIA. CNC IN CONDUIT EMBEDDED IN STRUCTURE, 4" DIA., PVC
- (E)** ELECTRIC CABLE, 600V (XLP-TYPE USE) (4)1/C NO. 2 AND 1/C NO. 4 IN CONDUIT ATTACHED TO STRUCTURE, 2" DIA., PVC COATED GALVANIZED STEEL
- (F)** ELECTRIC CABLE, 600V (XLP-TYPE USE) (4)1/C NO. 10 IN CONDUIT ATTACHED TO STRUCTURE, 3/4" DIA., PVC COATED GALVANIZED STEEL
- (I)** ELECTRIC CABLE, 600V (XLP-TYPE USE) (3)1/C NO. 10 IN , 3/4" LIQUIDTIGHT FLEXIBLE METALLIC CONDUIT

