




LEGEND:

 PROPOSED ALGONQUIN LIGHTING UNIT TYPE 4
 ORNAMENTAL LIGHTING, LED ACORN POST
 MOUNTED, 14 FT. M.H., 96W OR 70W, 120V
 -TYPE 3 DISTRIBUTION (TYP.)
 -TYPE 5 DISTRIBUTION (AS NOTED ON PLANS)

 PROPOSED ALGONQUIN LIGHTING UNIT TYPE 5
 ORNAMENTAL LIGHTING, TWIN LED ACORN
 POST MOUNTED, 14 FT. M.H., 96W OR 70W, 120V
 -TYPE 3 DISTRIBUTION (TYP.)

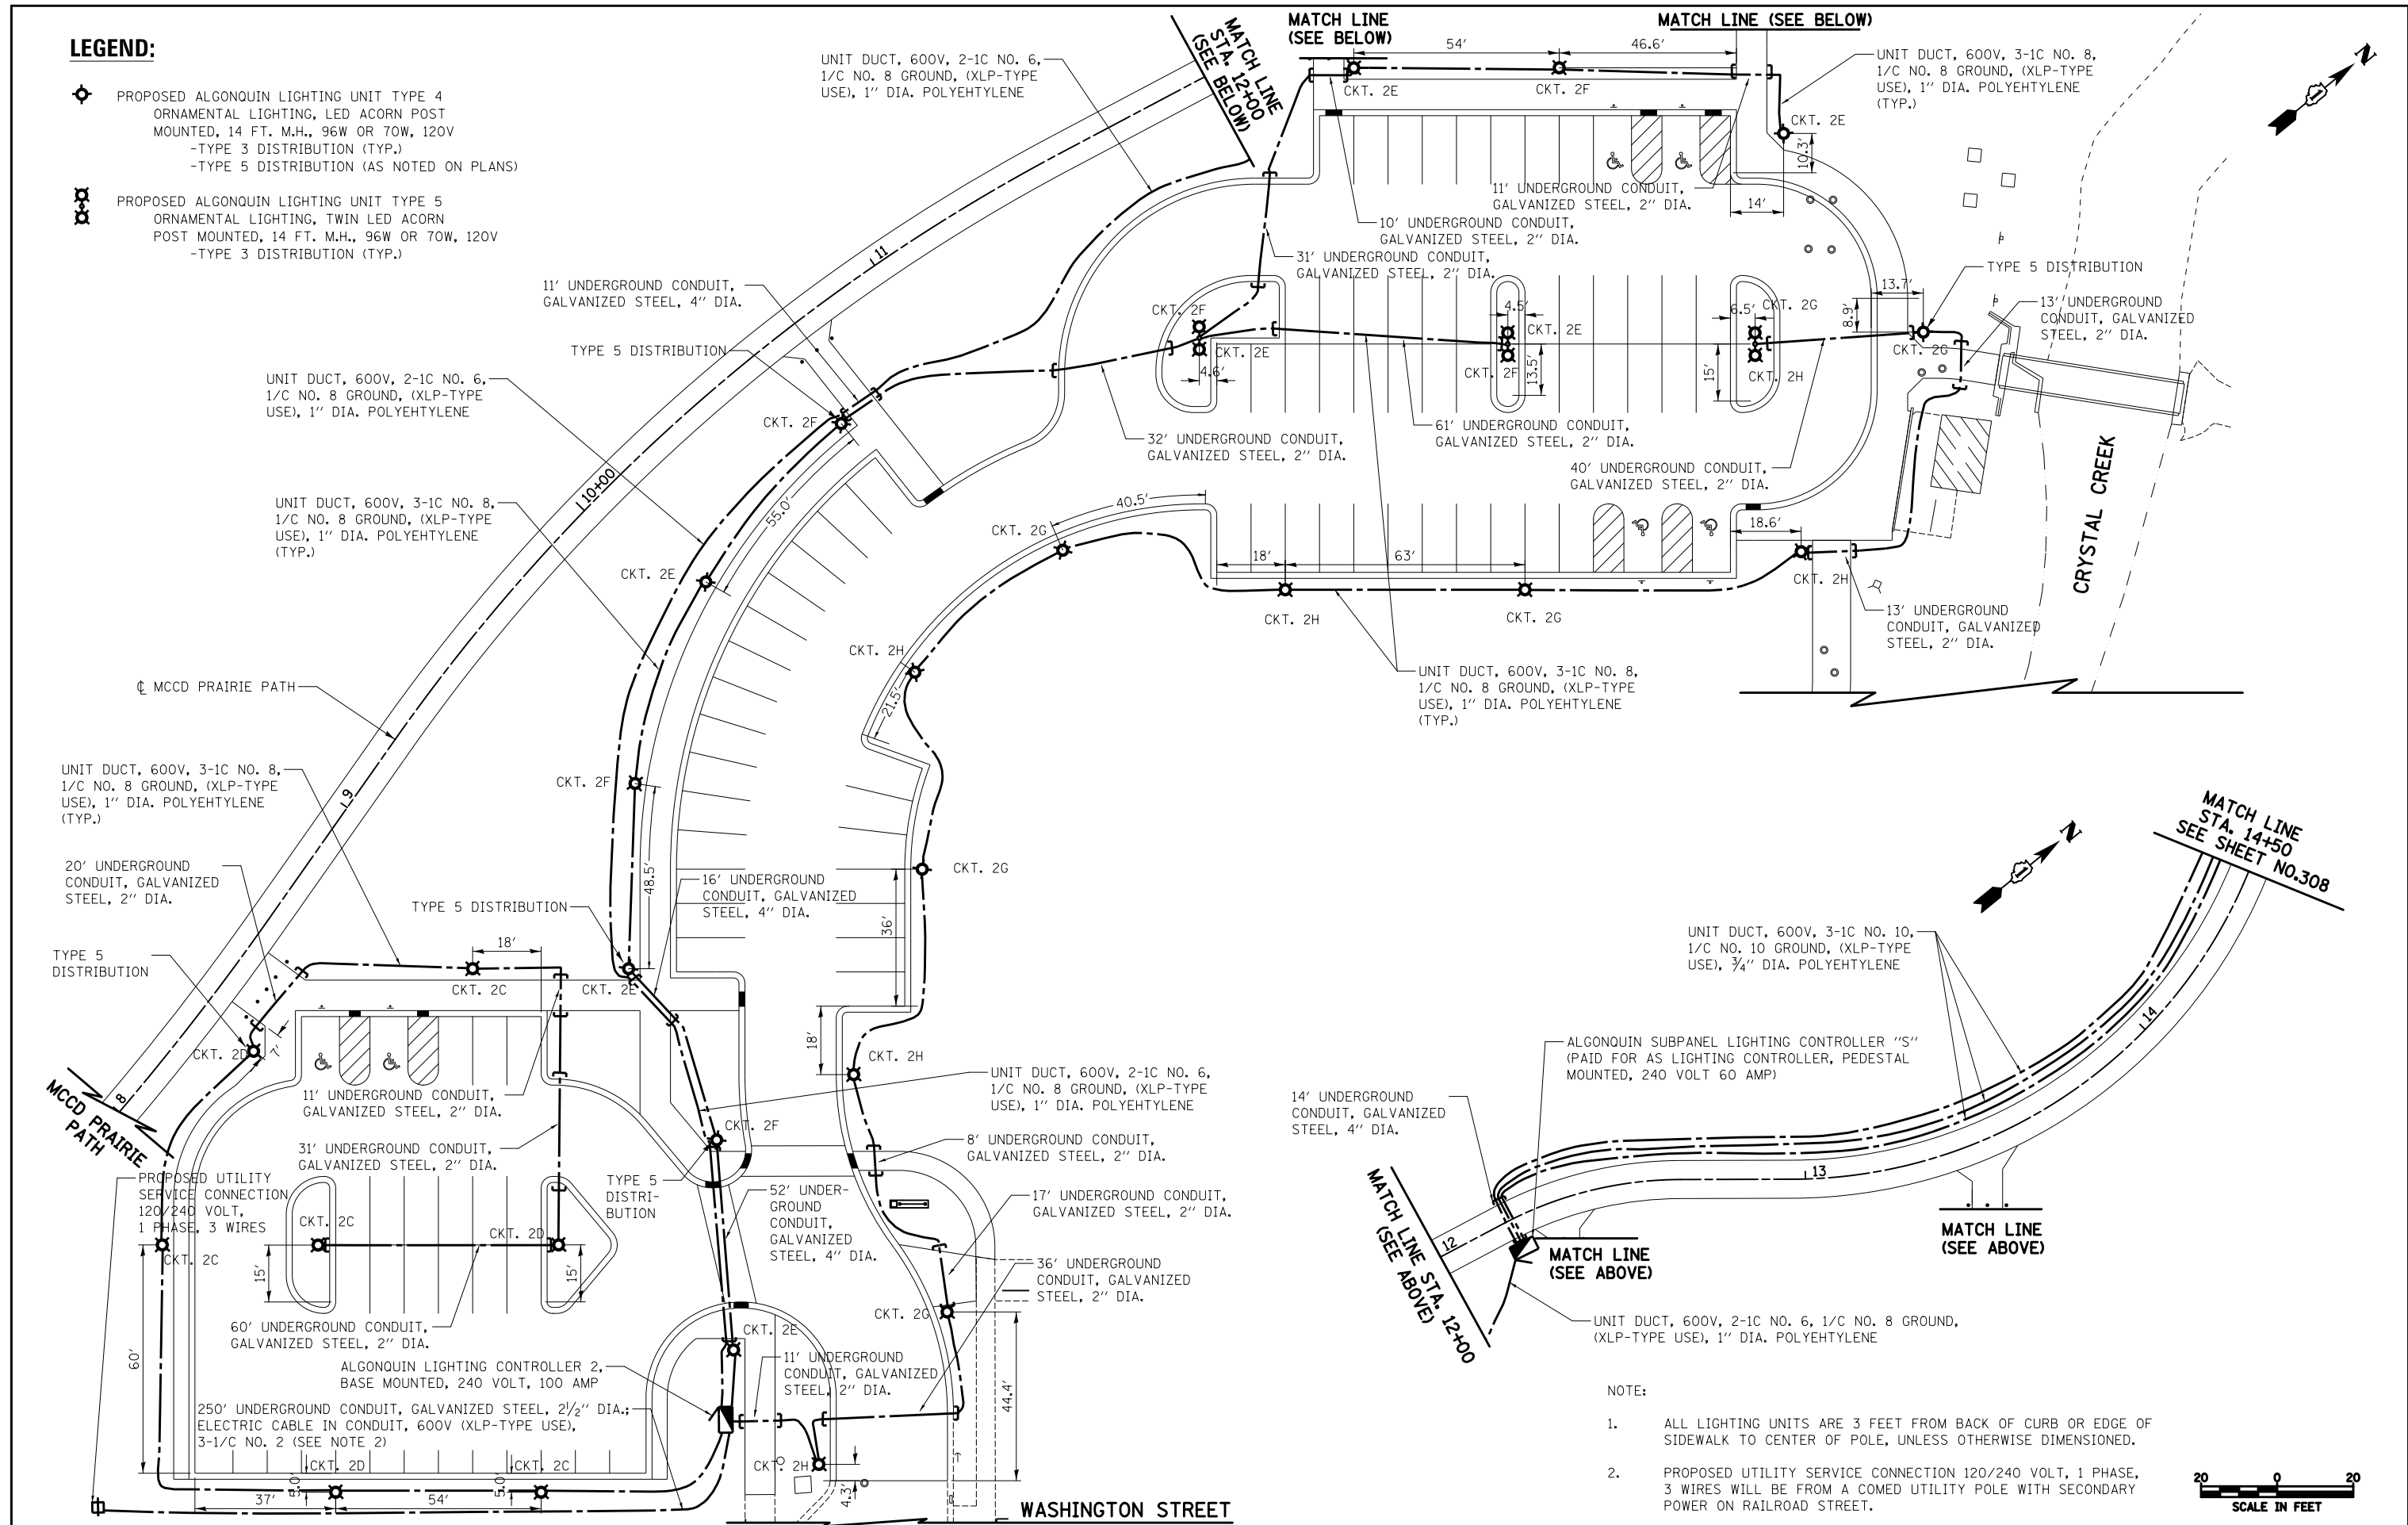

- NOTE:
- ALL LIGHTING UNITS ARE 3 FEET FROM BACK OF CURB OR EDGE OF SIDEWALK TO CENTER OF POLE, UNLESS OTHERWISE DIMENSIONED.
 - PROPOSED UTILITY SERVICE CONNECTION 120/240 VOLT, 1 PHASE, 3 WIRES WILL BE FROM A COMED UTILITY POLE WITH SECONDARY POWER ON RAILROAD STREET.



FILE NAME =	USER NAME = akw	DESIGNED - SJC	REVISED -
...\\D160F72-sht-light-12.Towne Parking Loadn		DRAWN - SJC	REVISED -
	PLOT SCALE = 40.0000' / in.	CHECKED - DNM	REVISED -
	PLOT DATE = 5/2/2012	DATE - 5/3/2012	REVISED -

STATE OF ILLINOIS
DEPARTMENT OF TRANSPORTATION

TOWNE PARK LIGHTING PLANS
 SCALE: 1" = 20' SHEET NO. 13 OF 31 SHEETS STA. TO STA.

O.R. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
0003	18A-2	MCHENRY	825	310
CONTRACT NO. 60F72			FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT	