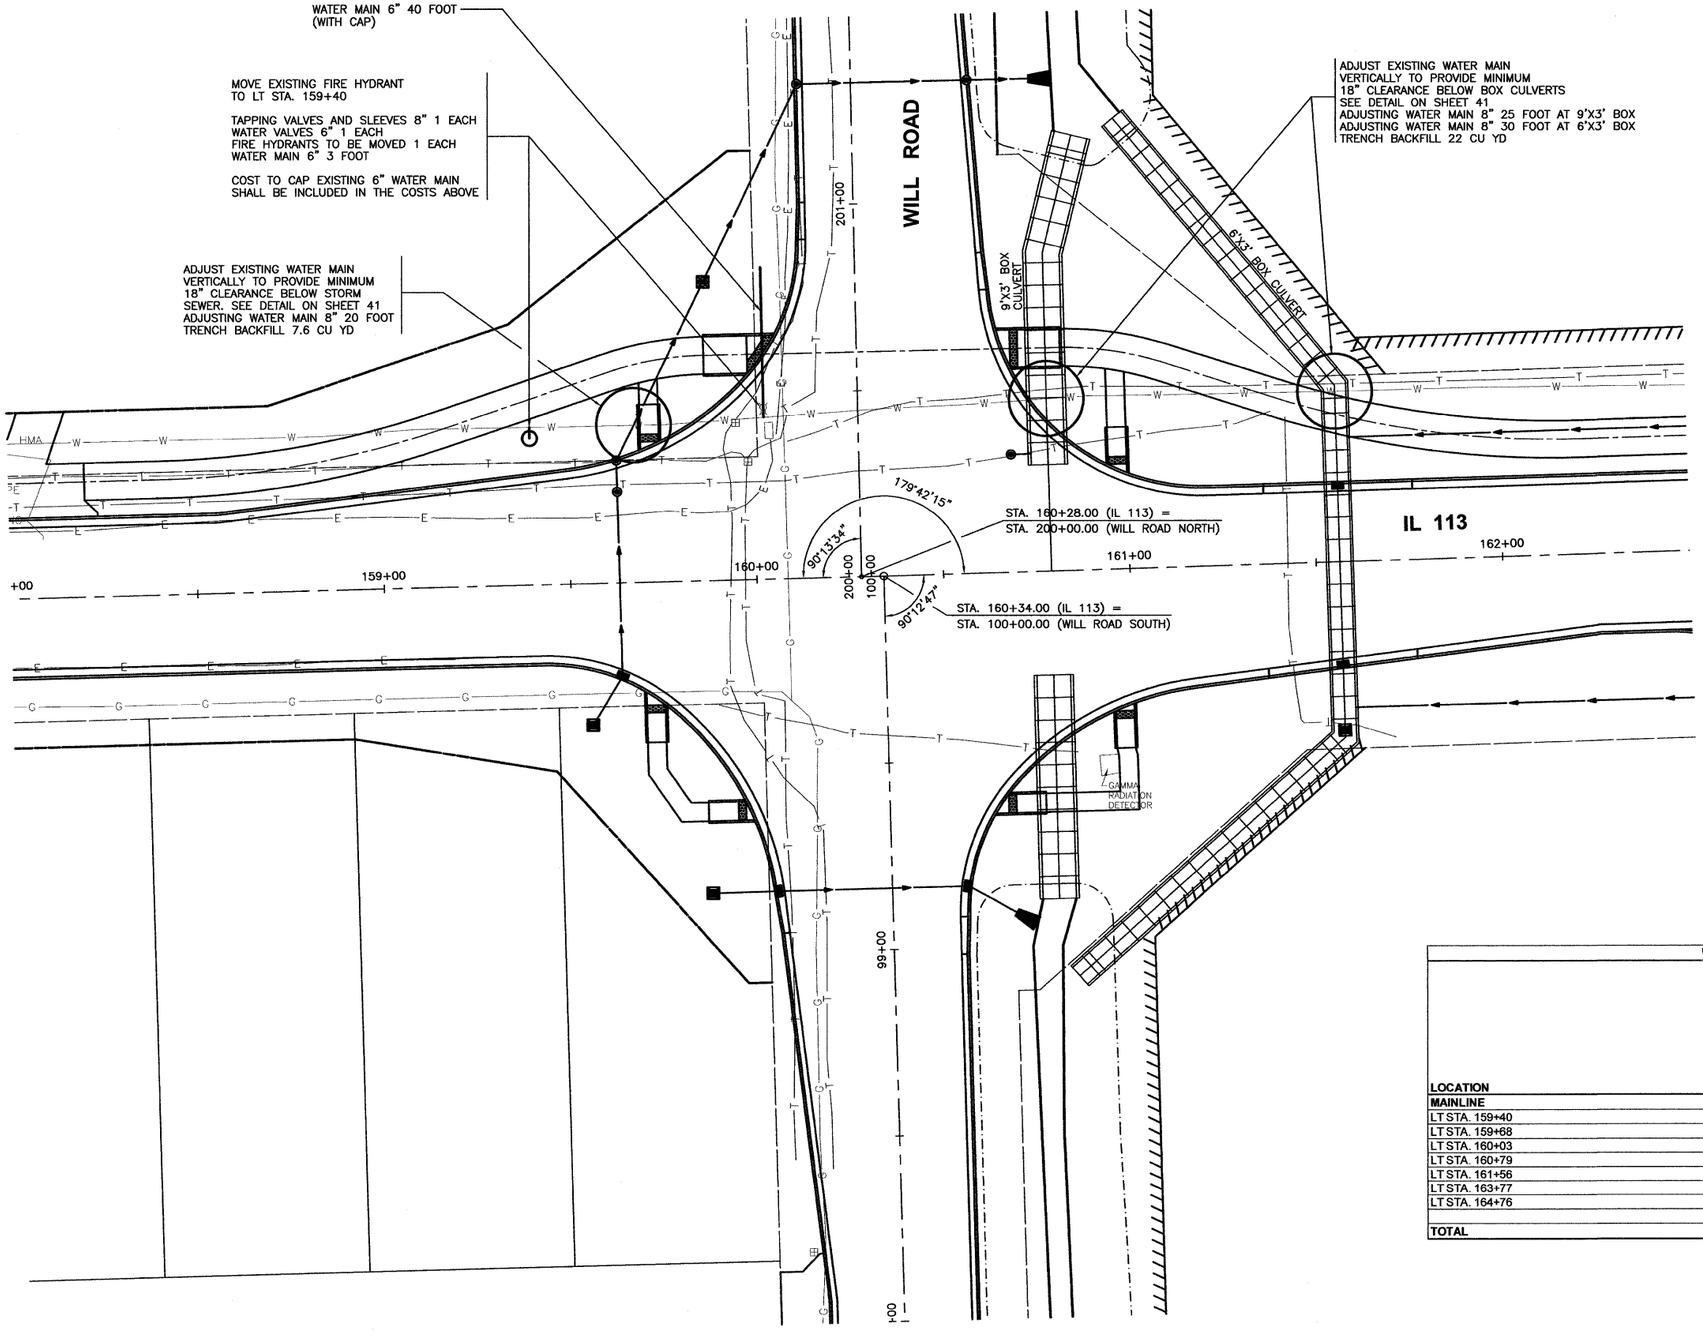

WATER MAIN SCHEDULE

LOCATION	TRENCH BACKFILL CU YD	WATER MAIN 6" FOOT	WATER VALVES 6" EACH	ADJUSTING WATER MAIN 8" FOOT	TAPPING SLEEVES AND VALVES 8" EACH	WATER VALVES TO BE ADJUSTED EACH	FIRE HYDRANTS TO BE MOVED EACH	FIRE HYDRANT EXTENSION FOOT
MAINLINE								
LT STA. 159+40	—	3	1	—	1	—	1	—
LT STA. 159+68	7.6	—	—	20	—	—	—	—
LT STA. 160+03	16.9	40	—	—	—	1	—	—
LT STA. 160+79	8.7	—	—	25	—	—	—	—
LT STA. 161+56	13.3	—	—	30	—	—	—	—
LT STA. 163+77	—	—	—	—	—	1	—	—
LT STA. 164+76	—	—	—	—	—	1	—	3
TOTAL	**47**	**43**	**1**	**75**	**1**	**3**	**1**	**3**

CHAMLIN & ASSOCIATES, INC. ©2011
Drawing Name: G:\Users\66022-01-Diamond Will Road & IL 113-Env-Survey\CAD\C3D\PLANS-EXTENDED\CHG-WATER MAIN PLAN.dwg Last Modified: Mar 27, 2012 - 4:12pm Plotted on: Mar 28, 2012 - 11:16am by nancia

DRAWN BY: NV	REVISIONS			
CHECKED BY: JKC	LEVEL	BY	DATE	DESCRIPTION
DATE: 02/12				

CHAMLIN & ASSOCIATES — PERU MORRIS ILLINOIS

FAS 301 / FAU 383
SECTION 11-00007-00-WR
VILLAGE OF DIAMOND
GRUNDY AND WILL COUNTIES

WATER MAIN PLANS
IL 113 AND WILL ROAD

CONSTRUCTION PLANS

CONTRACT NO. 87520

CURRENT AS OF: 02/12		
SCALE: AS NOTED	SHEET	40
FILE NO.: 66022.01 Y–	OF	96