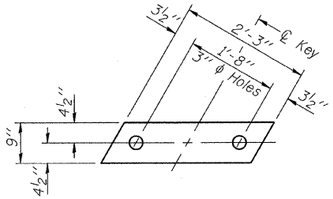

FABRIC BEARING PAD
(Interior - 20 Req'd)



FABRIC BEARING PAD
(Exterior - 8 Req'd)

FIXED

Notes:
All bearing pads shall be 1" thick.
Omit holes when using expansion bearings.
Expansion bearing pad shall be bonded to the substructure.

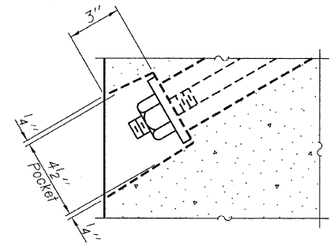

SECTION A-A

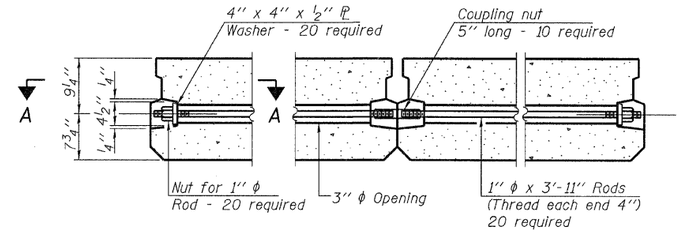

TYPICAL TRANSVERSE TIE ASSEMBLY



BAR A_1(E)

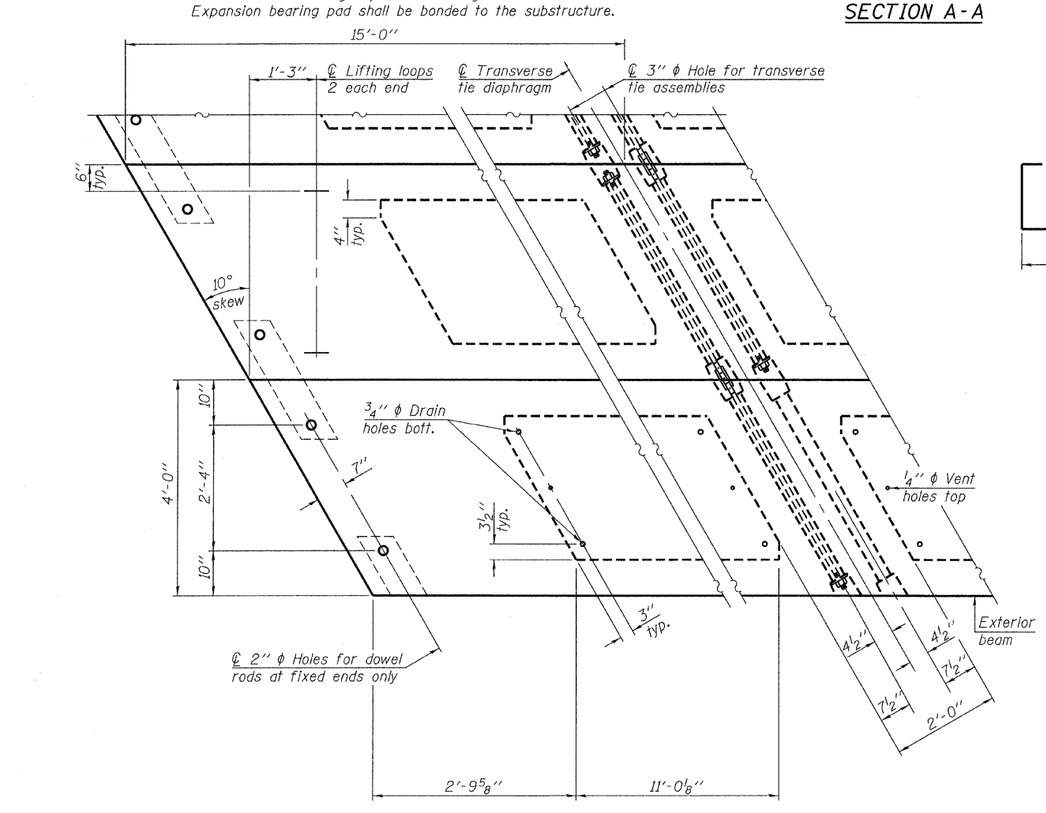

PLAN VIEW



BAR S(E)



BAR S_1(E)



BAR S_2(E)



BAR S_3(E)



BAR S_4(E)



BAR U(E)

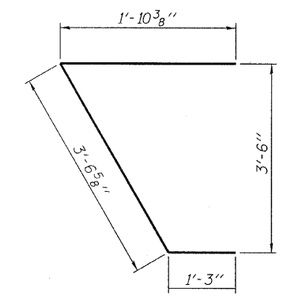

BAR U_1(E)

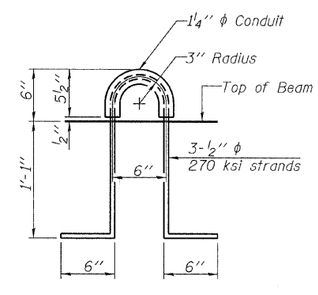

LIFTING LOOP DETAIL

Note: Connect beams in pairs with the transverse tie configuration shown.

NOTES

Prestressing steel shall be uncoated high strength, low relaxation 7-wire strand, Grade 270. The nominal diameter shall be ½" and the nominal cross-sectional area shall be 0.153 sq. in.

The 1" ϕ rods in the transverse tie assembly shall be tightened to a snug fit and the threads set. Pockets on exterior faces of bridge shall be filled with grout after transverse tie assembly is in place.

Reinforcement bars shall conform to ASTM A 706, Grade 60. (See Special Provisions).

Two ⅛" fabric adjusting shims of the dimensions of the exterior bearing pad shall be provided for each bearing pad location.

A minimum 2½" ϕ lifting pin shall be used to engage the lifting loops during handling.

Corrosion Inhibitor, per Article 1020.05(b)(12) and 1021.06 of the Standard Specifications, shall be used in the concrete for precast prestressed concrete deck beams.

Compressive strength of prestressed concrete, f'c, shall be 6000 psi.

Compressive strength of prestressed concrete at release, f'ci, shall be 5000 psi.

All reinforcement shall be epoxy coated.

BILL OF MATERIAL

Precast Prestressed Conc. Deck Bms. (17" depth)	Sq. Ft.	1,440

PD-1748-RD 7-1-10

FILE NAME = 110266-sht-bridge.dgn	USER NAME =	DESIGNED - A.S.L.	REVISED -	STATE OF ILLINOIS JEFFERSON COUNTY HIGHWAY DEPARTMENT
HAMPTON, LENZINI AND RENWICK, INC. 3065 STEVENSON DRIVE, SUITE 201 SPRINGFIELD, ILLINOIS 62703 ILLINOIS PROFESSIONAL DESIGN FIRM LS / PE / SE CORP. 184.000959		CHECKED - S.W.M.	REVISED -	
	PLOT SCALE =	DRAWN - D.A.B.	REVISED -	
	PLOT DATE = 2/20/2012	CHECKED - S.W.M.	REVISED -	

17" x 48" PPC DECK BEAM DETAILS – SPANS 1 & 3
STRUCTURE NO. 041-3748
SHEET NO. 4 OF 12 SHEETS

T.R.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
91	09-06122-00-BR	JEFFERSON	37	29
FARRINGTON ROAD DISTRICT		CONTRACT NO. 99471		
ILLINOIS FED. AID PROJECT BROS-0081(063)				