

**CONSTRUCTION NOTES:**

Maintain 8' Minimum Depth (top of Pipe) Below G.L. →

Sta. 21+00 - Remove 25' of old main on each side of the Centerline of Culvert #17 Abandon Pipe Will Be Grouted

Sta. 26+34 - Remove 25' of old main on each side of the Centerline of Culvert #18

**LEGEND:**


UIUC 8" GAS LINE	
GROUND LEVEL DEPTH (Surface)	
PROPOSED GAS LINE (Top of Pipe)	

**MATERIALS:**

MKT NO.	QTY.	DESCRIPTION
1	1100'	8" Steel Pipe - 8.625" O.D., 250 wall, API 5L, Grade B Fusion Bonded Epoxy Coated

**MATERIALS:**

MKT NO.	QTY.	DESCRIPTION

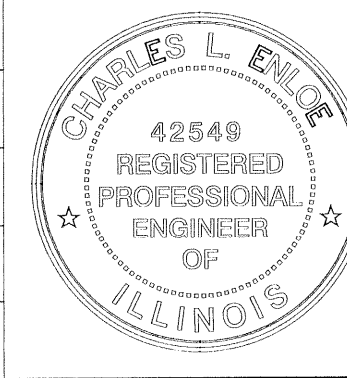

**Revisions**

19-Oct-05	SDP
23-Nov-05	SDP

Scale: 1" = 40'

Utility Safety & Design, Inc.  
 #9 Executive Woods Court Suite 1  
 Belleville, Illinois  
 Relocate UI Lateral  
 Natural Gas Pipeline for  
 Phase 2 of Curtis Road Improvements  
 Station 22+00 to Station 33+00 | U3