

**CONSTRUCTION NOTES:**

Maintain 5' Minimum Depth (top of Pipe) →

Abandon Pipe Will Be Grouted

Sta. 50+73 - Tie In (End of Job)

**LEGEND:**


- UIUC 8" GAS LINE
- GROUND LEVEL DEPTH (Surface)
- PROPOSED GAS LINE (Top of Pipe)

**MATERIALS:**

MKT NO.	QTY.	DESCRIPTION
1	846'	8" Steel Pipe - 8.625" O.D., 250 wall, API 5L, Grade B Fusion Bonded Epoxy Coated
2	2	3R Weld Ell

**MATERIALS:**

MKT NO.	QTY.	DESCRIPTION

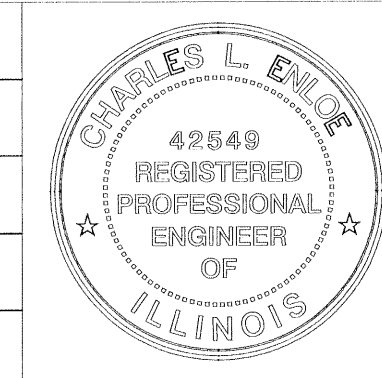

**Revisions**

19-Oct-05	SDP
23-Nov-05	SDP

Utility Safety & Design, Inc.  
#9 Executive Woods Court Suite 1  
Belleville, Illinois

Relocate UI Lateral  
Natural Gas Pipeline for  
Phase 2 of Curtis Road Improvements  
Station 44+00 to Station 51+03 | U5

Scale: 1" = 40'