


SERVICE POLE

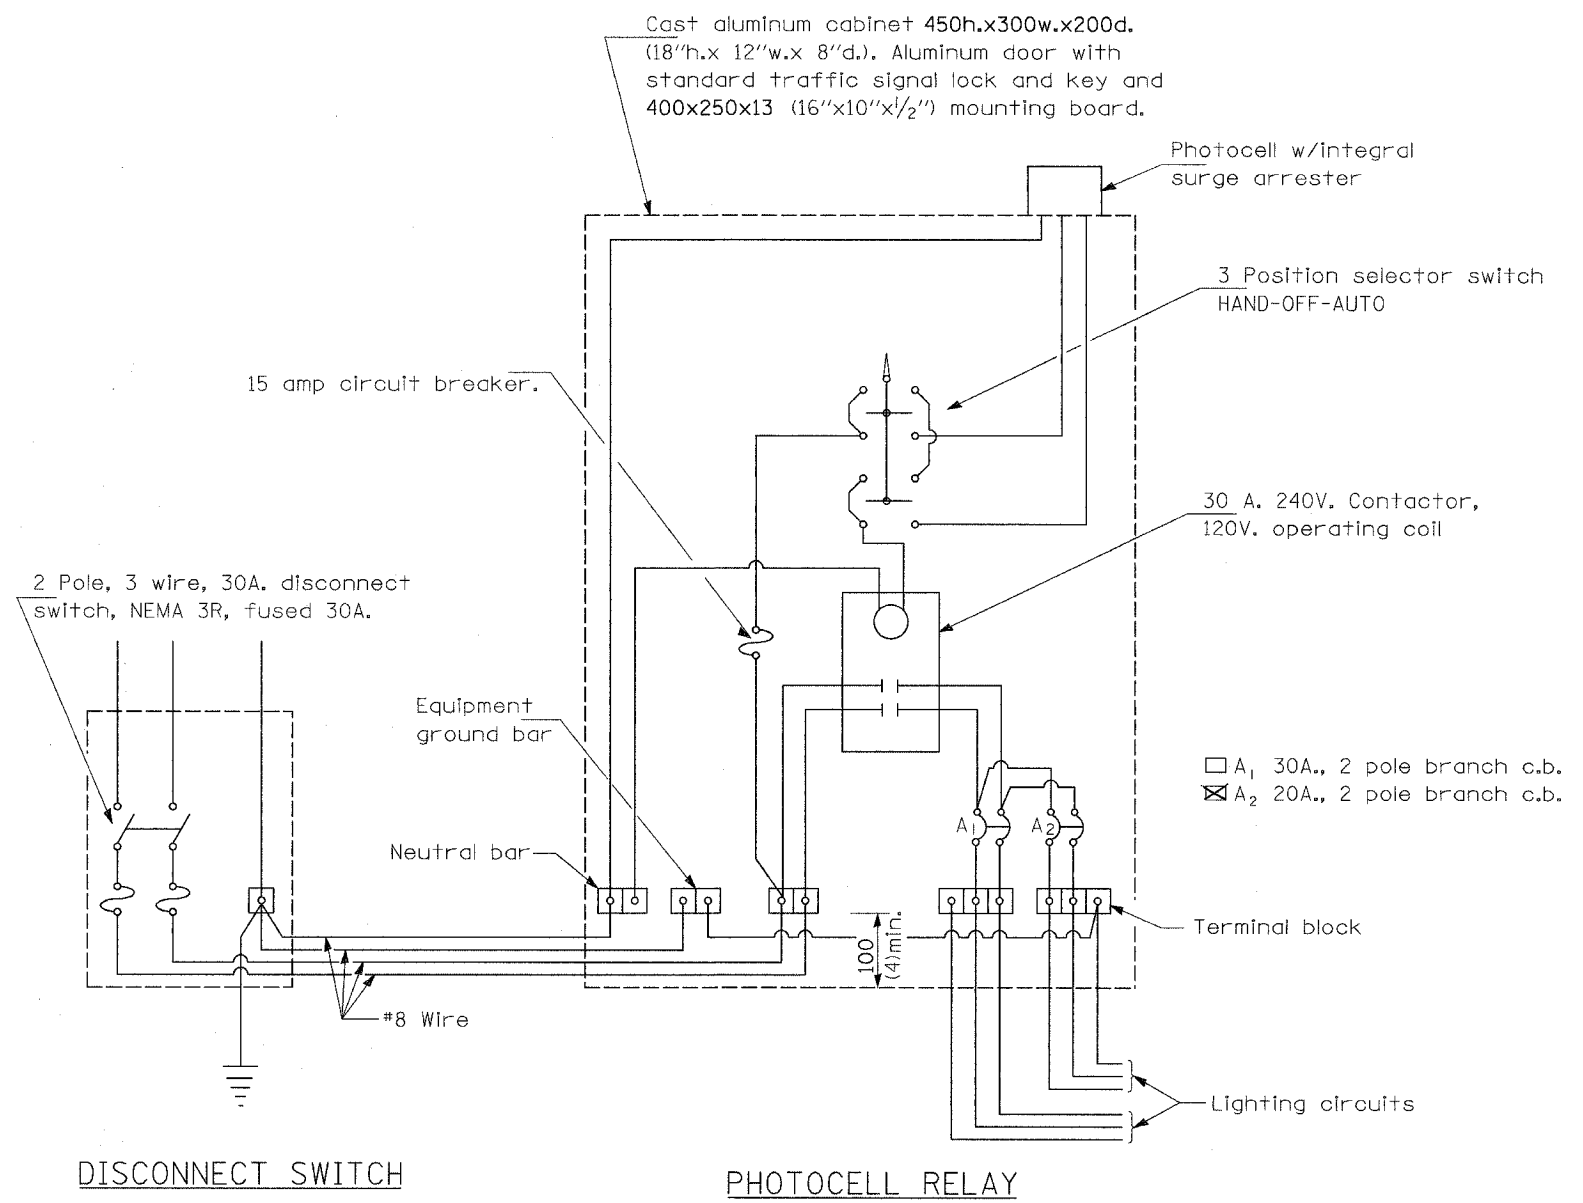

DISCONNECT SWITCH

PHOTOCELL RELAY

GENERAL NOTES

All equipment shall be U.L. Listed.
 All dimensions are in millimeters unless otherwise shown.

DATE	REVISIONS

**CONTROL INSTALLATION
 SERVICE POLE MOUNTED**
 120/240V., 1 PHASE, 3 WIRE SERVICE

Rev.