
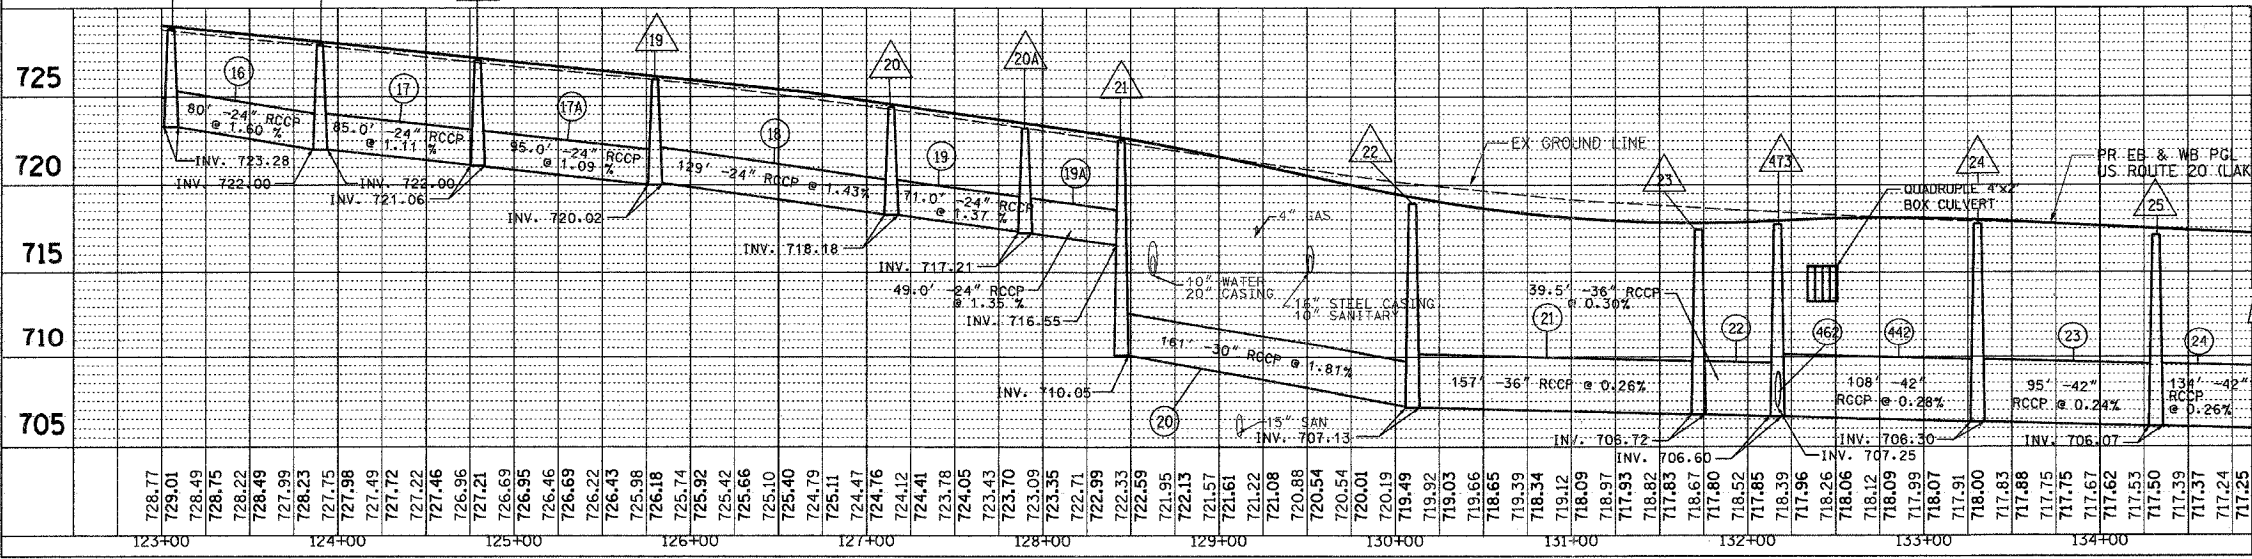



PROPOSED LEGEND

- XX NEW STRUCTURE
- XX NEW STORM PIPE

NOTE

1. WATER MAIN, FIRE HYDRANTS AND VALVE VAULTS FROM STA. 105+70 TO STA. 223+00 TO BE REMOVED/RELOCATED BY THE VILLAGE OF ADDISON AS PART OF 12" WATER MAIN RELOCATION CONTRACT.

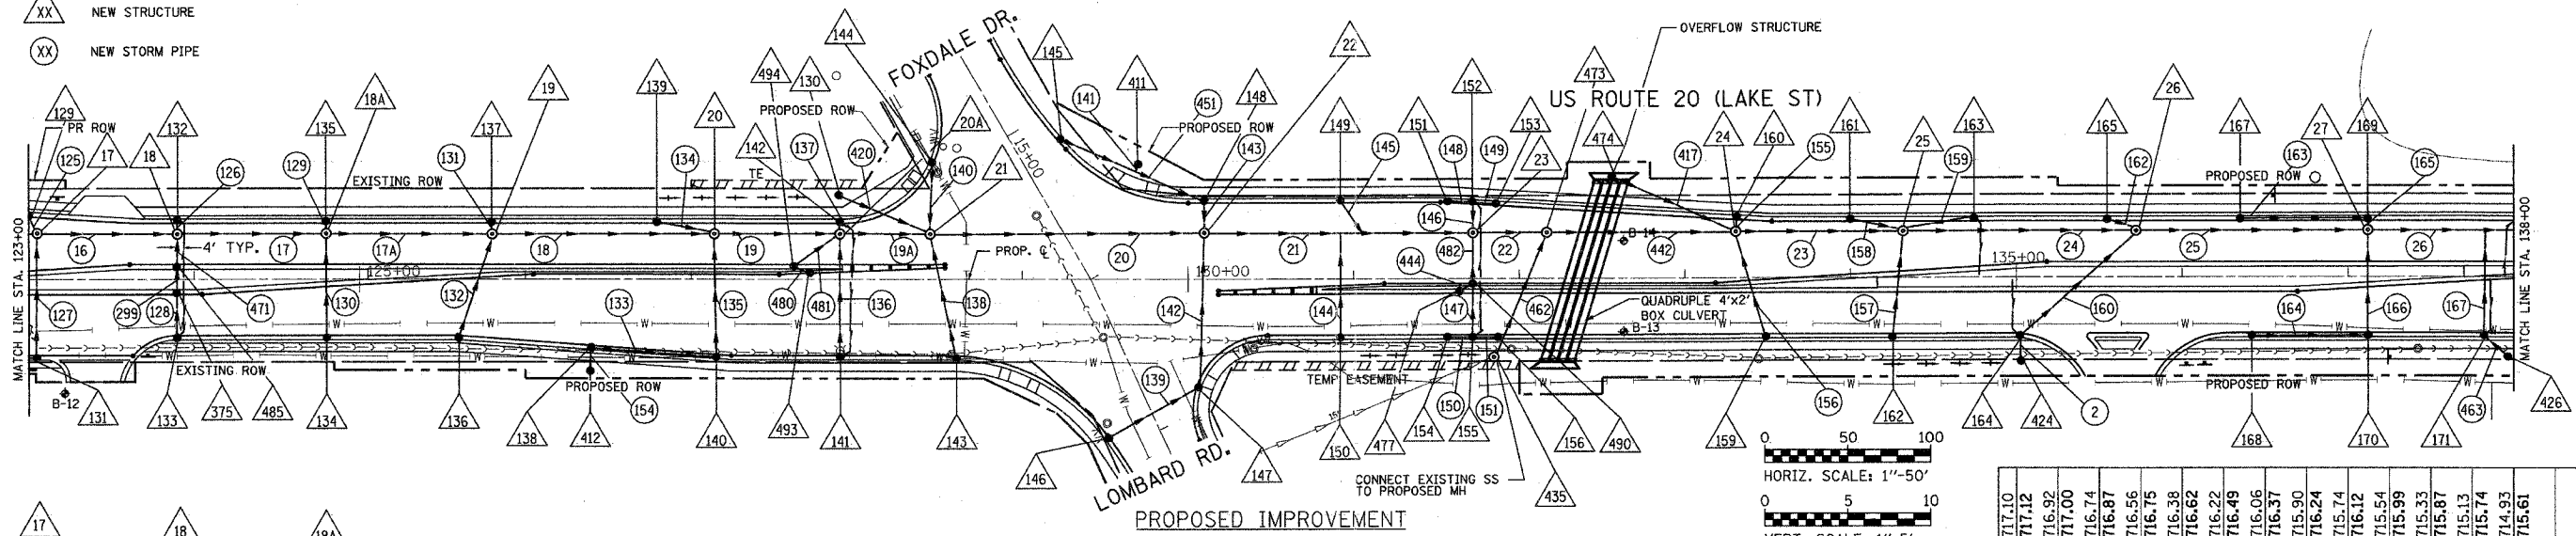

717.10	717.12	716.92	717.00	716.87	716.56	716.75	716.38	716.62	716.22	716.06	716.37	715.90	716.24	715.74	716.12	715.54	715.99	715.33	715.87	715.13	714.93	715.61
135+00	136+00	137+00	138+00																			

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION

DRAINAGE AND UTILITIES
 STA. 123+00 STA. 138+00
 U.S. ROUTE 20 (LAKE ST.)

SCALE: VERT. 1"=5'
 HORIZ. 1"=50'
 DATE: 03/01/05

DRAWN BY: V.P.
 CHECKED BY: J.J.

DATE	BY	REVISION

DATE	BY	REVISION

I:\127\project\design\Sheet146.dwg 01-26-05