


DATE	BY
DATE	BY

DATE	BY
DATE	BY

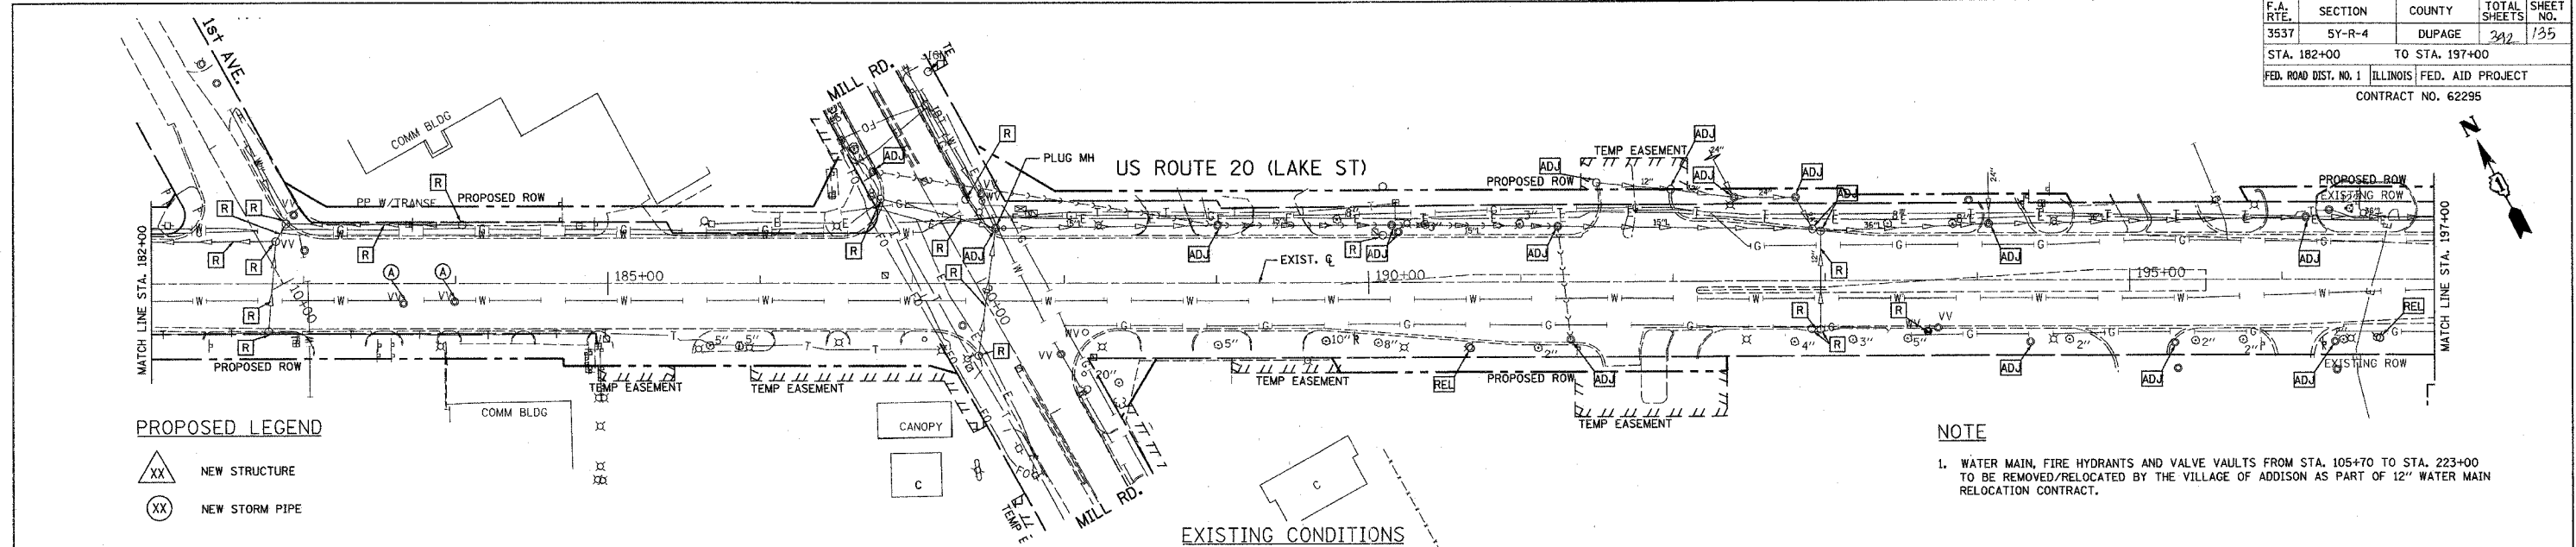


PROPOSED LEGEND



- △ XX NEW STRUCTURE
- XX NEW STORM PIPE

NOTE

1. WATER MAIN, FIRE HYDRANTS AND VALVE VAULTS FROM STA. 105+70 TO STA. 223+00 TO BE REMOVED/RELOCATED BY THE VILLAGE OF ADDISON AS PART OF 12" WATER MAIN RELOCATION CONTRACT.

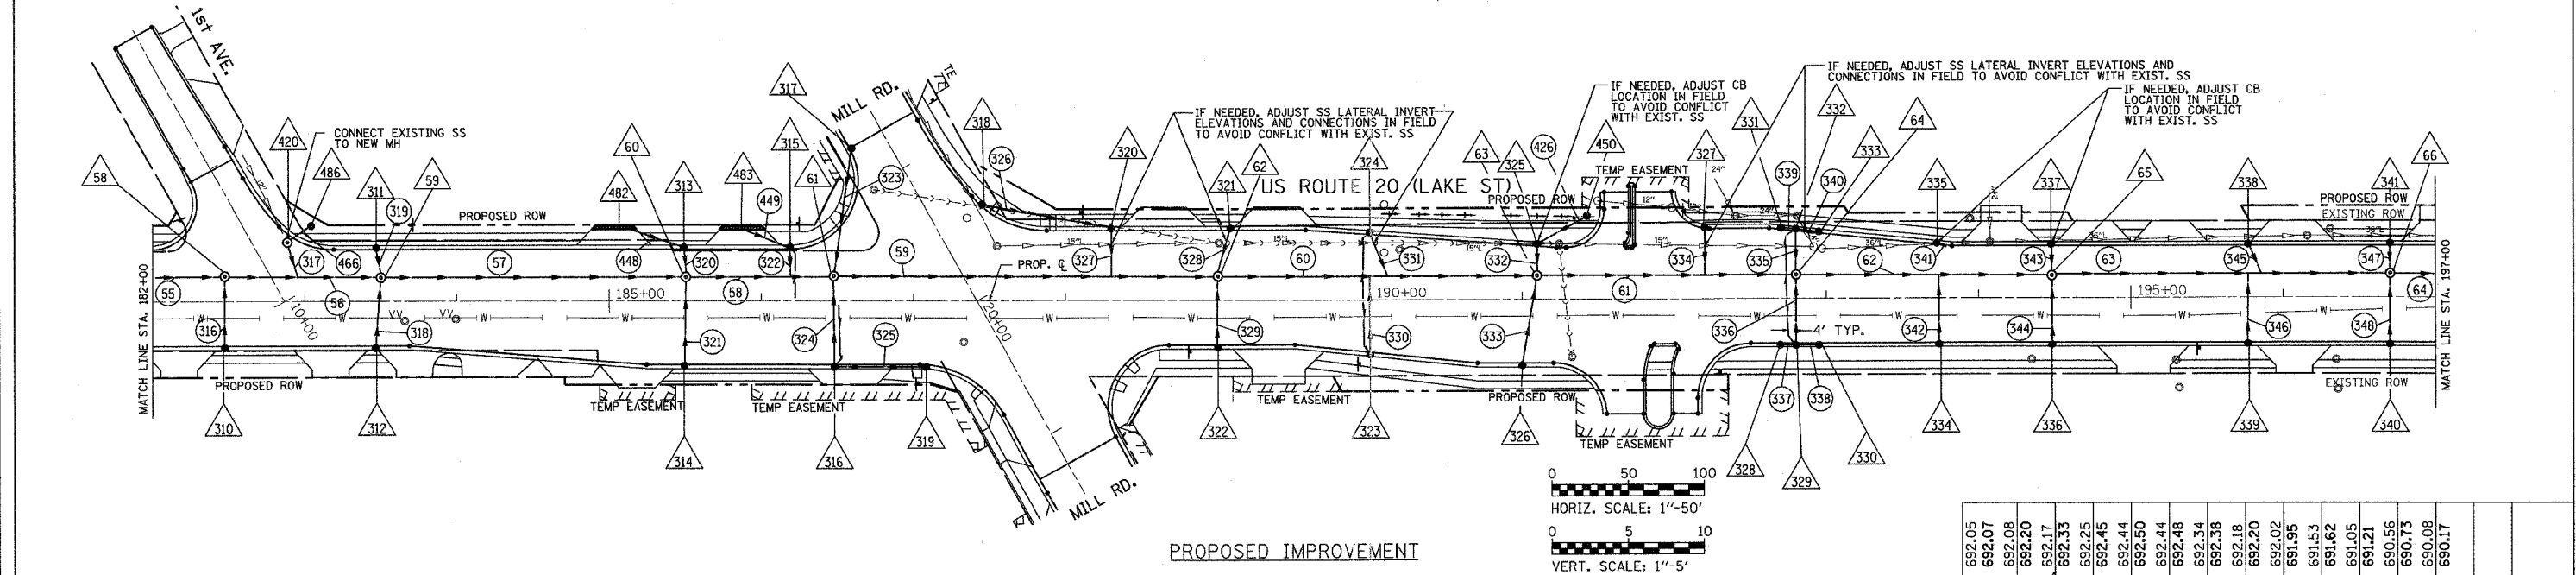

PROPOSED IMPROVEMENT

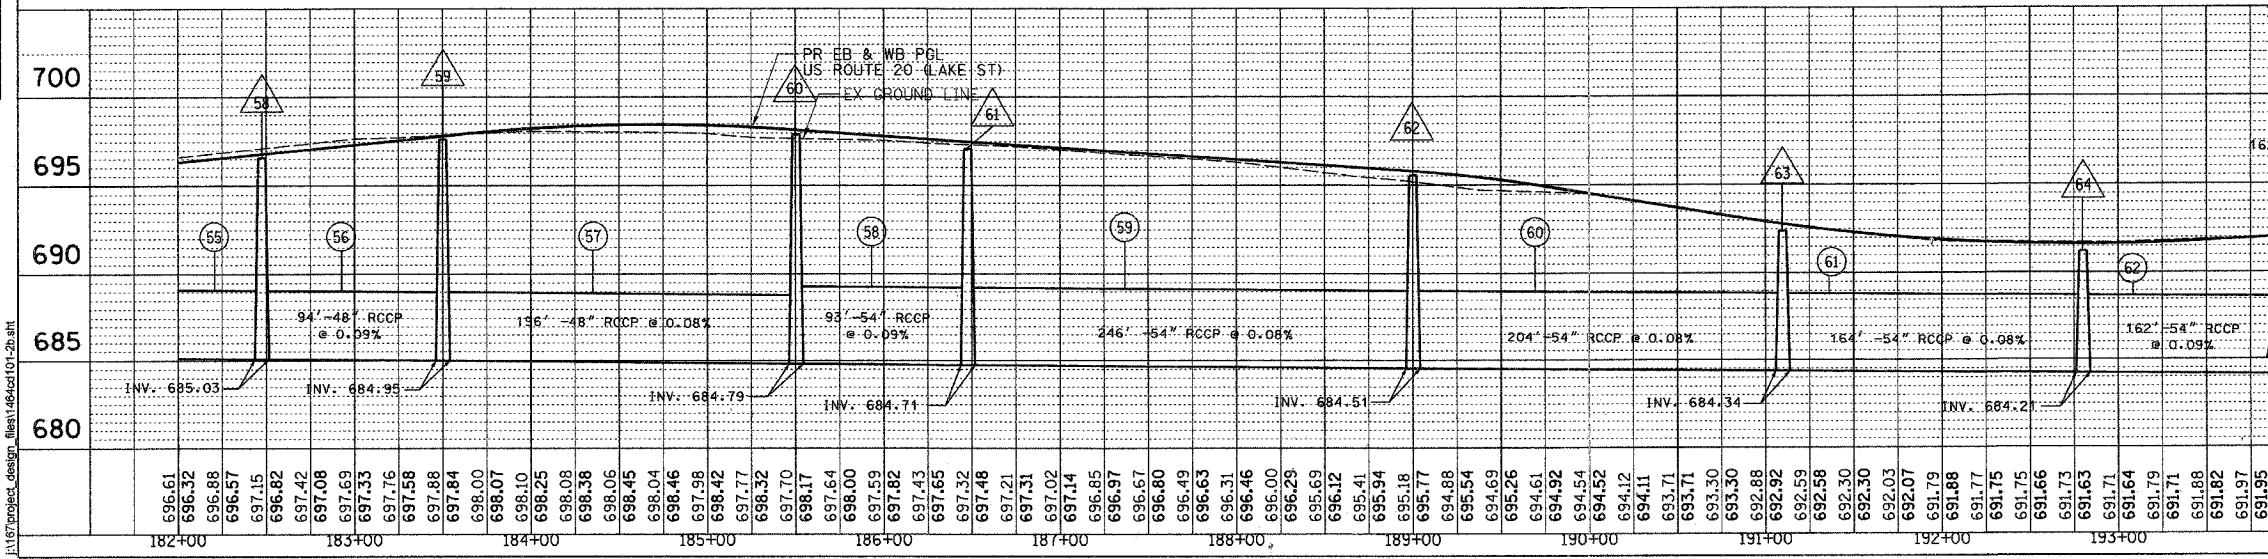

692.05	692.07	692.08	692.20	692.17	692.33	692.25	692.45	692.44	692.44	692.48	692.34	692.38	692.18	692.20	692.02	691.95	691.53	691.62	691.05	691.21	690.56	690.08	690.17
692.05	692.07	692.08	692.20	692.17	692.33	692.25	692.45	692.44	692.44	692.48	692.34	692.38	692.18	692.20	692.02	691.95	691.53	691.62	691.05	691.21	690.56	690.08	690.17

SHEET 8 OF 19

ILLINOIS DEPARTMENT OF TRANSPORTATION

DRAINAGE AND UTILITIES
STA. 182+00 STA. 197+00
U.S. ROUTE 20 (LAKE ST.)

REVISIONS	
NAME	DATE

SCALE: VERT. 1"=5'
HORIZ. 1"=50'

DATE: 03/01/05

DRAWN BY V.P.
CHECKED BY Y.J.