

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
549	116RS-1	OGLE	593	233
STA.		TO STA.		
FED. ROAD DIST. NO.		ILLINOIS FED. AID PROJECT		

LIGHTING IMPROVEMENTS

LIGHTING FOUNDATION REMOVAL

- LR - FR1
STA 369+89.06
RELOCATE EXISTING LIGHTING UNIT TO LR - PF1
- LR - FR2
STA 372+11.70
RELOCATE EXISTING LIGHTING UNIT TO LR - PF2
- LR - FR3
STA 373+63.88
RELOCATE EXISTING LIGHTING UNIT TO LR - PF3

LIGHT POLE FOUNDATION



- LR - PF1
LIGHT POLE FOUNDATION 24" DIAMETER, WITH GROUND ROD
STA. 369+89.06
FIELD LOCATE
2' BEHIND CURB
- LR - PF2
LIGHT POLE FOUNDATION 24" DIAMETER, WITH GROUND ROD
STA 372+00
5' BEHIND CURB
- LR - PF3
LIGHT POLE FOUNDATION 24" DIAMETER, WITH GROUND ROD
STA 374+20
5' BEHIND CURB

CONDUIT IN TRENCH

- LR - C1 - 64'
CONDUIT IN TRENCH, 1 1/2" INTERMEDIATE METAL
STA-369+89-
- LR - C2 - 41'
CONDUIT IN TRENCH, 1 1/2" INTERMEDIATE METAL
STA 372+00 TO 372+11
- LR - C3 - 75'
CONDUIT IN TRENCH, 1 1/2" INTERMEDIATE METAL
STA 373+00 TO 374+20

ELECTRICAL CABLE IN CONDUIT

- LR - W1
242' - ELECTRICAL CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C, NO. 6
114' - ELECTRICAL CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C, NO. 8
STA. 369+89
- LR - W2
173' - ELECTRICAL CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C, NO. 6
91' - ELECTRICAL CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C, NO. 8
STA. 372+00 TO 372+11
- LR - W3
275' - ELECTRICAL CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C, NO. 6
125' - ELECTRICAL CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C, NO. 8
STA. 373+00 TO 374+20

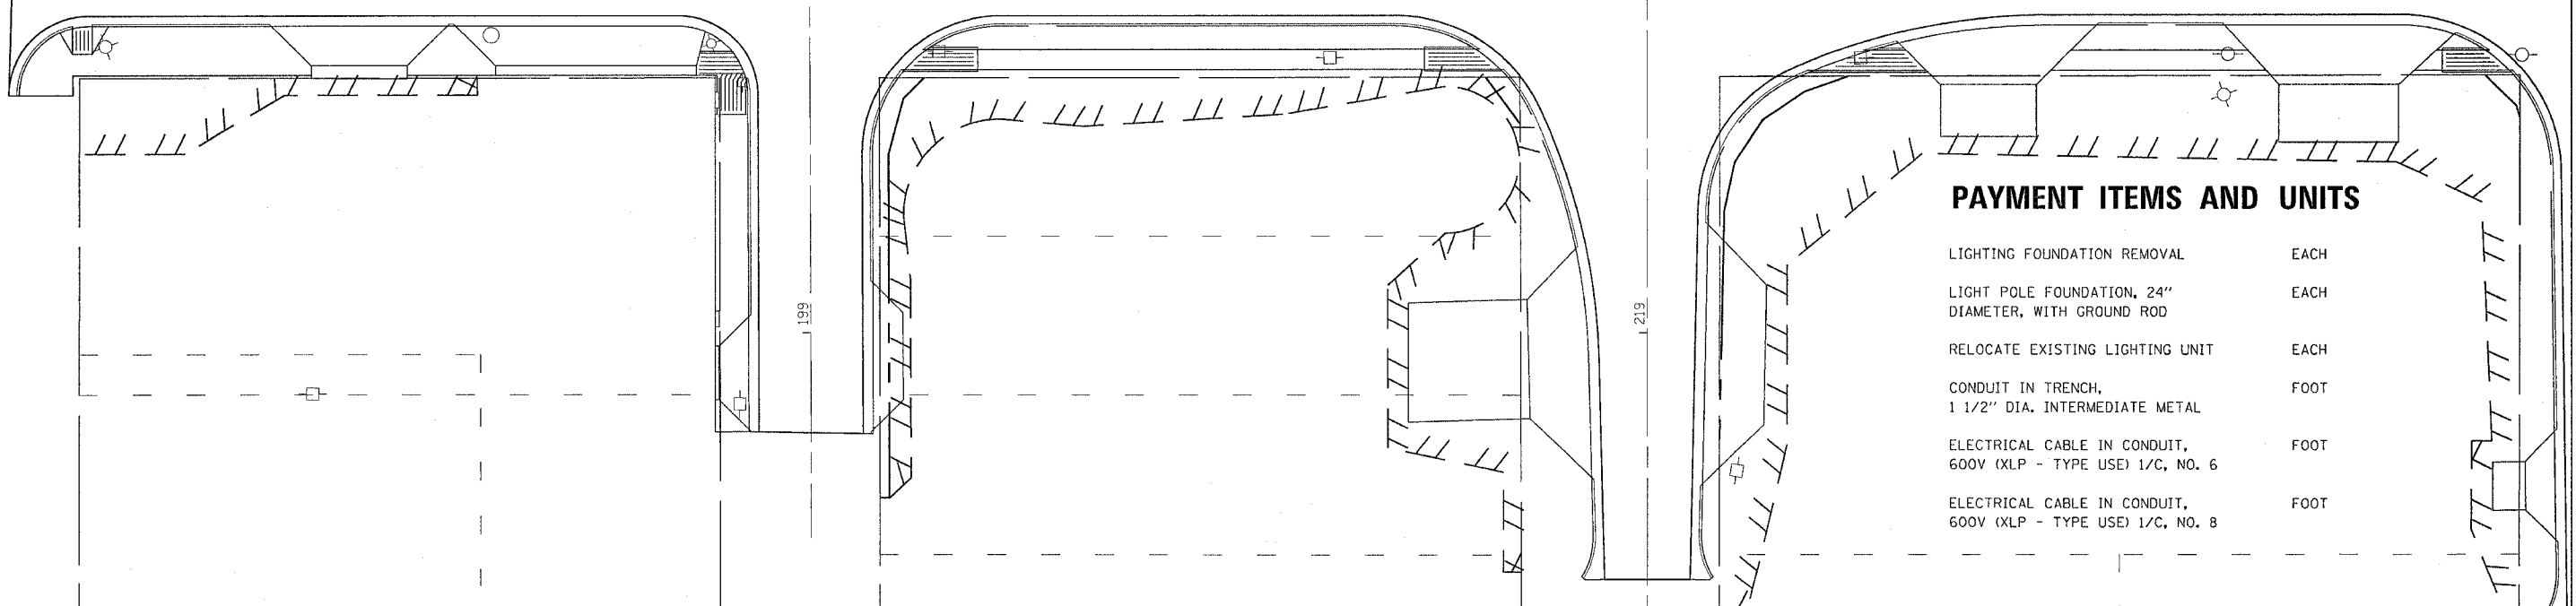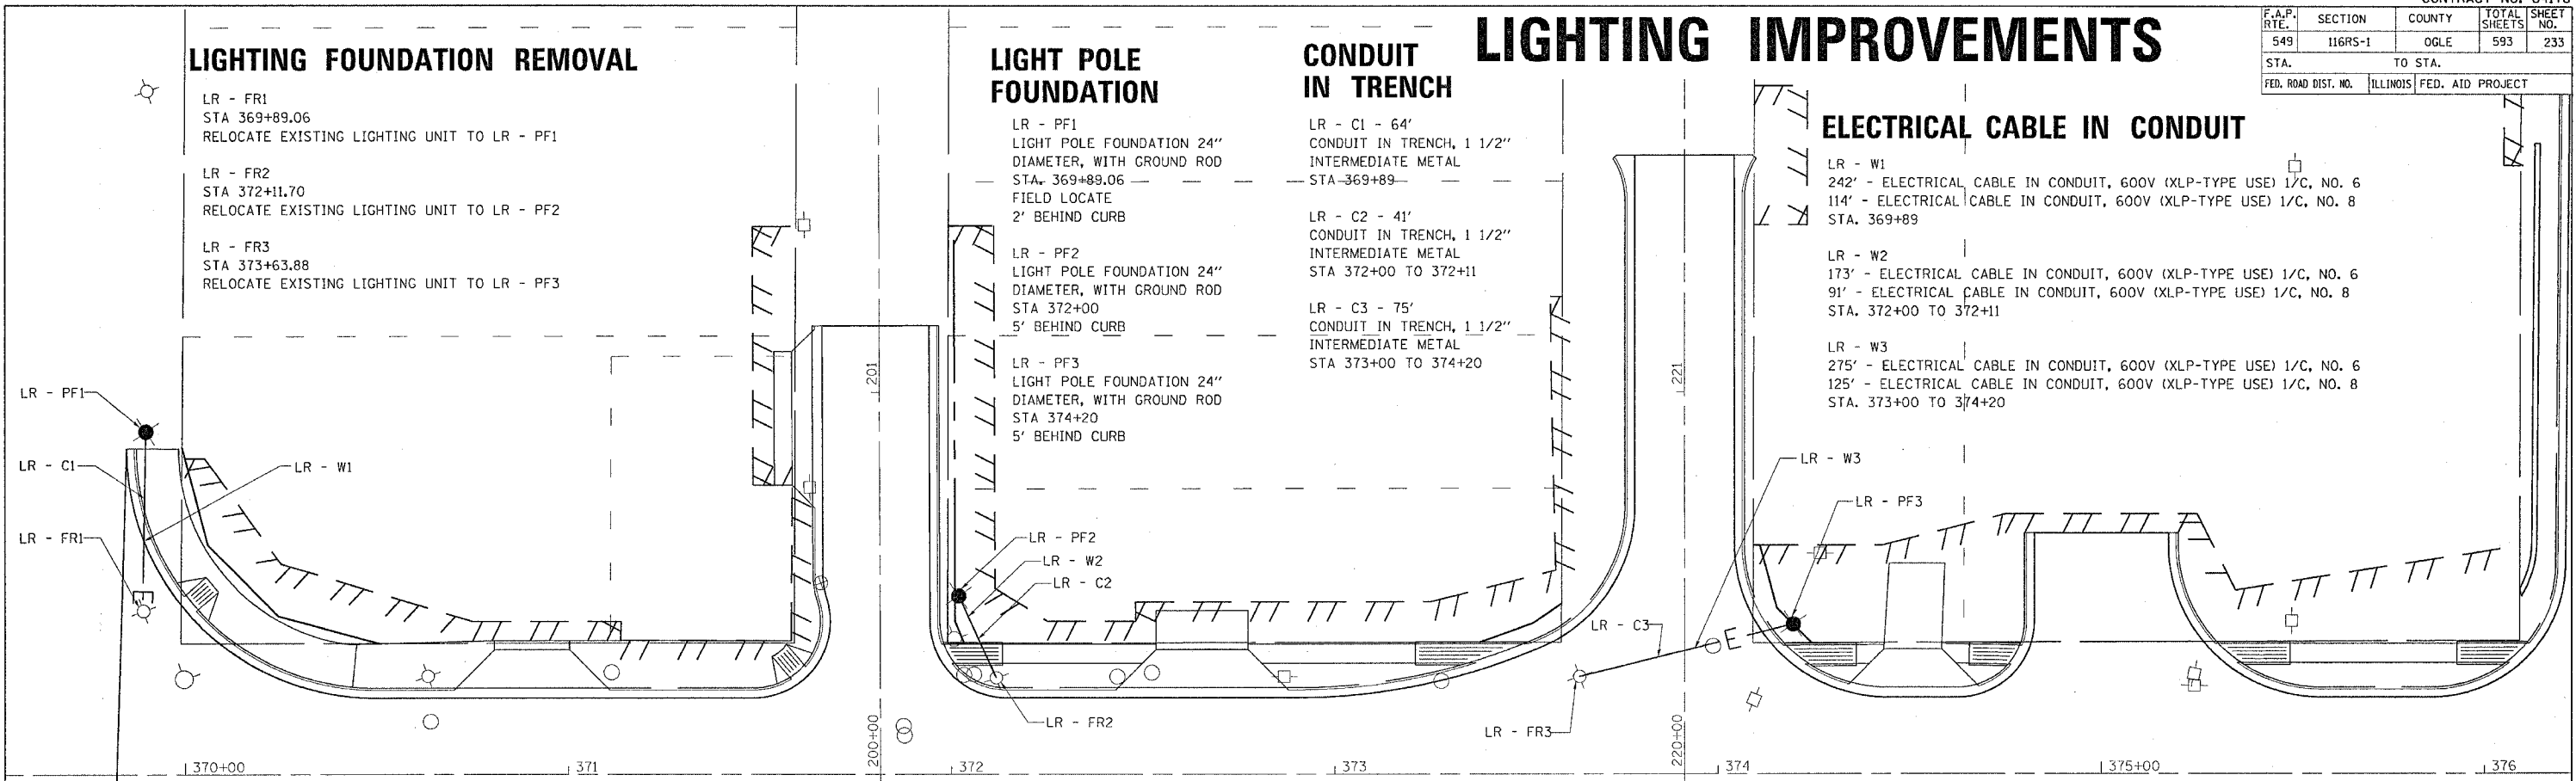

PAYMENT ITEMS AND UNITS

LIGHTING FOUNDATION REMOVAL	EACH
LIGHT POLE FOUNDATION, 24" DIAMETER, WITH GROUND ROD	EACH
RELOCATE EXISTING LIGHTING UNIT	EACH
CONDUIT IN TRENCH, 1 1/2" DIA. INTERMEDIATE METAL	FOOT
ELECTRICAL CABLE IN CONDUIT, 600V (XLP - TYPE USE) 1/C, NO. 6	FOOT
ELECTRICAL CABLE IN CONDUIT, 600V (XLP - TYPE USE) 1/C, NO. 8	FOOT

REVISIONS	
NAME	DATE

ILLINOIS DEPARTMENT OF TRANSPORTATION

SCALE: VERT. / HORIZ. / DATE

DRAWN BY / CHECKED BY

PLT DATE = Wed Feb 03 07:52:12 2005
 FILE NAME = C:\p\c\m\st\220497\000497net.dgn
 PLT SCALE = 22.0000 / IN.
 REFERENCE = BR16*