


ABBREVIATIONS

AC ALTERNATING CURRENT
 A/C AERIAL CABLE
 AFG ABOVE FINISHED GRADE
 CB CIRCUIT BREAKER
 CKT CIRCUIT
 CT CURRENT TRANSFORMER
 CP CONTROL PANEL
 DA DAVIT ARM
 DC DIRECT CURRENT
 DIA DIAMETER
 DP DISTRIBUTION PANEL
 E EXISTING UNIT TO REMAIN
 EM EXISTING UNIT TO BE MODIFIED
 ER EXISTING RELOCATED UNIT
 ET EXISTING TEMPORARY UNIT TO REMAIN
 ETR EXISTING TEMPORARY RELOCATED UNIT
 FND FOUNDATION
 FT FOOT
 FU FUSE
 GND GROUND
 HID HIGH INTENSITY DISCHARGE
 IN INCH
 JB JUNCTION BOX
 KVA KILOVOLT - AMPERE
 KW KILOWATTS
 MA MAST ARM
 MH MOUNTING HEIGHT
 NO, # NUMBER
 PB PUSH BUTTON
 PNL PANEL
 PT POTENTIAL TRANSFORMER
 R EXISTING UNIT OR EQUIPMENT TO BE REMOVED (OWNER SALVAGED UNLESS NOTED OTHERWISE)
 RR EXISTING UNIT TO BE REMOVED AND REINSTALLED
 RECP RECEPTACLE
 RGC RIGID GALVANIZED CONDUIT
 SEL SW SELECTOR SWITCH
 SS STAINLESS STEEL
 STA STATION

T TEMPORARY LIGHTING UNIT
 TYP TYPICAL
 TEMP TEMPORARY
 TR TEMPORARY UNIT TO BE REMOVED SALVAGE EQUIPMENT AS SPECIFIED
 TRR TEMPORARY UNIT TO BE REMOVED AND RELOCATED
 UD UNIT DUCT
 WP WEATHERPROOF
 XFMR TRANSFORMER

ELECTRICAL SYMBOLS

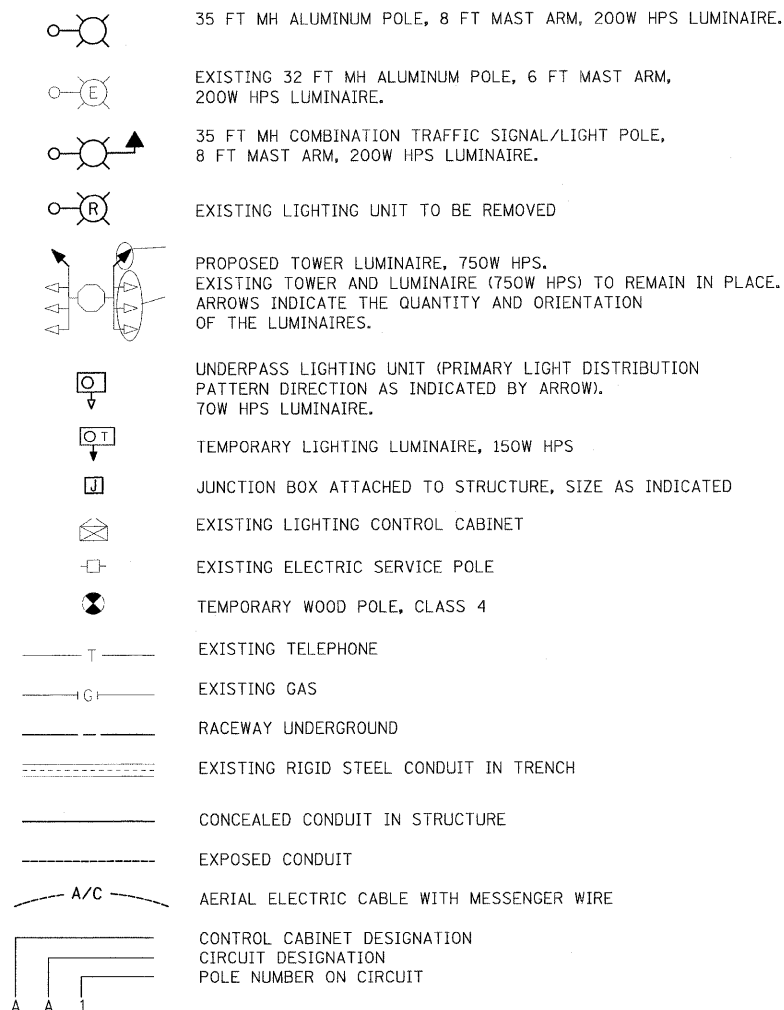

SCHEDULE OF QUANTITIES

DESCRIPTION	UNIT	QUANTITY
CONDUIT PUSHED, 4 " DIA., GALVANIZED STEEL	FOOT	71
CONDUIT PUSHED, 4 " DIA., PVC	FOOT	71
CONDUIT ATTACHED TO STRUCTURE, 1" DIA., GALVANIZED STEEL	FOOT	1307
CONDUIT ATTACHED TO STRUCTURE, 2" DIA., GALVANIZED STEEL	FOOT	1155
CONDUIT ATTACHED TO STRUCTURE, 2 1/2" DIA., GALVANIZED STEEL	FOOT	30
CONDUIT EMBEDDED IN STRUCTURE, 1" DIA., PVC	FOOT	40
CONDUIT EMBEDDED IN STRUCTURE, 2" DIA., PVC	FOOT	30
CONDUIT EMBEDDED IN STRUCTURE, 2 1/2" DIA., PVC	FOOT	2339
JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 6" x 6" x 4"	EACH	22
JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 12" x 12" x 6"	EACH	33
JUNCTION BOX, STAINLESS STEEL, ATTACHED TO STRUCTURE, 16" x 12" x 6"	EACH	6
UNIT DUCT, 600V, 3-1C NO. 6, 1/C NO. 8 GROUND, (XLP-TYPE USE), 1" DIA., POLYETHYLENE	FOOT	157
UNIT DUCT, 600V, 3-1C NO. 2, 1/C NO. 4 GROUND, (XLP-TYPE USE), 1 1/4" DIA., POLYETHYLENE	FOOT	177
ELECTRIC CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C NO. 10	FOOT	5339
ELECTRIC CABLE IN CONDUIT, 600V (XLP-TYPE USE) 1/C NO. 8	FOOT	3665
ELECTRIC CABLE IN CONDUIT, 600V (XLP-TYPE USE) 3-1/C NO. 6	FOOT	3665
ELECTRIC CABLE IN CONDUIT, 600V (XLP-TYPE USE) 3-1/C NO. 8	FOOT	233
AERIAL CABLE, 3-1/C NO. 1/0, WITH MESSENGER WIRE	FOOT	646
AERIAL CABLE, 3-1/C NO. 4, WITH MESSENGER WIRE	FOOT	734
TRENCH AND BACKFILL FOR ELECTRICAL WORK	FOOT	295
LUMINAIRE, SODIUM VAPOR, HORIZONTAL MOUNT, 200 WATT	EACH	24
LUMINAIRE, SODIUM VAPOR, HIGH MAST, HORIZONTAL MOUNT, 750 WATT	EACH	4
UNDERPASS LUMINAIRE, 70 WATT, HIGH PRESSURE SODIUM VAPOR	EACH	22
UNDERPASS LUMINAIRE, 150 WATT, HIGH PRESSURE SODIUM VAPOR	EACH	7
LIGHT POLE, ALUMINUM, 35 FT. M.H., 8 FT. MAST ARM	EACH	22
LIGHT POLE, WOOD, 30 FOOT, CLASS 4	EACH	5
REMOVAL OF LIGHTING UNIT, NO SALVAGE	EACH	22
REMOVAL OF LIGHTING CONTROLLER	EACH	1
REMOVAL OF ELECTRIC SERVICE INSTALLATION	EACH	1
REMOVAL OF LIGHTING CONTROLLER FOUNDATION	EACH	1
REMOVE ELECTRIC CABLE FROM CONDUIT	FOOT	377
ROD AND CLEAN EXISTING CONDUIT	FOOT	164
MODIFY EXISTING LIGHTING CONTROLLER	EACH	1
LUMINAIRE SAFETY CABLE ASSEMBLY	EACH	24
MAINTENANCE OF EXISTING LIGHTING SYSTEM COMPLETE	L. SUM	1